

Manufacturer

ait-deutschland GmbH
Industriestraße 3
95359 Kasendorf
Germany

T +49 9228 9977 0
F +49 9228 9977 149
E info@kkt-chillers.com
W www.kkt-chillers.com

Representative in the US and Service Center

KKT chillers, Inc.
1280 Landmeier Road
Elk Grove
IL 60007

T 847 734 1600
F 847 734 1601
TF 866 517 6867
E support@kkt-chillersusa.com

YOUR LOCAL SERVICE CONTRACTOR IS:

COMPANY NAME:

PHONE NUMBER:

FAX NUMBER:

Contents

I Technical Data	4
I. Basics	5
II. Installation site	7
a) Ambient temperatures	7
b) Clearance	7
c) Servicing and repair access	7
d) Air flow	7
e) Load capacity of the base	7
III. Transport route/transport	10
a) Transport measurements	10
b) Transport weight	10
c) Transport safety locks	10
d) Crane transport	10
e) Dimensions in inch	12
f) Dimensions in mm	13
g) Weights	14
IV. Power supply/electrical connection	14
a) Follow local regulations	14
b) Voltage, frequency, tolerances	14
c) Type of cable	14
d) Length and cable width	14
e) Strain relief	14
f) Clamps	15
g) Fuse	16
h) Phase sequence	16
i) EMC Compatibility and Grounding	17
j) Data cable	18
V. Interface filter panel (IFP)	20
Scope of IFP supply:	21
Installation of IFP	21
VI. Water connection	22
a) Pipe material	22
b) Relation of pipe diameter to distance between chiller and IFP	22
c) Dimensions of the connections	22
d) Inflow and outflow	22
e) Water quality	22
f) Glycol	23
g) Filling	23
h) Vents and air chambers	23
VII. Initial start-up	27
VIII. SPS Settings	28
IX. Control	31
a) Pump	31

Installing Instruction
Healthcare chiller of the KSC Series



Version „Revision 05“

Type KSC 215-L-U/S

page 3 von 39

b) Water pressures	31
c) Compressor.....	31
d) Vents	31
e) Refrigerant pressures	31
f) Temperatures	31
X Overview water chiller and IFP	32
XI Trouble Shooting	33
XII. Maintenance.....	38
XIII. Warranty.....	38
XIV. Safety Warnings	38

Installing Instruction

Healthcare chiller of the KSC Series



Version „Revision 05“

Type KSC 215-L-U/S

page 4 von 39

I Technical Data

Model	Outdoor		
Dimensions	Depth	940	mm
	Width	3040	mm
	Height	1850	mm
Weight without refrigerant load	ca.	1066	kg
Weight with load	ca.	1090	kg
Shipping weight	ca.	1600	kg
Weight total refrigerant load		24.0	kg
Quantity of air	2x	18000	m ³ /h
Number of fans		4	
Refrigerant		R134a	
Required quantity of refrigerant		2x12kg	
High-pressure switch		19	bar
Water connection inlet	internal	2" G" female thread	
Water connection outlet	internal	2" G" female thread	
Cold water temperature outlet	min.	19-22	°C ±0.5 K
Cold water temperature inlet	max.	30	°C
Primary water pump type 60Hz		CR 10 - 05	
Primary water pump type 50Hz		CR 10 - 07	
Rated water capacity	min.	7.8	m ³ /h
Rated water pressure		6.5	bar
Ambient temperature		min.-20	°C
		max.+48	°C
Cooling capacity		60.0	kW
Rated cold water outlet temperature		20	°C
Temperature of surroundings		48	°C
Main supply	380-480 V / 3Ph / 50-60 Hz		
Control voltage		24	VDc
Fluctuations in main voltage	max.	-14+10	%
Fluctuations in frequency	max.	±1	Hz
Power input	max.	29	kW
Noise level	at 5 m	max.68	db(A)
at max cooling capacity and max. ambient temperature			

I. Basics

Scope of Chiller supply:

- KSC215-L-...
- Installing Instruction inside the switch cabinet
- Manual inside the switch cabinet
- Data transfer cable 50m (164feet) in a box near the pump
- Short data transfer cable in a box near the pump
- Grounding in a box near the pump
- Overvoltage protection in a box near the pump
- Spare parts in a box near the pump
- Brass fittings for the connection Chiller inlet/outlet and piping (on the pump)
- Stainless steel fittings for the connection piping and IFP (on the pump)

Carefully read the operating instructions located in the control cabinet before beginning installation.

Check the equipment for damage on arrival and report any defects immediately.

Claims submitted later cannot be honored.

Please observe the following notes and warnings.

1. Removing the operating instructions from the cooling block voids the warranty!
2. The volume of the water circulation system of the cooling block is approx. 17 liters (~4.5 gal) Please consider this by filling the water system with water ethylene glycol mixture.
3. Always operate the water circulation system at a volume of 35-38% ethylene glycol.

<p>This is regardless of the ambient temperature. Non-compliance voids the warranty.</p>
--

Use of automobile anti-freeze and propylene glycol is prohibited.

Fill with clean water (potable water quality) with Ethylene-glycol at the rate of min. 35% to max. 38%.

Use ethylene-glycol of only one manufacturer.

(e.g.: DOWTHERM SR1-Dow Chemical, Safeflow EG-Clariant)

Do not mix two or more different manufacturer for one water-ethylene-glycol circuit.

Open front panel and fill to a pressure of min.1,5 bar via the feed cock when the pump is off.

Installing Instruction

Healthcare chiller of the KSC Series



Version „Revision 05”

Type KSC 215-L-U/S

page 6 von 39

After filling, check all connections for leakage.

4. With the pump turned off, fill the system to a static water pressure of 1.5 bar (21.75 psi) by Avanto an Chiller at the same level. **(Also see Table 1 page24)**
5. The cooling block operates completely independently of the MR system.
6. Voltage is still present in the KSC control cabinet when the MR system is turned off. **Risk of death!**
7. Even with the cooling block turned off, high surface temperatures can cause burns. **Risk of death!**

Only trained and qualified personnel are permitted to install, start up, and repair the cooling block.

II. Installation site

a) Ambient temperatures

The chiller is designed to operate at ambient temperatures between -20°C (-4°F) minimum and $+48^{\circ}\text{C}$ ($+118.4^{\circ}\text{F}$) maximum.
Malfunctions can occur outside these specifications.

If the chiller is used at high ambient temperatures (higher than $40^{\circ}\text{C} = 104^{\circ}\text{F}$) the the chiller should be installed that the switch cabinet is not fully exposed to the sun radiation when the maximum ambient temperature is prevent. If this is not possible please install a sun protection!!
Support from KKT chillers could be requested.

b) Clearance

Maintain at least 100 cm (39.4 in.) around all four sides of the chiller for air intake and servicing/repair.

Under no circumstances install a roof above the chiller.

c) Servicing and repair access

See Clearance

d) Air flow

Never obstruct the air intake to the condensers on the upper third of the chiller.
The diameter of the tubes may not be smaller than the size specified.

e) Load capacity of the base

Verify that the installation surface has sufficient load capacity.
A concrete foundation or sectional steel construction is recommended.

A concrete foundation needs to be 200 mm (7.8 in.) wider and 200 mm (7.8 in.) longer than the cooling block. Final dimensions: approx. 3,200 mm (10.5 feet) long by 1,100 mm (3.6 ft) wide.

The operating weight of the chiller is approx. 1,100 kg (2,425 lbs.).

It is important that the cooling block be installed on a level surface.

Installing Instruction

Healthcare chiller of the KSC Series





Version „Revision 05”

Type KSC 215-L-U/S

page 8 von 39


waterchiller installation I

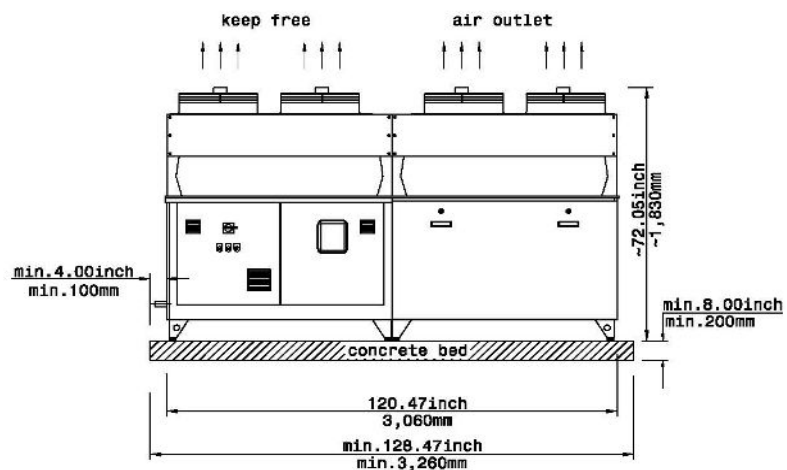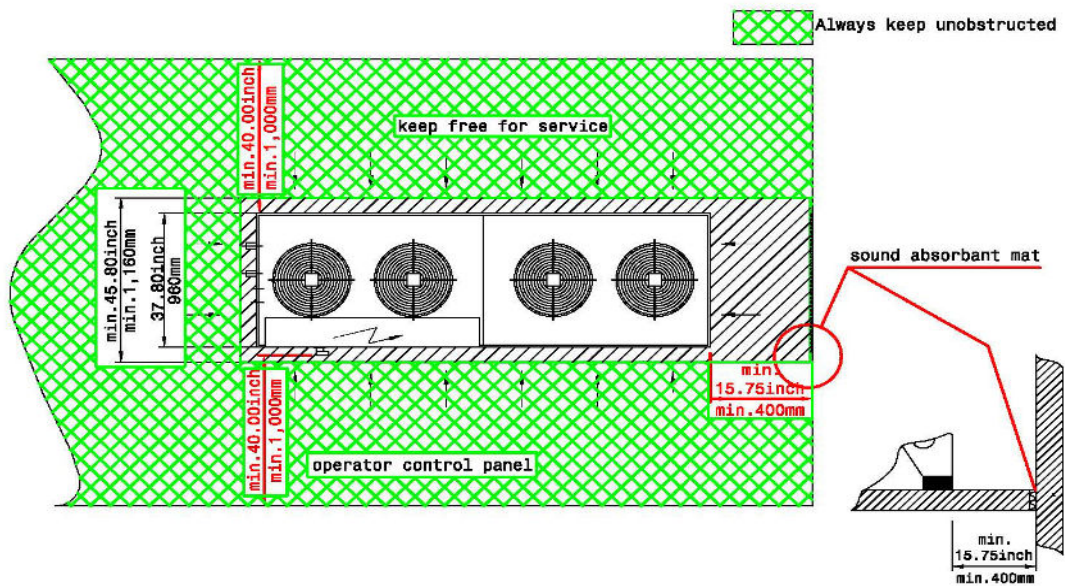


Dimensions for the concrete bed should be adjusted according to local circumstances.

waterchiller installation II

installation example A

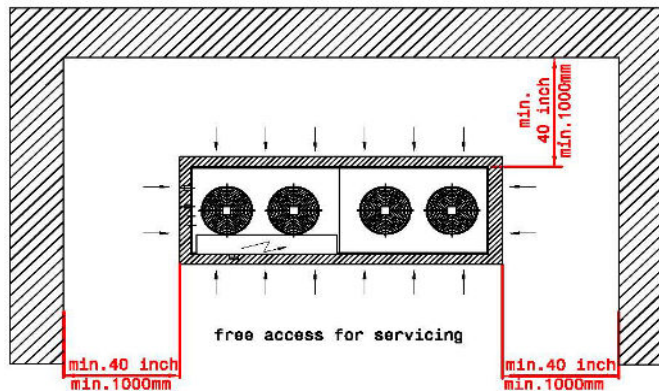


installation example B

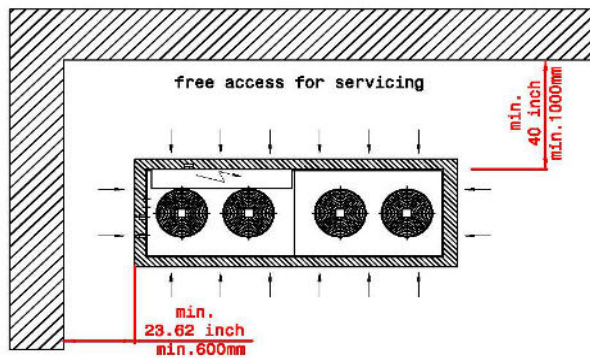

installation example C

Air outlet keep free!

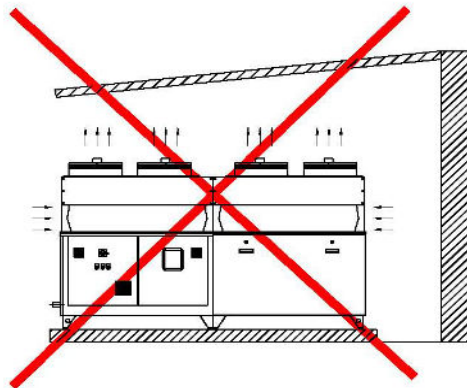

III. Transport route/transport

a) Transport measurements

Length: approx. 3,200 mm (126 inches)
Width: approx. 1,100mm (43.3 inches)
Height: approx. 2,150mm (approx. 84.65 inches)

You also need to add the height of the transport equipment, such as pallets, lift truck, transport rollers, etc.

b) Transport weight

Weight: approx. 1,600 kg (approx. 3,528 lbs.)

c) Transport safety locks

There are no transport safety locks to remove.

d) Crane transport

If a crane will be used to transport the chiller, note the following:

Lift the chiller only from its base. Insert two steel rods through the holes in the base. The rods must be specifically designed for this purpose and able to support the weight (1,100 kg./2,425 lbs.).

Secure the rods with locking pins to prevent shifting.

Use only straps or rope for lifting from the rods.

The straps or ropes must be held in place with a frame to keep them from pressing into the side walls, gutters, and condenser body. (Refer to the following graphic).

Installing Instruction


Healthcare chiller of the KSC Series



Version „Revision 05“

Type KSC 215-L-U/S

page 11 von 39

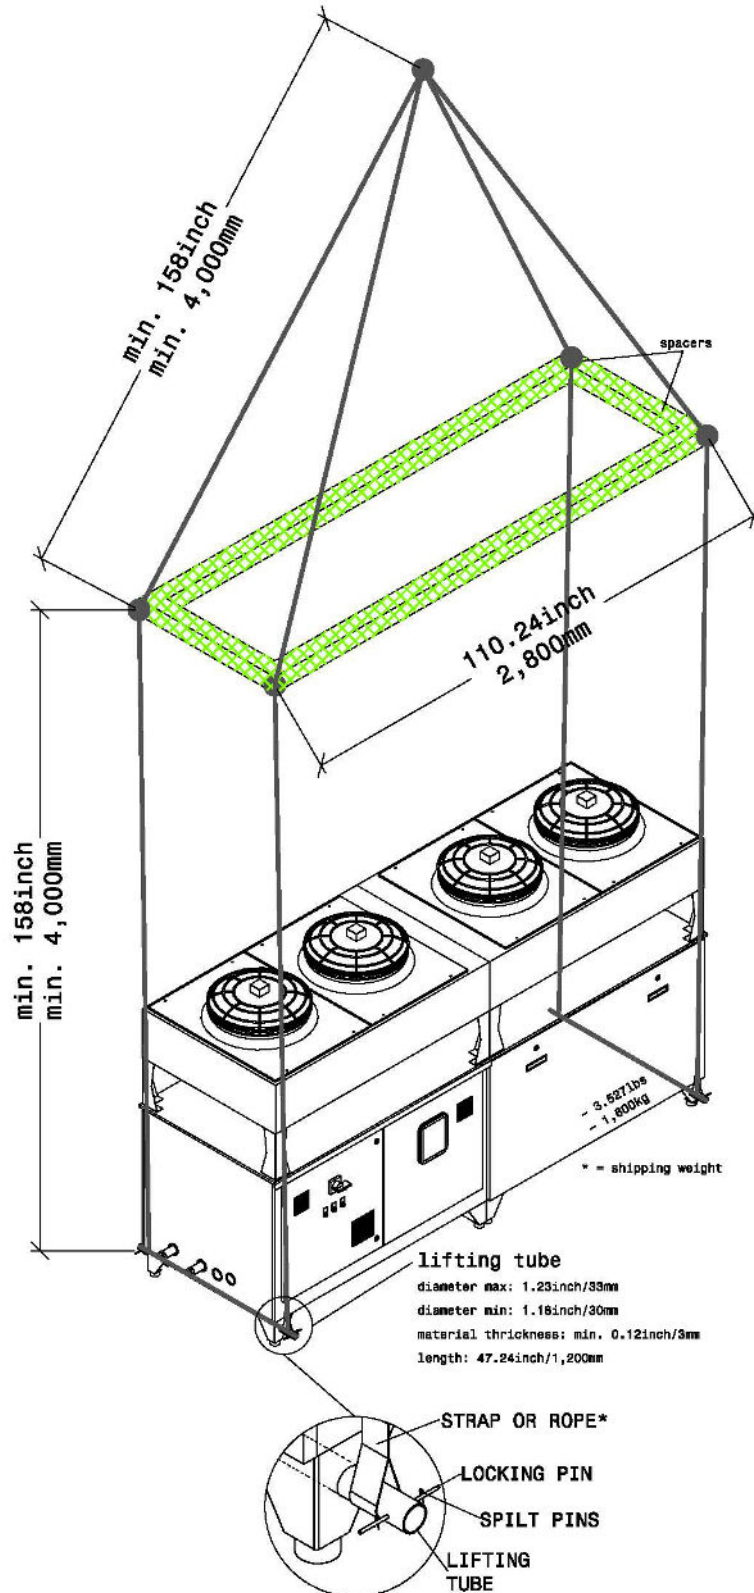

***Attention: don't use metal rope !!**

Installing Instruction

Healthcare chiller of the KSC Series




Version „Revision 05”

Type KSC 215-L-U/S

page 12 von 39

e) Dimensions in inch

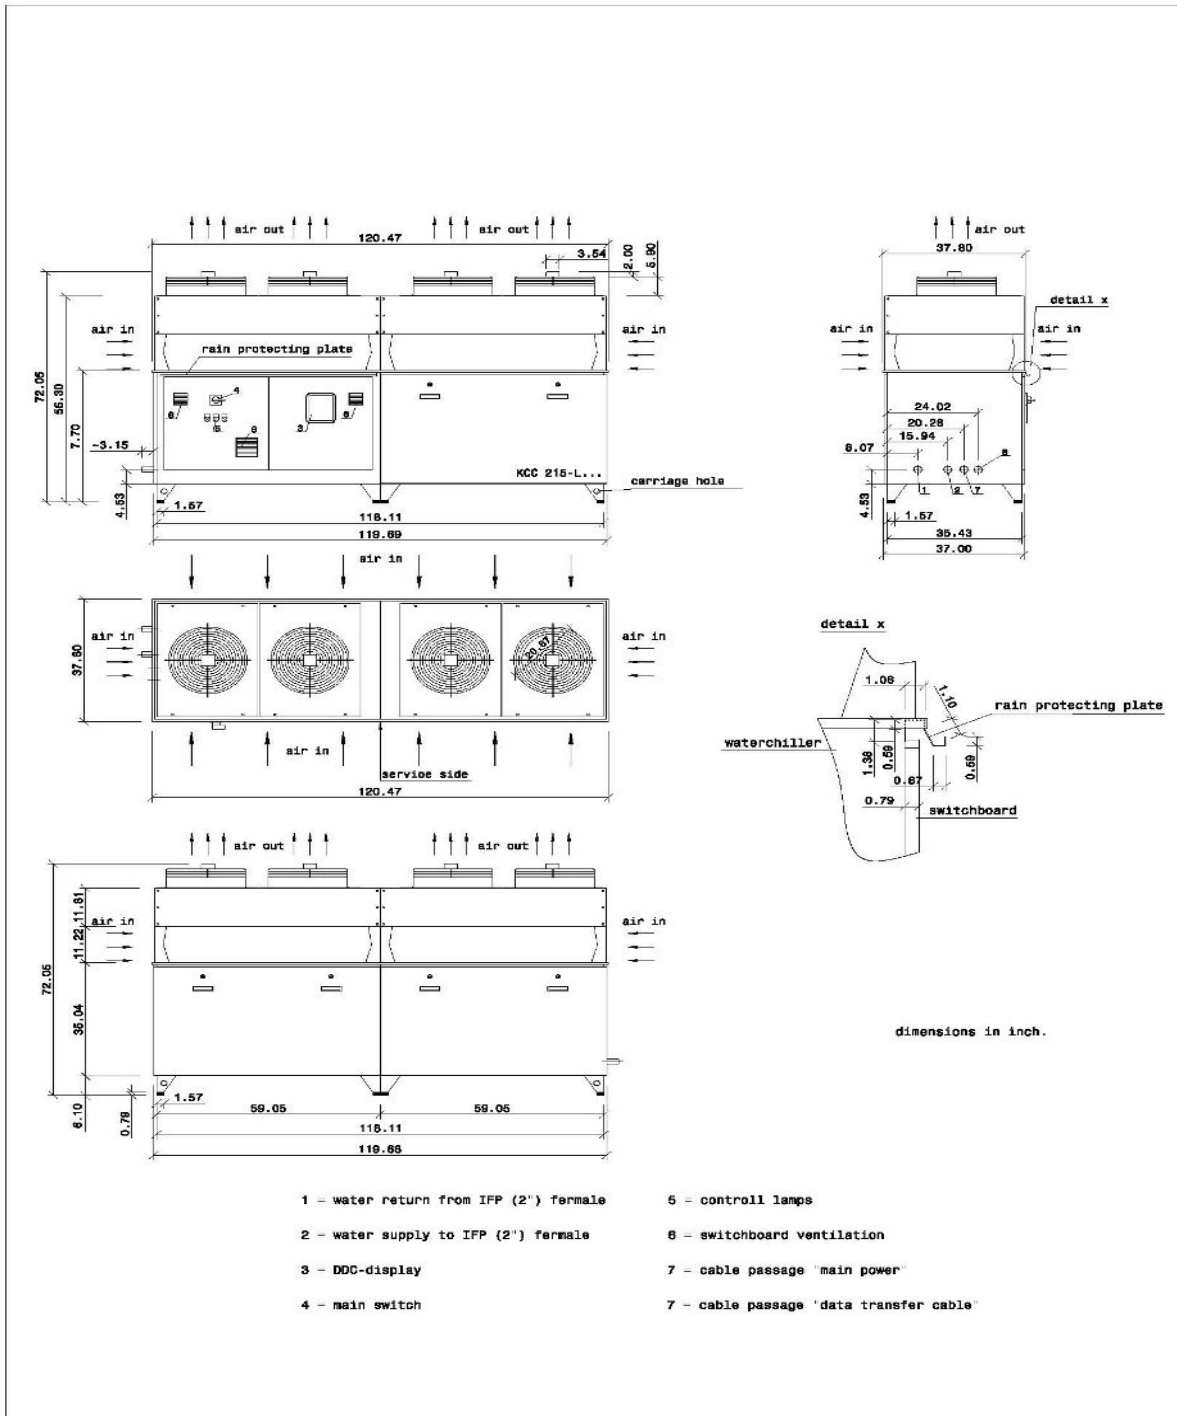

Installing Instruction

Healthcare chiller of the KSC Series




Version „Revision 05”

Type KSC 215-L-U/S

page 13 von 39

f) Dimensions in mm

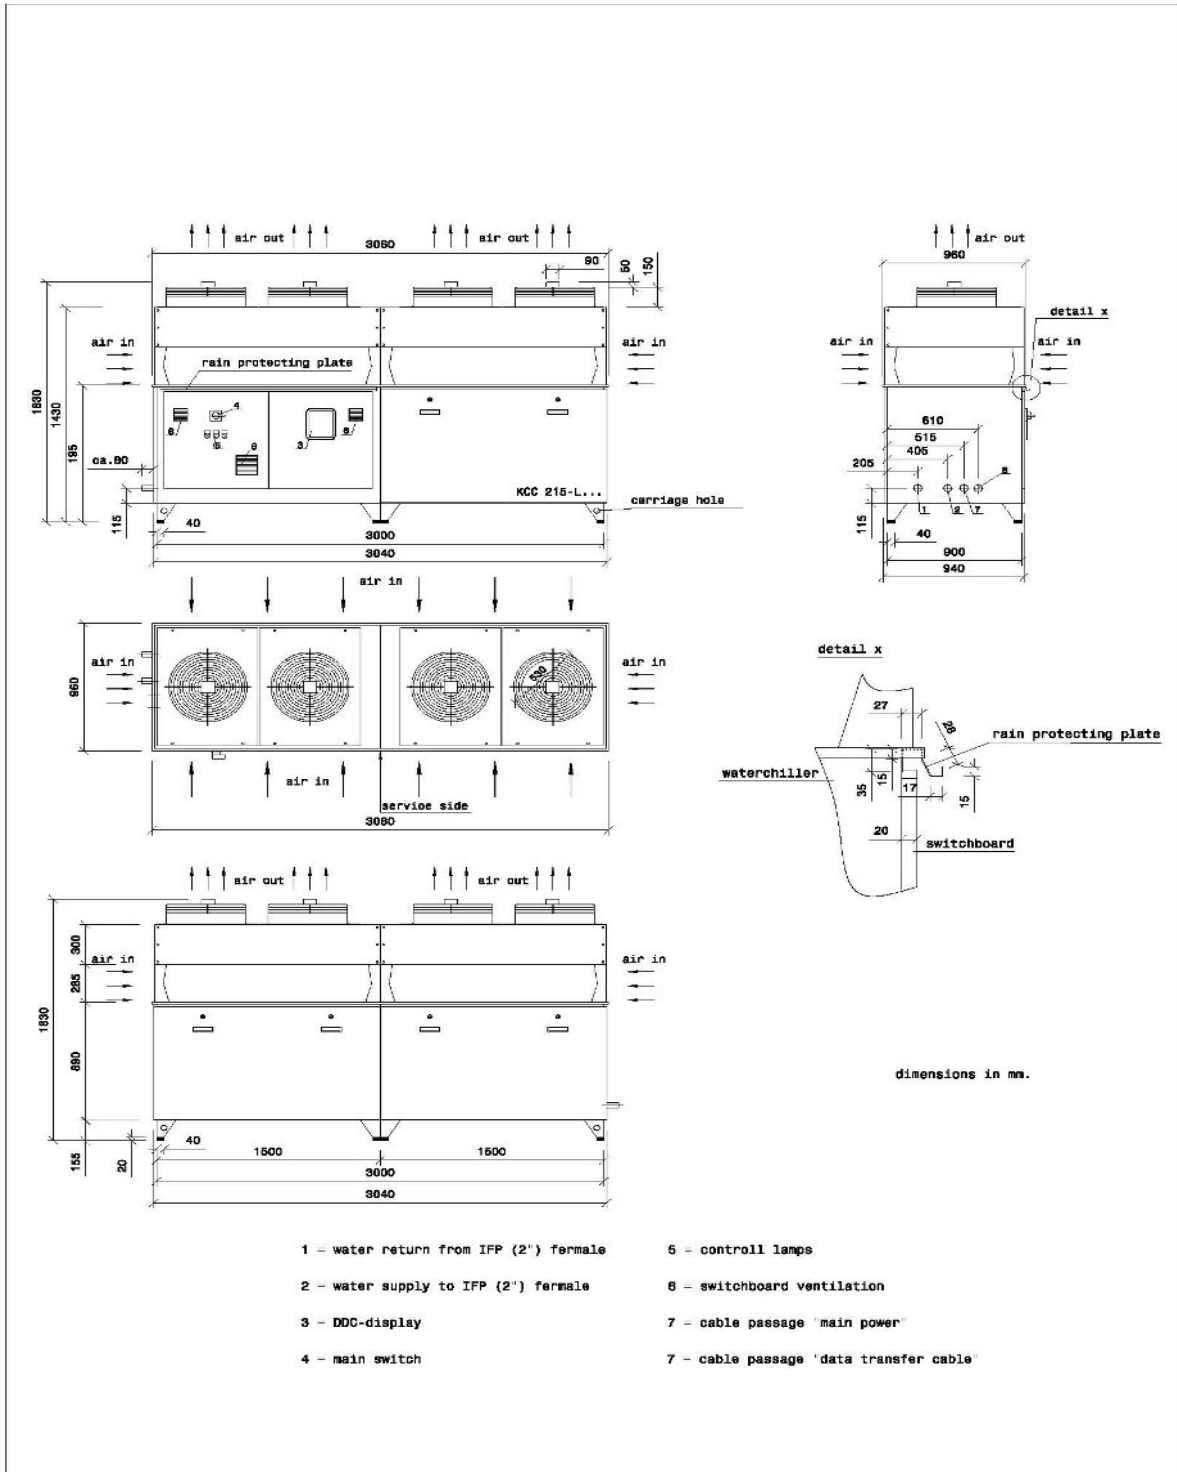

g) Weights

Net weight:	1,060 kg. (2,337 lbs.)
Operating weight:	approx. 1,100 kg. (2,425 lbs.)
Transport weight:	approx. 1,600 kg (3,527.4 lbs.)
Refrigerant:	approx. 2 X 12 kg. (26.45 lbs.) R 134a

IV. Power supply/electrical connection

a) Follow local regulations

Strictly adhere to the regulations of the local power company and authorities. Only trained, authorized persons are permitted to connect the power.

b) Voltage, frequency, tolerances

Voltage range: 380 - 480 Volt -14%+10%

Frequency range: 50 – 60Hz +/-1Hz

c) Type of cable

Make sure to use appropriately designed and approved cables when routing.

d) Length and cable width

A cable width of at least 16mm² per phase is required for cables up to 50 meters (164 ft.) in length.


Therefore, a 5 x 16mm² cable is required.

e) Strain relief


The input cable must be fitted on both sides with a strain relief.

f) Clamps

Insert the input cable through the cable feed-through (see photograph) next to the water connections. Route it into the control cabinet through the cable channel installed on the back of the control cabinet.

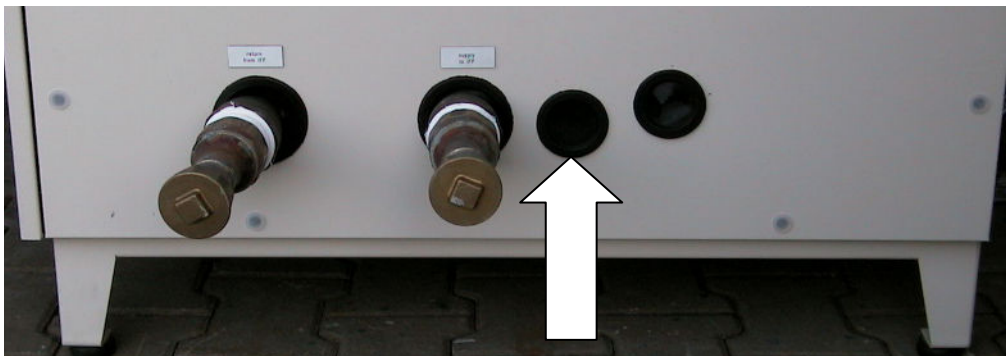

Use the clamps to secure the routed cable (see photograph).

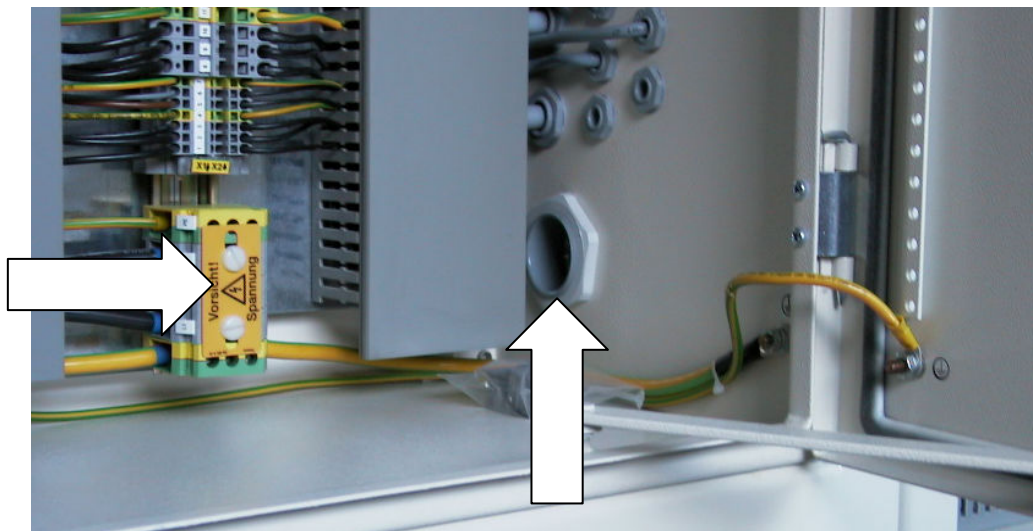

Attention!!

Do not pass the power supply line across the switch cabinet!!

Use cable opening in the lower right hand side of cabinet!!

Drilling holes into and running cables into the cabinet can cause interferences with the regulation electronics!!

g) Fuse

Maximum 60 A slow-blowing fuse for pre-fusing.

Maximum overcurrent of 200 A for 50 msec.

h) Phase sequence

Observe the correct phase sequence when routing the wires, otherwise the cooling block will not start. A phase sequence relay (5A1) is installed for this purpose.

The monitoring relay has its own power supply, measured voltage = supply voltage. The relay monitors the phase sequence and the phase failure of one of the three phases in a 3-phase network. No settings are necessary.

When the line voltage is switched on, the green LED lights up. If the correct phase sequence is applied to the terminals L1-L2-L3, the output relay picks up.

If the wrong phase sequence is applied, the red LED blinks and the output relay does not pick up. If a phase failure occurs, the red LED lights up and the output relay drops out.

Attention: The red LED is an error diagnosis indicator and does not show the current state of the relay.


i) EMC Compatibility and Grounding

This comments are compiled to help the field electrician to install the grounding of the power supply and to get a EMC Compatibility.

All electrical equipment produces radio and line-borne interference at various frequencies. The cables pass this on to the environment like an aerial.

The basic countermeasures are isolation of the wiring of control and power components, proper grounding and shielding of cables.

A large contact area is necessary for low-impedance grounding of HF interference. The use of grounding straps instead of cables is therefore definitely advisable.

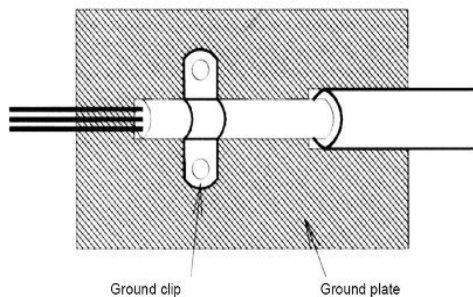

Moreover, cable shields must be connected with purpose-made ground clips.

The grounding surface must be highly conductive bare metal. Remove any coats of varnish and paint.

The width of the grounding wire must be min. 16mm^2 (AWG 6) or of the same width of the power supply.

The grounding must be an isolated ground and must be connected on the ground terminal (X1) in the switch cabinet. The ground resistance must be less than 10 Ohm.


Metal cable conduits are not allowed for grounding.

The piping of the chiller (supply and return) have to be grounded too.

Do not share the ground wire with other devices.


Always use a ground wire that complies with technical standards on electrical equipment and minimize the length of the ground wire.

When using more than one Inverter, be careful not to loop the ground wire.
(e.g. a CT-Chiller KPC108-L-U/S stands near an Avanto-Chiller KSC215-L-U/S)

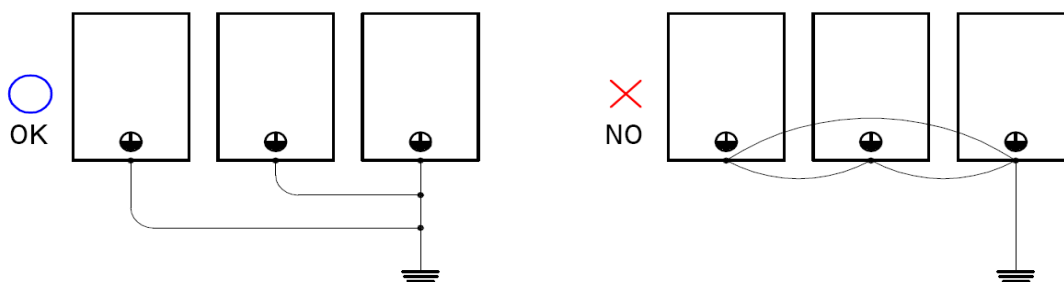


j) Data cable

Attach the “X8 Chiller” end of the 16-pin data cable (included) to the green connector (see photograph) at the top right of the control cabinet.

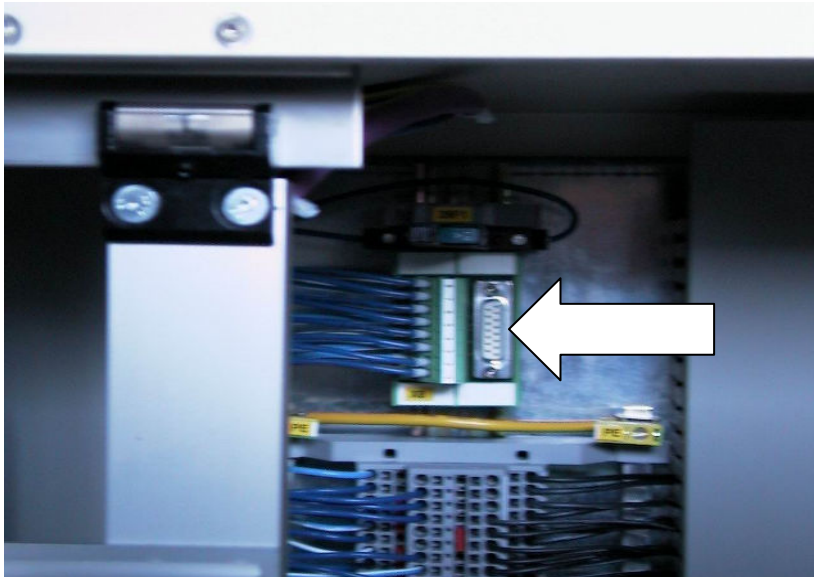

Power plug

A separate feed-through for the power plug is located on the right wall of the control cabinet (see photograph).

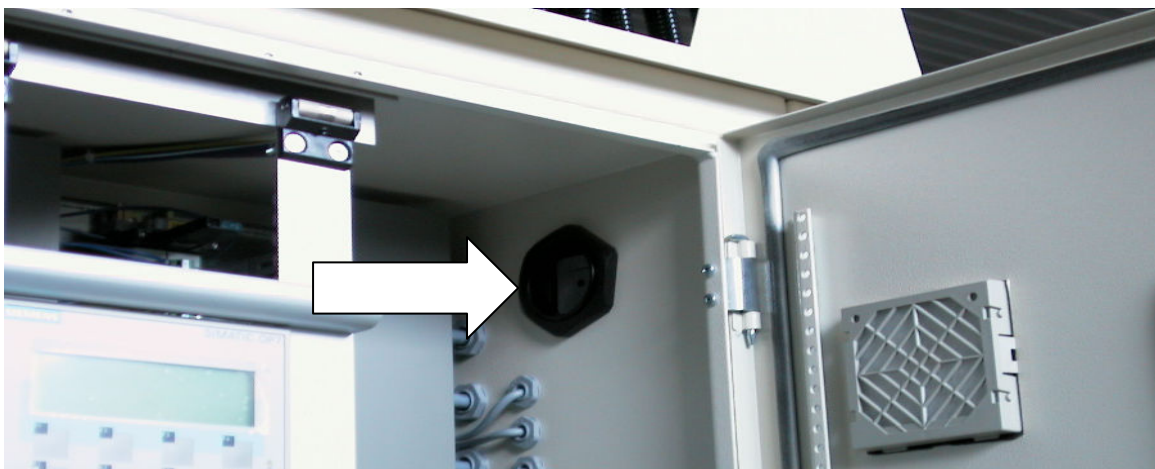

Feed-through

- Run the cable from the chiller to the MR electronic cabinets.
- Connect the lightning arrester with the 164 ft / 50 m data cable.
- Connect the short data cable with the lightning arrester.
- Attach the other end of the short data cable on the electronics cabinet ACC X81 of the MR system.
- Connect the grounding wire.

Installing Instruction


Healthcare chiller of the KSC Series



Version „Revision 05”

Type KSC 215-L-U/S

page 20 von 39

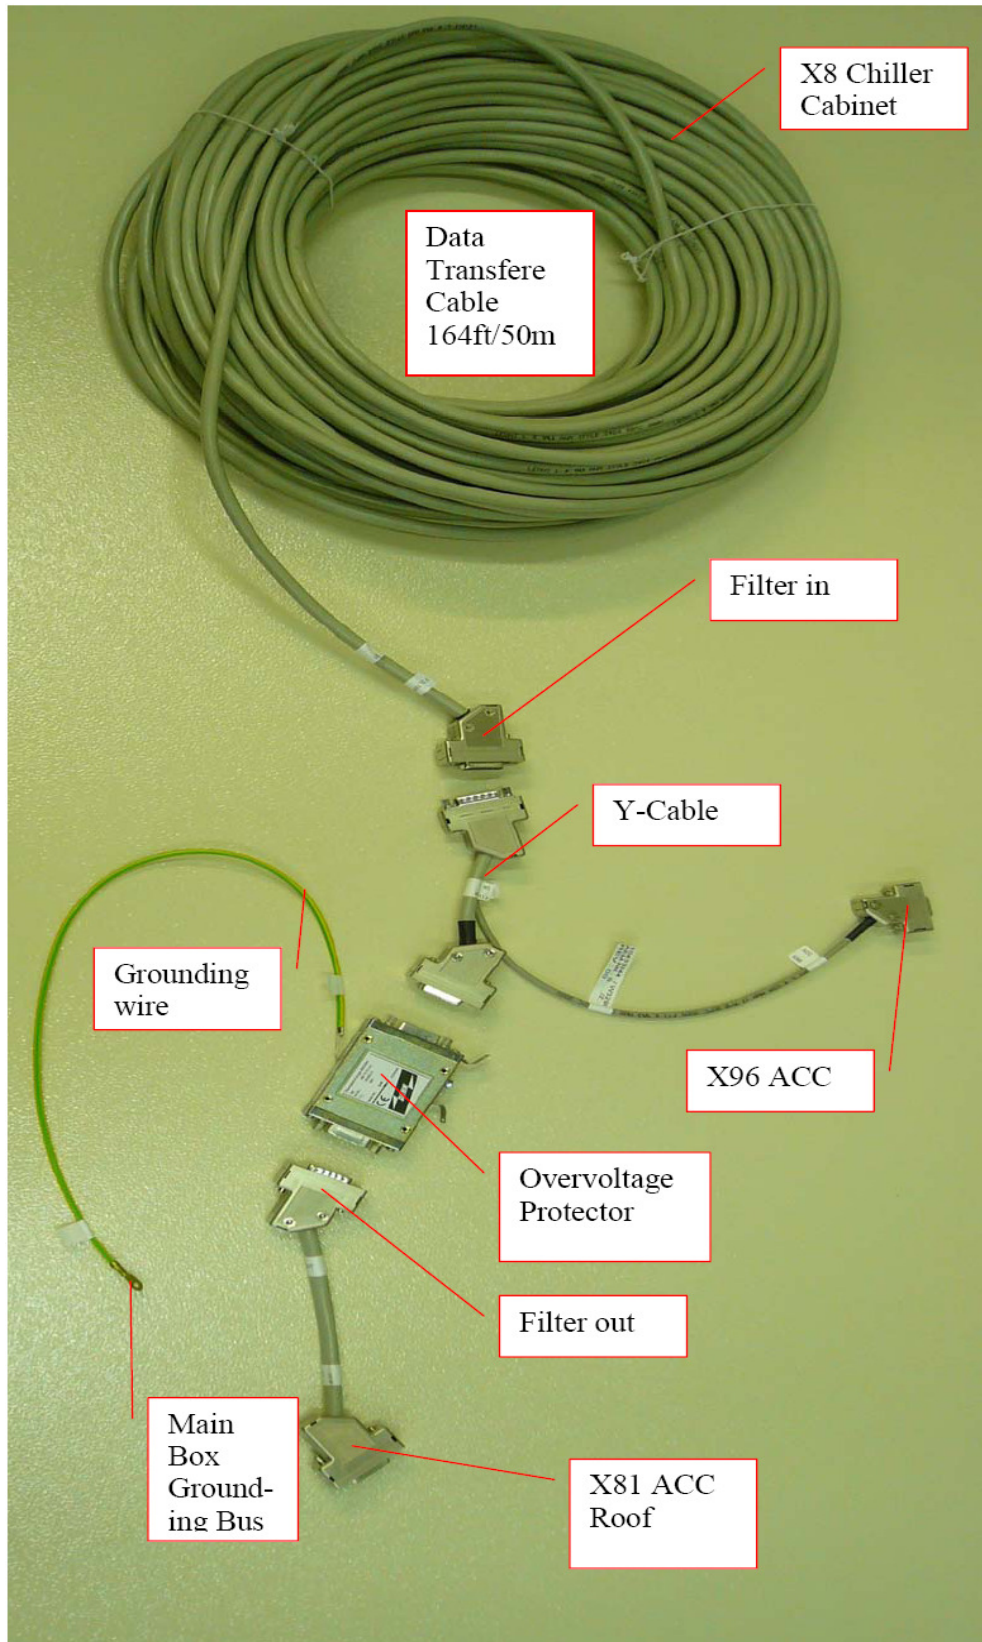


Interface filter panel (IFP)

Scope of IFP supply:

Data transfer cable (164 ft / 50 m)
Lightning arrester
Short data cable
Grounding wire
Power cable (IFP – compressor)
Water hoses (IFP – compressor)
Dummy plugs

Installation of IFP

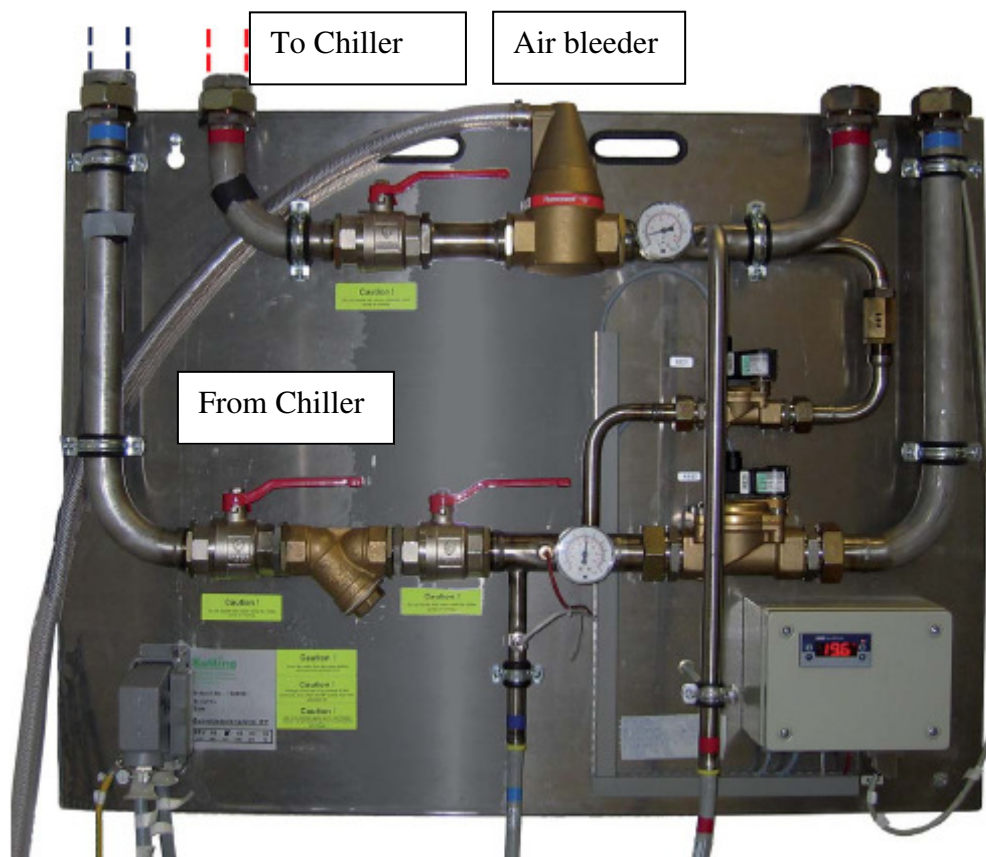

Attach the IFP to the wall. Contact the project manager for the location provided.

The outflow port of IFP to the MR electronic cabinet and the inflow port from the MR electronic cabinet can be closed with dummy plugs.

The dummy plugs allows filling the chiller and the IFP with water/ethylene glycol mixture without MR electronic cabinets connected to IFP.

Water hoses from IFP to the MR electronic cabinets are delivered with the MR system.

VI. Water connection

a) Pipe material

Use only the following materials for the pipes:

1. Copper is recommended
2. Stainless steel
3. PE or PVC – ensure that the appropriate steps are taken to protect the pipe along its length.

The proper way to seal the European fittings can be done with any of following steps.

1. Pipe sealing cord. There are a number of brands available, however we use Loctite 55
2. Teflon Tape and a Anaerobic sealant.
3. Teflon Tape an Nylog sealant.

As with any sealant, the application instruction must be followed for proper use.

b) Relation of pipe diameter to distance between chiller and IFP

Use 2" (R2, DN 50 or 54-mm copper) for up to 25 meters (82 ft.) of straight pipe.

Use 2 ½" (R21/2, DN 65 or 64-mm copper) for up to 45 meters (147.6 ft.) of straight pipe.

For distances exceeding 45 meters (147.6 ft.) of straight pipe, e-mail the actual pipe length, the difference in height, and the required pipe elbows to KKT: info@kkt-chillers.com

)

c) Dimensions of the connections

Both the coolant return (water/ethylene glycol mix) from the IFP and the coolant supply (water/ethylene glycol) to the IFP need to have a 2" internal thread.

To connect them, use a crossover with a 2" external screw thread or preferably a fitting with a 2" external screw thread (two crossovers are attached to the pump).

d) Inflow and outflow

Verify that the inflow and outflow pipes are attached correctly (do not confuse).

The inflow is FROM the IFP.

The outflow is TO the IFP.


The connections are labeled (see photograph).

On the Chiller inflow and outflow use the brass-fittings.

On the IFP use the stainless steel fittings.

e) Water quality

Use only distilled water to fill the system

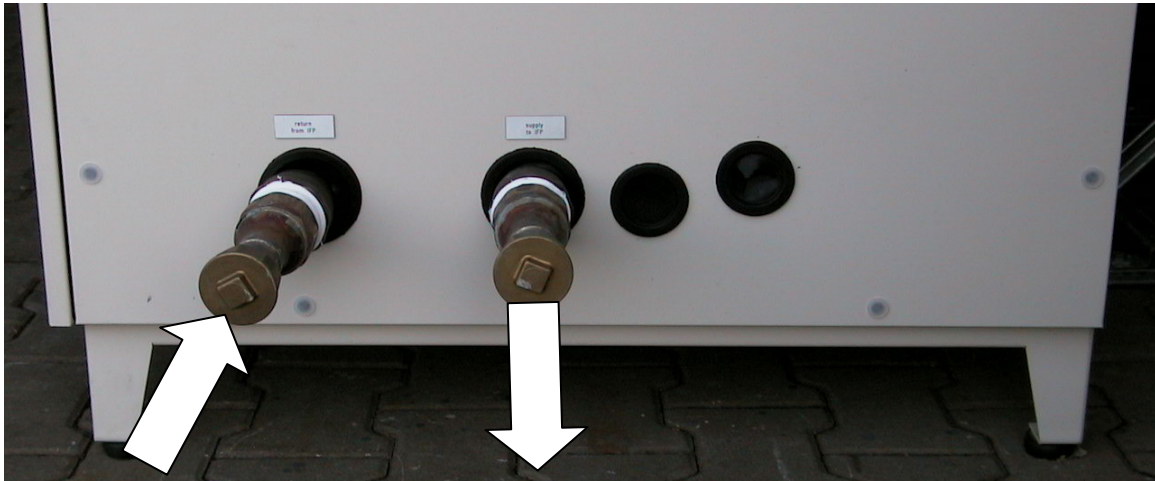

f) Glycol

For transport the chiller is empty. The volume which is to consider for the water ethyleneglycol mixture is approx. 17 liters (~4.5 gal.).
35-38% of the whole volume of watercircuit must be filled with ethylene glycol..
Never use automobile anti-freeze or propylene glycol.

The contractor who fills the water circuit has to supply 30 liters (7.9 gal.) of distilled water-ethylene glycol mixture (35-38% ethylene glycol) for service.

Fill with clean water (distilled water quality) with Ethylene-glycol at the rate of min. 35% to max. 38%.

Use ethylene-glycol of only one manufacturer.

(e.g.: DOWTHERM SR1-Dow Chemical, Safeflow EG-Clariant)

Do not mix two ore more different manufacturer for one water-ethylene-glycol circuit.

Open front panel and fill to a pressure of min.1,5 bar via the feed cock when the pump is off.

After filling, check all connections for leakage.

g) Filling

For filling, use the fill and drain valve near the pump.

It is best to fill the circulation system completely for the air to escape most easily (refer to the following item).

open the valves on the IFP

h) Vents and air chambers

Be sure to avoid air pockets when routing the pipes.

Air chambers or automatic vents must be attached at the highest point to ensure the most simple and reliable venting procedure.

Installing Instruction
Healthcare chiller of the KSC Series



Version „Revision 05“

Type KSC 215-L-U/S

page 24 von 39

Perform and repeat the following steps until all the air has been bled from the system.

This steps have to be done during the first start up and after each replacement of components with water inside also Siemens components.

1. From the lowest point possible, fill the pipe with water/ethylene glycol mixture until no more air escapes from the vent (at the highest point).
Fill the centrifugal pump with the water/ethylene glycol mixture and vent. Close the vent.
2. Continue filling until the pressure on the water circulation manometers display 1.5 bar (21.75 PSI) with the pump **OFF**.
3. Turn on the pump for 15 seconds and turn it off again.
4. Open the vents on the air chambers and the pump and vent off the remaining air.
The pressure on the manometers drops.
5. Fill again until the pressure on the manometers with the pump **OFF** reaches 1.5 bar (21.75 PSI).
6. Repeat starting with step 3 until no more air escapes from the vents and the static pressure with the pump off does not drop below 1.5 bar (21.75 PSI).
7. Clean the filter during the next-to-the-last pass.
8. If the pressure remains constant for 60 – 90 minutes of operation, the coolant circulation system is full and no air remains.

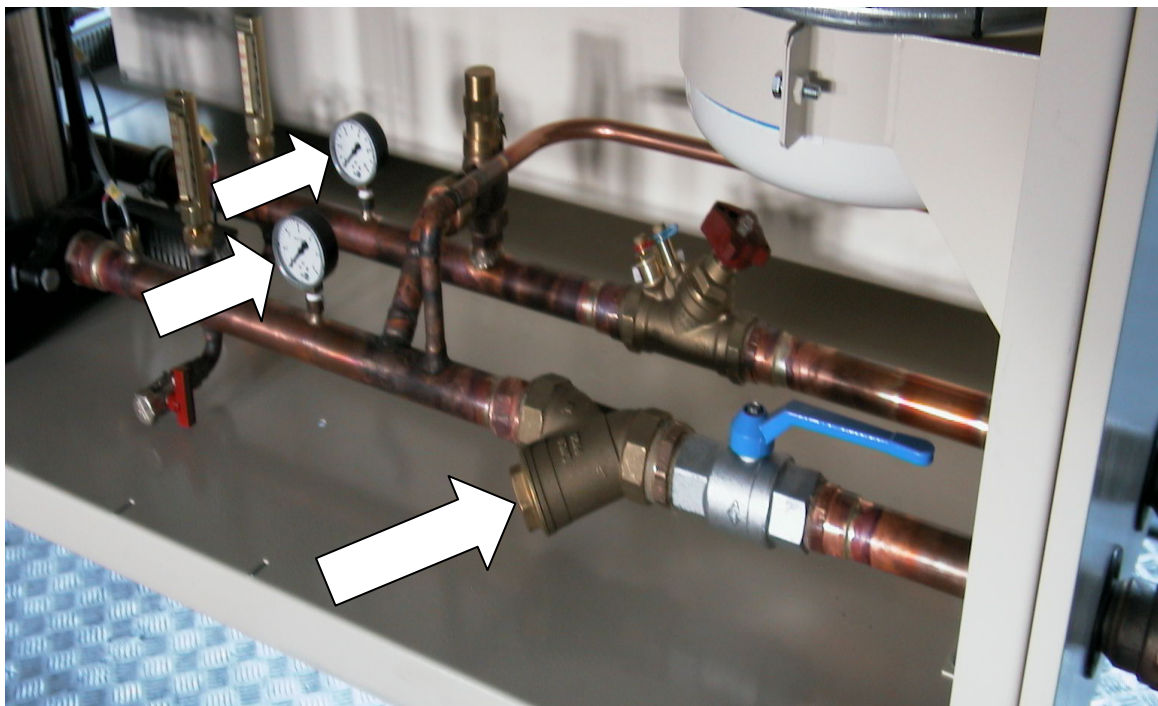


Figure 1

Installing Instruction

Healthcare chiller of the KSC Series



Version „Revision 05“

Type KSC 215-L-U/S


page 26 von 39

System configuration	Fill pressure at Chiller manometer Chiller is off	Warning level setting: SeSo/Magnet & Cooling/ ACS/Water Pressure Return
MR_system & Chiller are at the same level and Pipe routing is higher than the MR_system or Chiller above MR_system	0.1 - 0.5 bar (overpressure) + 0.1 bar / m (difference in level)	Warning level = 0.1 bar (overpressure) + 0.01 bar/ m (flow resistance) + 0.1 bar/m (difference in level)
Example: Chiller or pipe routing is 10m above MR_system Length of piping 20m	0.5 bar (overpressure) + 10m * 0.1 bar/m (difference in level) = 1.5 bar (fill pressure)	Warning level = 0.1 bar + 0.01 bar/m * 20m + 0.1 bar/m * 10m = 1.3 bar
Example: Chiller and MR_system are on the same level. Pipe routing is 5m above the MR_system Pipe length is 20m	0.5 bar (overpressure) + 5m * 0.1 bar/m (difference in level) = 1.0 bar (fill pressure)	Warning level = 0.1 bar + 0.01 bar/m * 20m + 0.1 bar/m * 5m = 0.5 bar
MR_system & Chiller & Pipe routing on same level	0.1 - 0.5 bar (overpressure)	0.4 bar
MR_system is higher than Chiller	0.1 - 0.5 bar (overpressure) + 0.1 bar/m (difference in level)	0.4 bar
Example. Chiller is 5 m below MR System	0.5 bar (overpressure) + 5m * 0.1 bar/m (difference in level) = 1.0 bar (fill pressure)	0.4 bar

Table 1

VII. Initial start-up

1. Turn on main switch 5Q1.

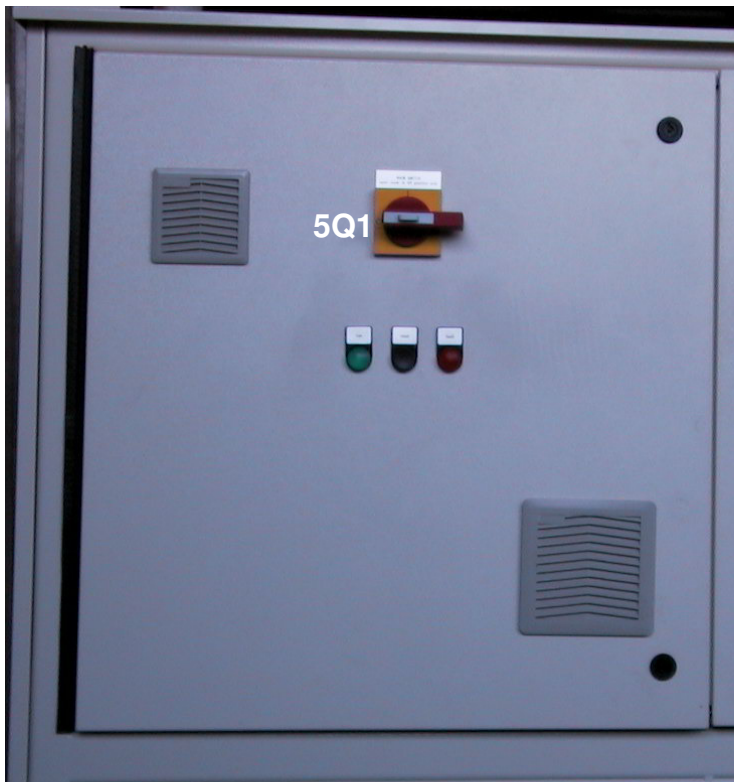

The display needs approx. 15 seconds to activate.

2. The flow meter is bypassed for 15 seconds after the pump starts.

Press reset, if necessary. (**Black button on the control cabinet door and ACK button on the SPS display**).

3. The compressor begins running when the water temperature reaches 18.5 °C after 30 seconds.
4. When the compressor is running the two condenser vents are released. They are reactivated once the pressure in the condenser reaches approx. 13 bar. The stop light on the frequency converter stays lit as long as the vents are off.
5. Vents regulate themselves gradually and independently of the SPS in accordance with the set condenser pressure.

6. Without MR, the IFP is set to Bypass (open magnet valves with no current). In this operating state, there is only approx. 3 m³/h (13.2 gal/min) of coolant in circulation.

VIII. SPS Settings

Setting the clock on the operation panel OP73

Remark: The function of the button F1, F2, F3 and F4 will shown above the buttons at the screen.

The following steps are to be used:

1. Switch on the main switch 5Q1
2. Now the chiller is running in autarc.
3. If the date and time displayed are incorrect, change them using the following steps.
4. If the display shows any failure please press back till the display looks like figure 2



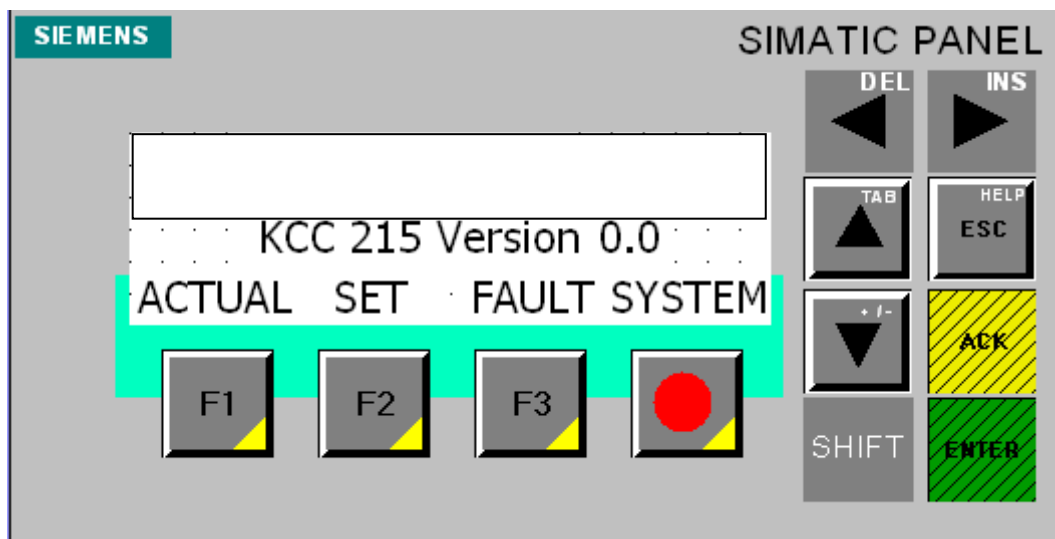


Abbildung 2 figure 2


5. Than press „F4“.

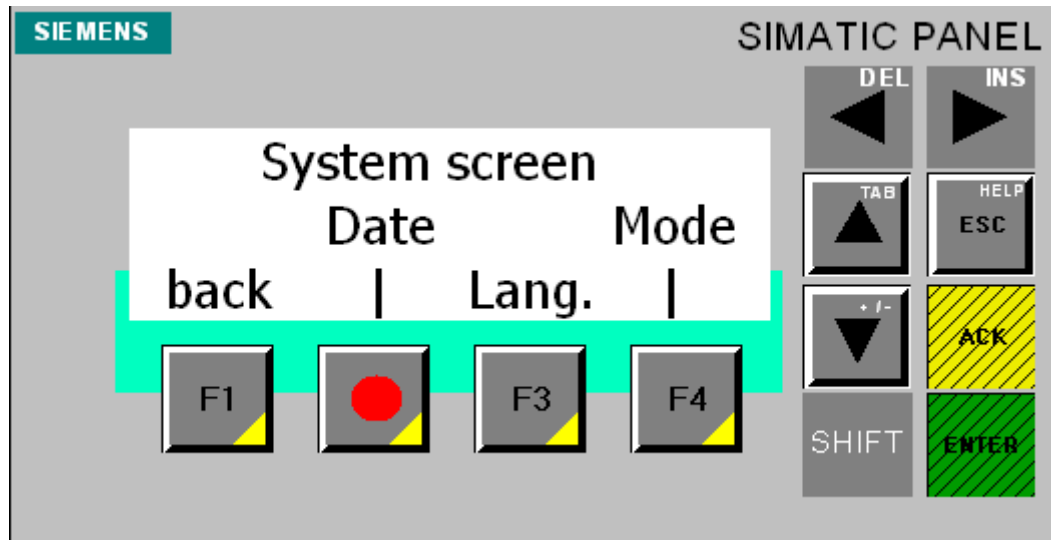

6. Then press „F2“

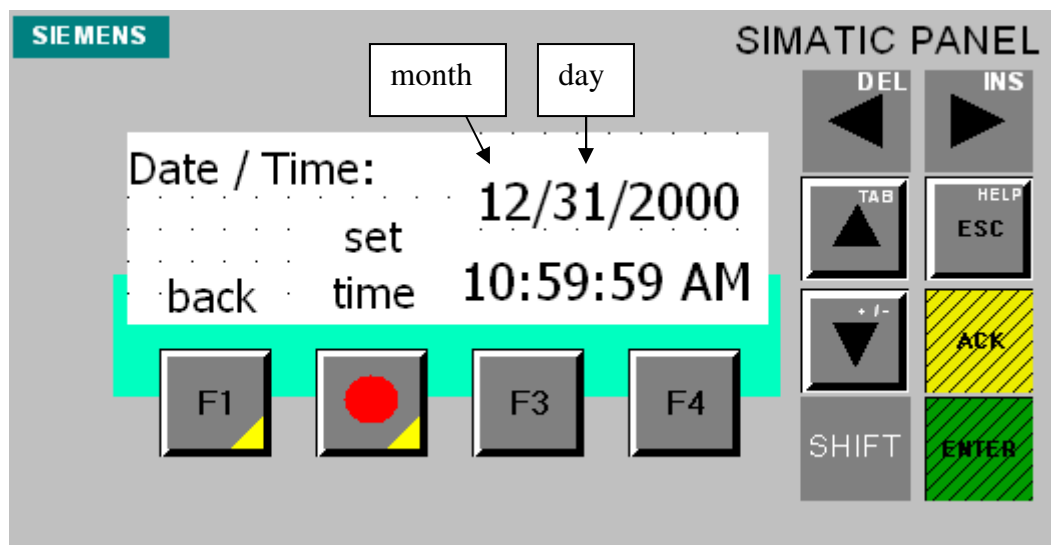

7. Press “Enter” and the “left arrow” and “right arrow” to set the cursor for change the values with the “up arrow”, “down arrow”. Close with “Enter”.
8. Then change the cursor with up arrow to the date.
With left arrow” and “right arrow” change the position of the cursor within the date and with the “up arrow”, “down arrow” change the values. Close with “Enter”
9. Press F2 for setting. The black sign shows that the time will be set in the operation panel.

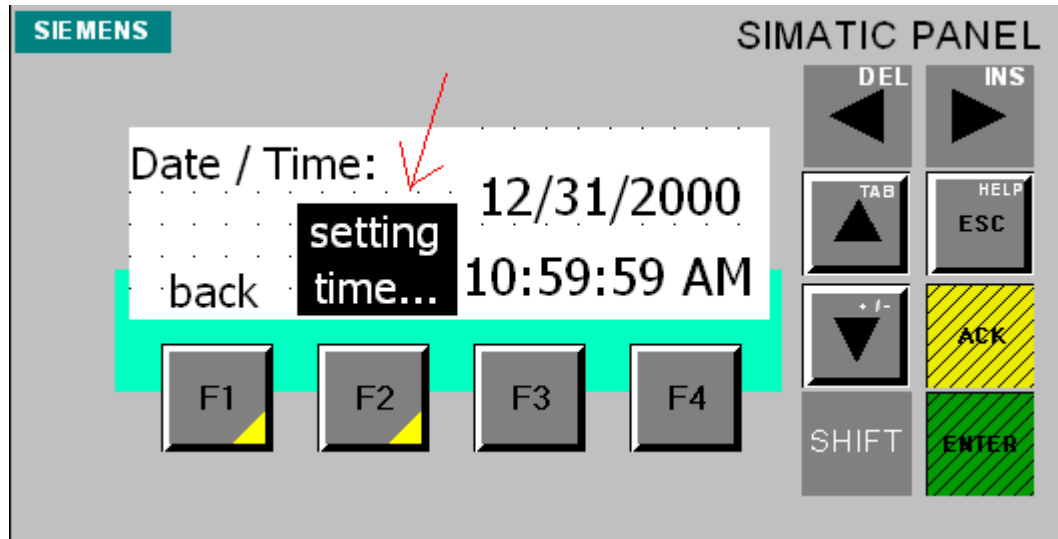

10. With “Back” you go to System

11. With another “Back” you will go to the first picture.

Do not remove the memory chip in the SPS with voltage present.

The pump begins to run approx. 30 seconds after it is switched on. Press reset, if necessary.

IX. Control

a) Pump

Check the direction of rotation of the pump.
Check any noises the pump makes while running.
Check the power consumption.

b) Water pressures

Suction pressure must be between 1.0 bar (14.5 PSI) and 1.5 bar (21.75 PSI).
High pressure must be between 6.5 bar (94.3 PSI) and 7.0 bar (101.5 PSI).

c) Compressor

Check the power consumption.

d) Vents

Check the power consumption.

e) Refrigerant pressures


The low-pressure side must be between 3.0 bar (43.5 PSI) and 5.0 bar (72.5 PSI).
The high-pressure side must be between 8.0 bar (116 PSI) and 15.0 bar (217.5 PSI).

f) Temperatures

Outflow water temperatures should be between 19°C (66.2°F) and 22°C (71.6°F).
Inflow water temperatures should be between ~21°C (69.8°F) and ~27.7°C (81.9°F),
depending on the operating state of the MR system.

X Overview water chiller and IFP

overview of waterchiller transfer station / remote control panel

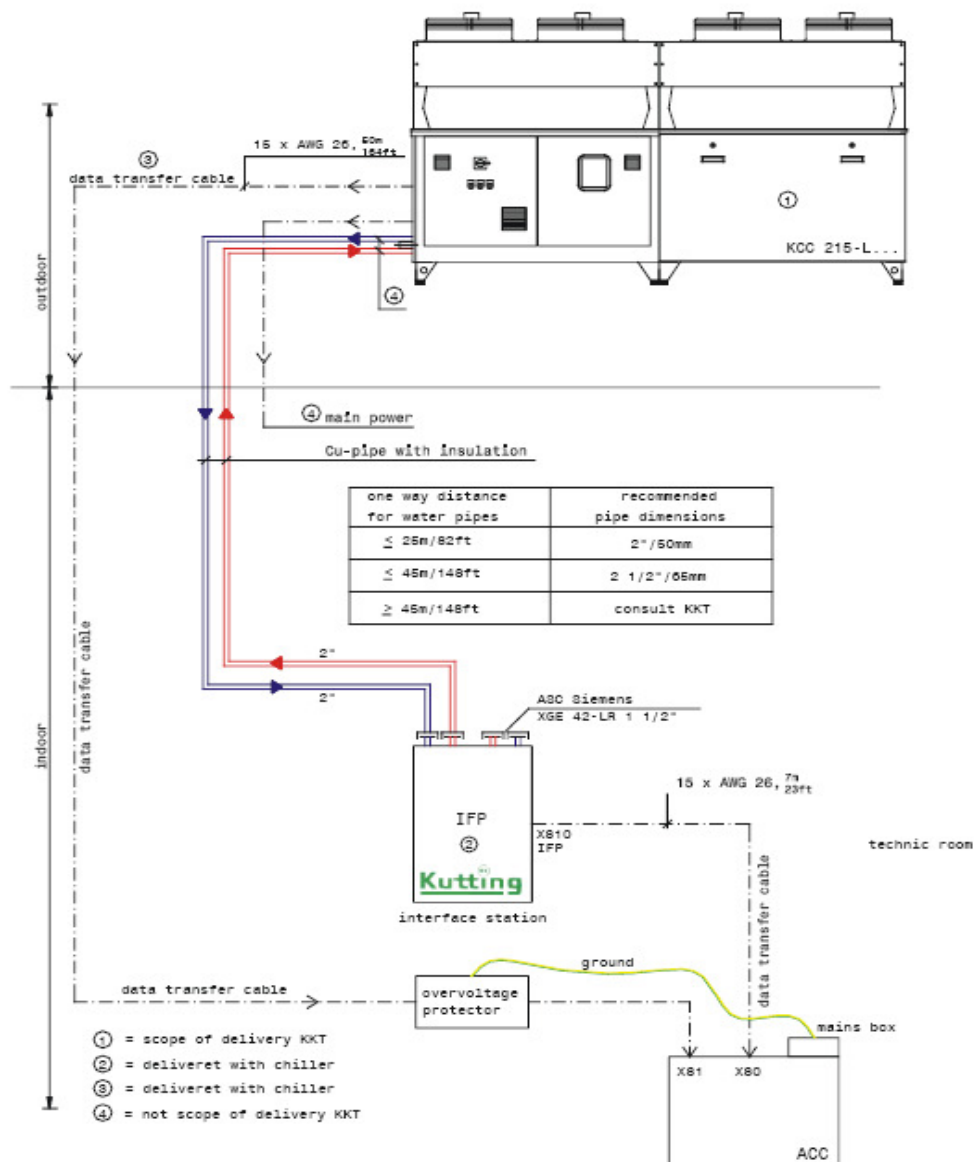

XI Trouble Shooting

KIND OF TROUBLE	CAUSE	ELIMINATION
<ul style="list-style-type: none"> malfunction of plant/system 	<ol style="list-style-type: none"> power failure, phase sequence or phase failure temperature sensor defective simatic 8N1, 8A1, 8A2, 8A3 an 8A4 malfunction chiller “not ok” 	<ul style="list-style-type: none"> check mains connection and relay 5A1 check sensor 9B1 clamp feeler and measure the resistance check MMC-Card check power supply 24VDC 7U1and fuses 7F1 and 7F2 check fuse 24F1 data transfere cable check overvoltage protection
<ul style="list-style-type: none"> malfunction of pump 17M1 	<ol style="list-style-type: none"> main switch 5Q1 not switched on main fuse 5Q1 defective fuse for control current defective pump motor 17M1 defective flow switch responded 10B1 shortage of water 	<ul style="list-style-type: none"> switch on main switch 5Q1 replace fuse 5Q1 replace fuse replace motor 17M1 check water flow check system pressure, clean strainer
<ul style="list-style-type: none"> still malfunction of pump 	<ol style="list-style-type: none"> overload trip 17Q1 of pump protection interrupted control circuit 	<ul style="list-style-type: none"> main switch to '0', push in overload trip
<ul style="list-style-type: none"> pump makes gurgling noise 	<ol style="list-style-type: none"> circuit is not completely vented 	<ul style="list-style-type: none"> vent and fill up with water/Ethylene glycol

Installing Instruction

Healthcare chiller of the KSC Series



Version „Revision 05“

Type KSC 215-L-U/S

page 34 von 39

KIND OF TROUBLE	CAUSE	ELIMINATION
<ul style="list-style-type: none"> • compressor 18M1 and 21M1 stops 	<ol style="list-style-type: none"> 1. Klixon/INT69 tripped 18A1 and 21A1 2. Klixon/INT69 18A1 and 21A1 defective 	<ul style="list-style-type: none"> - Check Fuses 18Q1 and 21Q1 - wait until compressor cooled down; perhaps clean condenser or provide fresh air supply - replace Klixon/INT69
<ul style="list-style-type: none"> • malfunction of refrigerating machine 	<ol style="list-style-type: none"> 1. simatic stopped machine, return temperature too cold 	<ul style="list-style-type: none"> - to check function, level down adjustments, wait until return temperature rised
<ul style="list-style-type: none"> • still malfunction of refrigerating machine 	<ol style="list-style-type: none"> 1. low pressure in refrigerant circuit <ul style="list-style-type: none"> - plant loses refrigerant - dryer in liquid pipe dirty - pressure relief valve defective 2. high pressure in refrigerant circuit <ul style="list-style-type: none"> - condenser dirty - fan defective - outside temperature too high - pressure sensor 20B1 and 23B1 for condenser control defective - Frequency inverter defective 	<ul style="list-style-type: none"> - find leak, seal, refill circuit - replace dryer - replace pressure relief valve - clean condenser - put right electric cause; check fuses 20Q1 and 23Q1 - spray condenser with water - replace pressostat - replace frequency inverter 20U1 and 23U1
<ul style="list-style-type: none"> • refrigerating machine starts and stops short-termed 	<ol style="list-style-type: none"> 1. not enough fresh air supply for condenser; high pressure pressostat tries to protect refrigerating machine against overload 2. not enough pressure of refrigerant circuit; refrigerant partly escaped; diminished pressure switch shut down compressor 	<ul style="list-style-type: none"> - provide enough fresh air supply and fresh air removal; get rid of short-circuit across fresh air and exhaust air - find leak, seal, refill circuit

Installing Instruction
Healthcare chiller of the KSC Series



Version „Revision 05“

Type KSC 215-L-U/S

page 35 von 39

KIND OF TROUBLE	CAUSE	ELIMINATION
<ul style="list-style-type: none"> • not enough refrigeration power 	<ol style="list-style-type: none"> 1. air in water circuit 2. fallen below minimum water agitation quantity 3. not enough fresh air supply for condenser 4. not enough refrigerant in circuit 	<ul style="list-style-type: none"> - vent system - design cross-section of water pipe right; perhaps open check valve in water circuit completely, increase pipe cross-section - provide enough fresh air supply and fresh air removal; get rid of short-circuit across fresh air and exhaust air - find leak, seal, refill circuit

Installing Instruction

Healthcare chiller of the KSC Series



Version „Revision 05”

Type KSC 215-L-U/S

page 36 von 39

Problem	Possible cause	Remedy
The pump does not run	1. No power at motor.	Check for voltage at motor terminal box. If no voltage at motor, check feeder panel for tripped circuits and reset circuit.
	2. Fuses are blown or circuit breakers are tripped.	Turn off power and remove fuses. Check for continuity with ohmmeter. Replace blown fuses or reset circuit breaker. If new fuses blow or circuit breaker trips, the electrical installation, motor and wires must be checked.
	3. Motor starter overloads are burned or have tripped out.	Check for voltage on line and load side of starter. Replace burned heaters or reset. Inspect starter for other damage. If heater trips again, check the supply voltage and starter holding coil.
	4. Starter does not energize.	Energize control circuit and check for voltage at the holding coil. If no voltage, check control circuit fuses. If voltage, check holding coil for shorts. Replace bad coil.
	5. Defective controls.	Check all safety and pressure switches for operation. Inspect contacts in control devices. Replace worn or defective parts or controls.
	6. Motor is defective.	Turn off power and disconnect wiring. Measure the lead to lead resistances with ohmmeter (RX-1). Measure lead to ground values with ohmmeter (RX-100K). Record measured values. If an open or grounded winding is found, remove motor and repair or replace.
	7. Defective capacitor. (Single-phase motors)	Turn off power and discharge capacitor. Check with ohmmeter (RX-100K). When the meter is connected to the capacitor, the needle should jump towards 0 ohms and slowly drift back to infinity (∞). Replace if defective.
	8. Pump is bound.	Turn off power and manually rotate pump shaft. If shaft does not rotate easily, check coupling setting and adjust as necessary. If shaft rotation is still tight, remove pump and inspect. Disassemble and repair.
The pump runs but at reduced capacity or does not deliver water	1. Wrong rotation	Check wiring for proper connections. Correct wiring.
	2. Pump is not primed or is airbound.	Turn pump off, close isolation valve(s), remove priming plug. Check fluid level. Refill the pump, replace plug and start the pump. Long suction lines must be filled before starting the pump.
	3. Strainers, check or foot valves are clogged.	Remove strainer, screen or valve and inspect. Clean and replace. Reprime pump.
	4. Suction lift too large.	Install compound pressure gauge at the suction side of the pump. Start pump and compare reading to performance data. Reduce suction lift by lowering pump, increase suction line size or removing high friction loss devices.
	5. Suction and/or discharge piping leaks.	Pump runs backwards when turned off. Air in suction pipe. Suction pipe, valves and fittings must be airtight. Repair any leaks and retighten all loose fittings.
	6. Pump worn.	Install pressure gauge, start pump, gradually close the discharge valve and read pressure at shutoff. Convert measured pressure (in PSI) to head (in feet): (Measured PSI x 2.31 ft./PSI = _____ ft.). Refer to the specific pump curve for shutoff head for that pump model. If head is close to curve, pump is probably OK. If not, remove pump and inspect.
	7. Pump impeller or guide vane is clogged.	Disassemble and inspect pump passageways. Remove any foreign materials found.

Installing Instruction

Healthcare chiller of the KSC Series



Version „Revision 05”

Type KSC 215-L-U/S

page 37 von 39

Problem	Possible cause	Remedy
<p>The pump runs but at reduced capacity or does not deliver water (continued)</p>	<ul style="list-style-type: none"> 8. Incorrect drain plug installed. 9. Improper coupling setting. 	<p>If the proper drain plug is replaced with a standard plug, water will recirculate internally. Replace with proper plug.</p> <p>Check/reset the coupling, see page 10.</p>
<p>Pump cycles too much</p>	<ul style="list-style-type: none"> 1. Pressure switch is not properly adjusted or is defective. 2. Level control is not properly set or is defective. 3. Insufficient air charging or leaking tank or piping. 4. Tank is too small. 5. Pump is oversized. 	<p>Check pressure setting on switch and operation. Check voltage across closed contacts. Readjust switch or replace if defective.</p> <p>Check setting and operation. Readjust setting (refer to level control manufacturer's data). Replace if defective.</p> <p>Pump air into tank or diaphragm chamber. Check diaphragm for leak. Check tank and piping for leaks with soap and water solution. Check air to water volume. Repair as necessary.</p> <p>Check tank size and air volume in tank. Tank volume should be approximately 10 gallons for each gpm of pump capacity. The normal air volume is 2/3 of the total tank volume at the pump cut-in pressure. Replace tank with one of correct size.</p> <p>Install pressure gauges on or near pump suction and discharge ports. Start and run pump under normal conditions, record gauge readings. Convert PSI to feet (Measured PSI x 2.31 ft./PSI = _____ ft.) Refer to the specific pump curve for that model, ensure that total head is sufficient to limit pump delivery within its design flow range. Throttle pump discharge flow if necessary.</p>
<p>Fuses blow or circuit breakers or overload relays trip</p>	<ul style="list-style-type: none"> 1. Low voltage. 2. Motor overloads are set too low. 3. Three-phase current is imbalanced. 4. Motor is shorted or grounded. 5. Wiring or connections are faulty. 6. Pump is bound. 7. Defective capacitor (single-phase motors). 8. Motor overloads at higher ambient temperature than motor. 	<p>Check voltage at starter panel and motor. If voltage varies more than ±10%, contact power company. Check wire sizing.</p> <p>Cycle pump and measure amperage. Increase heater size or adjust trip setting to a maximum of motor nameplate (full load) current.</p> <p>Check current draw on each lead to the motor. Must be within ±5%. If not, check motor and wiring. Rotating all leads may eliminate this problem.</p> <p>Turn off power and disconnect wiring. Measure the lead-to-lead resistance with an ohmmeter (RX-1). Measure lead-to-ground values with an ohmmeter (RX-100K) or a megaohm meter. Record values. If an open or grounded winding is found, remove the motor, repair and/or replace.</p> <p>Check proper wiring and loose terminals. Tighten loose terminals. Replace damaged wire.</p> <p>Turn off power and manually rotate pump shaft. If shaft does not rotate easily, check coupling setting and adjust as necessary. If shaft rotation is still tight, remove pump and inspect. Disassemble and repair.</p> <p>Turn off power and discharge capacitor. Check with ohmmeter (RX-100K). When the meter is connected to the capacitor, the needle should jump towards 0 ohms and slowly drift back to infinity (∞). Replace if defective.</p> <p>Use a thermometer to check the ambient temperature near the overloads and motor. Record these values. If ambient temperature at motor is lower than at overloads, especially where temperature at overloads is above +104°F (+40°C), ambient-compensated heaters should replace standard heaters.</p>

XII. Maintenance

The cooling block must be serviced at least twice a year by a Chiller company. (e.g., KKT chillers or SBT)

XIII. Warranty

The unit is supplied finished, tested and ready to work. The unit warranty will be void if any modification to the unit is carried out without written agreement of KKT chillers. For warranty purposes, the following conditions must be satisfied:

- The initial start of the unit must be carried out by trained personnel from an Authorized KKT chillers Service Partner.
- Maintenance must be carried out by properly trained personnel.
- Only genuine KKT chillers spare parts must be used.
- For KSC215-L-U/S: Ethylene glycol must be added to the rate of 35-38Vol%.
- The manual (this document) must not remove from the chiller.
- All the scheduled maintenance operations detailed in this manual must be performed at the specified times. Please use a higher amount of services if the local conditions require it.

Failure to satisfy any of these conditions will automatically void the warranty.

XIV. Safety Warnings

-Cooling water circuit is pressurized.

Switch off the chiller and depressurize before servicing the cooling water circuit.

-Drain water from pipes and spare parts before shipment.

-Nominal static filling pressure when Chiller has been switched off: 1,5bar. The pressure of the expansion tank is without counter pressure from the “water / glycol – side” = 1,0 bar.

-Don` t handle valves while the Chiller is running

-**Ethylene glycol must** be added at the rate of 35-38% of the volume of water anytime otherwise warranty void.

-The rate depends not on the local ambient temperature.

-Don` t use automotive antifreeze.

-Voltage continuous to be present at the terminals, even after the medical device has been switched off.

-Parts in the refrigerant circuit are hot, even the Chiller has been switched off.

Installing Instruction
Healthcare chiller of the KSC Series



Version „Revision 05“

Type KSC 215-L-U/S

page 39 von 39

Warranty void if manual removed from chiller.

OBSERVE THE SAFETY RULES

Before commencing work on the unit, switch the plant to voltage-free

IN CASES OF EMERGENCY TURN OFF THE AGGREGATE BY THE MASTER SWITCH !

Caution!

Work on electric and refrigerant circuits should only be performed by qualified operatives
Observe the safety rules!