

Compact-Line Healthcare






GB

Operating instructions



cBoxX 40
cBoxX 60
cBoxX 70
cBoxX 80
cBoxX 100
cBoxX 120
cBoxX 160
cBoxX 180

Table 1: Contact details

Manufacturer	<p>ait-deutschland GmbH Industriestraße 3 95359 Kasendorf Germany T +49 9228 9977 0 F +49 9228 9977 149 E info@kkt-chillers.com W www.kkt-chillers.com</p>
Service	<p>ait-deutschland GmbH Industriestraße 3 95359 Kasendorf Germany T +49 9228 9977 7190 * F +49 9228 9977 7474 E service@kkt-chillers.com W www.kkt-chillers.com</p> 
Service USA	<p>KKT chillers, Inc. 765 Dillon Drive Wood Dale IL 60191 TF +1 833 558 4357 * F +1 847 734 1601 E techsupport@kkt-chillersusa.com</p> 
Service East Asia	<p>KKT chillers East Asia Sales and Service Office 5-1-D, No. 333 Xingpu Road Modern Industrial Park Suzhou 215021, Jiangsu Province, P.R.C. S +86 512 6790 3091* F +86 512 6287 1077 E service@kkt-chillerscn.com</p> 

The operating instructions in digital form can be requested under (E info@kkt-chillers.com)

Introduction

These operating instructions have been drawn up by KKT chillers. They contain all important information and instructions for the installation and safe operation of the chiller. It also contains suggestions on how to prevent or correct faults.

Please take enough time to carefully read this instruction manual and to process all the information that it contains. For further questions, please contact the KKT chillers Service Team by means of the aforementioned contact details.

If properly used for its intended use and correctly maintained, the chiller ensures sustained, fault-free operation. The methods and procedures described in this manual were designed to help you identify problems at an early state and to initiate corresponding countermeasures.

By observing the described maintenance program, you ensure that the reliability and safety of the machine is maintained. Plus this keeps operating costs low and increases the service life of the components.

To ensure that the performance of your chiller is not impaired, we recommend that you only use original spare parts from KKT chillers. By doing so, you ensure the reliability and quality of the machine.



ATTENTION! A black exclamation mark on a yellow background in a triangle indicates important information and instructions to which you must pay particular attention and must always follow.

KKT chillers reserves the right to change technical data without prior announcement. Illustrations in this document are not set to scale!

As the devices of the Compact-Line can be adapted project specifically, this document contains only information that is of general relevance for all devices of the series.

The separate documentation "Installation guidelines" is part of this operating manual. The information it contains must be observed and specifications must be complied with.

All project-specific data is enclosed with the unit in separate summary documentation.

- Machine configuration
- Parameter list
- P&I diagram
- Pump characteristic curve(s)
- Circuit diagram
- All other project-specific details

Contents

Introduction.....	3
1. Product description	8
1.1. Intended use	8
1.2. Technical data	9
1.2.1. Technical data closed loop	9
1.2.2. Technical data open loop	16
1.3. Elements.....	21
1.4. Explanation of terms.....	22
2. Function and main components.....	22
2.1. Compressor	23
2.2. Evaporator	23
2.3. Condenser	23
2.4. Expansion valve	23
2.5. Refrigerant.....	23
2.6. Oil	23
2.7. Filter dryer	24
2.8. Pressure sensors	24
2.9. Temperature sensors.....	24
2.10. Control unit / main circuit board.....	24
2.11. Display	24
2.12. Control cabinet.....	24
2.13. Pump.....	25
2.14. Fan	25
2.15. Closed loop cold water circuit	25
2.16. Open loop cold water circuit.....	25
2.16.1. Filling a open loop cold water circuit	26
2.16.2. Level package (accessories)	27
2.17. Materials used in the water circuit	27
2.18. Water quality	28
2.19. Permitted coolant media	29
2.19.1. Permitted cooling media.....	29
3. Options and accessories	29
3.1. Heater for the compressor and control cabinet.....	30
3.2. Insulating cold pipes.....	30
3.3. Pump redundancy.....	30
3.4. Phase monitoring.....	30
3.5. Hot gas bypass for output control <1K.....	30
3.6. Low-temperature package (ambient temperature < -25 ° C).....	30
3.7. Levelling feet (accessories).....	30
3.8. Filter assembly group coolant circuit (accessories).....	31
3.9. Anybus-Gateway (accessories).....	31
3.10. Remote control panel (accessories)	31
3.11. Special languages (accessories).....	32

3.12.	Seaworthy crate packaging (accessories)	32
3.13.	Earthquake kit (accessories).....	32
3.14.	CIP Chiller interface panel (accessories).....	33
4.	Safety.....	33
4.1.	General information.....	33
4.2.	Hazard warnings	33
4.3.	Residual energy.....	36
4.4.	Safety devices, guards and safeguards	37
4.4.1.	High-pressure limiter.....	37
4.4.1.	High-pressure monitoring via sensor	37
4.4.2.	Low-pressure monitoring.....	37
4.4.3.	Flow monitoring.....	38
4.4.4.	Personal protective equipment when operating the machine	38
4.5.	Personal protective equipment for servicing work	38
4.5.1.	Electronic level monitoring	38
4.5.2.	Switching the chiller On/off	39
4.5.3.	Cold water flow temperature control	40
4.5.4.	Compressor control.....	40
4.5.5.	Fan speed control	41
4.5.6.	Electronic expansion valve control.....	41
4.5.7.	Temperature limit monitoring.....	41
4.5.8.	Group fault alarm	41
4.6.	Execution types	41
4.6.1.	ECO mode	41
4.6.2.	Comfort mode.....	41
4.7.	Airborne sound emissions.....	42
4.8.	Notes on reducing noise and vibration.....	42
4.8.1.	Noise	42
4.8.2.	Vibration.....	43
4.9.	Residual risks.....	43
4.9.1.	Electrical	43
4.9.2.	Mechanical	43
4.9.3.	Chemical	43
4.9.4.	Other	43
4.10.	Dangerous substances.....	44
4.10.1.	Refrigerant R410A	44
4.10.2.	Öl POE 160SZ.....	45
4.11.	Reasonably foreseeable misuse	46
4.12.	Information for emergencies.....	46
5.	Handling and storage	46
5.1.	Dangerous goods	46
5.2.	Transport	47
5.2.1.	Forklift truck	47
5.3.	Unpacking.....	48
5.4.	Storage	49

6.	Installation	49
6.1.	Overview	49
6.2.	Installation site.....	49
6.2.1.	General information	49
6.2.2.	Minimum room volume.....	50
6.2.3.	Ambient temperature.....	50
6.2.4.	Effect of surrounding air flow	50
6.2.5.	Minimum clearances	50
6.2.6.	Surface and foundation	51
6.2.7.	Stability	51
6.2.8.	Levelling.....	51
6.2.9.	Vibration isolation	51
6.2.10.	Installation	51
6.2.11.	Hydraulic installation	52
6.2.12.	Flushing the cold water circuit	52
6.2.13.	Filling.....	52
6.2.14.	Venting.....	53
6.2.15.	Electrical installation.....	53
7.	Commissioning	54
7.1.	Installation checklist.....	55
8.	Operation.....	55
8.1.	Switching on	55
8.2.	Selecting the operating mode	55
8.3.	External release	56
8.4.	Control	56
8.5.	Control panel.....	56
8.5.1.	Start screen	57
8.5.2.	Main menu.....	58
8.5.3.	Information	58
8.5.4.	Settings	58
8.5.5.	Alarm menu	59
8.5.6.	Control panel	59
8.5.7.	Software update.....	59
8.5.8.	Datalog export	59
8.5.9.	Datalog stop	59
8.6.	Parameters.....	59
8.7.	Controller description	60
8.7.1.	Thermostatic pump start	60
8.7.2.	Electronic level monitoring	60
8.7.3.	Switching the chiller On/off	60
8.7.4.	Cold water flow temperature control	61
8.7.5.	Compressor control.....	62
8.7.6.	Fan speed control	62
8.7.7.	Electronic expansion valve control.....	62
8.7.8.	Temperature limit monitoring.....	62

8.7.9.	Group fault alarm	63
8.8.	Execution types	63
8.8.1.	ECO mode	63
8.8.2.	Comfort mode.....	63
9.	Cleaning	63
9.1.	Air filter mat.....	63
9.2.	Condenser	63
9.3.	Water filter.....	63
9.4.	Complete cleaning of the cold water circuit.....	63
10.	Service.....	64
10.1.	Maintenance	64
10.2.	Fault correction	64
10.3.	Spare parts.....	64
11.	Taking out of service	65
11.1.	Draining	65
12.	Recycling.....	66
13.	Products, solutions and services.....	66
I.	Menu navigation	67
II.	Troubleshooting.....	86
III.	Maintenance intervals in accordance with the VDMA.....	98
IV.	Product registration	100

1. Product description

Please read all the points in these operating instructions before starting up the machine. You should pay particular attention to the points on safety, commissioning/startup and operation. Should you have any further questions concerning your machine, please contact the KKT chillers Service Team (**see *Contact details***).

1.1. Intended use




The cBoxX is a factory-tested, fully automatic compressor chiller. The machine is only used for cooling liquids in accordance with EN 378-1. A sufficient supply of cooling air must be provided. Only approved liquids may be used. The cBoxX corresponds to protection class IP 54 (when the housing is closed) and is suitable for both indoor and outdoor installation (observe option packages).

The operator is responsible for complying with the specified operating, servicing and maintenance conditions according to these operating instructions.

The owner of the chiller, not the manufacturer, is responsible and liable for all personal injuries and damage to property caused by improper use of the unit (misuse).

Table 2 contains the general safety instructions of the chiller. These instructions are attached to the machine in a clear and readily visible position. A complete description of all hazard warnings is given in Chapter **4.2 Hazard warnings**.

Table 2: Safety instructions

	Note and follow the instructions for use!
	Before opening the machine, disconnect the machine from the power supply. After disconnecting the machine from the power supply, always wait for at least 5 minutes before opening it.
	Beware of dangerous electrical voltage! If the machine is only turned off by means of the main switch, some of the terminals in the control cabinet will still be under dangerous voltage.

1.2. Technical data

1.2.1. Technical data closed loop

Table 3: Technical data

Chillertyp	cBoxX 40		cBoxX 40	cBoxX 40
SAP-Nummer	90904000743 90904001009		90904000744 90904001010	90904000819 90904001078
Refrigerating capacity* @ tw2=13°C / tu=50°C / 4,0 m3/h	27 kW		23 kW	23 kW
Refrigerating capacity* @ tw2=11°C / tu=45°C / 4,1 m3/h	27 kW		24 kW	24 kW
Refrigerating capacity* @ tw2=18°C / tu=45°C / 2,4 m3/h	34 kW		32 kW	32 kW
Ambient temperature range	-25 - +50°C		-25 - +50°C	-25 - +50°C
Hermetically sealed refrigeration circuit	no		no	no
Refrigerant	R410A		R410A	R410A
GWP	2.088		2088	2088
Refrigerant capacity	6		6	6
CO2 equivalent	12,5 t CO2		12,5 t CO2	12,5 t CO2
Cooling medium	Water with 35Vol% AFN	Water with 50Vol% AFN	Water with 35Vol% AFN	Water with 35Vol% AFN
Supply temperature setpoint	11°C		13°C	13°C
Supply temperature range	+7°C...+15°C		+8°C...+15°C	+8°C...+15°C
Target constancy at full load	+/- 1°K		+/-2 K	+/-2 K
Flow rate 1 at free pump pressure (min)	4.1 m³/h at 3.0bar		4,0 m³/h at 2,8bar	4,0 m³/h at 5bar
Flow rate 2 at free pump pressure (min)	2.4 m³/h at 5.5bar		-	-
Operating voltage (+/-10%)	460V/3/60Hz	460V/3/60Hz	400V/3/50Hz	400V/3/50Hz
Protection class Electrical cabinet	IP54		IP54	IP54
Air flow rate (max.)	20.000 m³/h		12.600 m³/h	12.600 m³/h
Sound pressure level at 5 m distance	69 dB(A)		55 dB(A)	55 dB(A)
Height Chiller	2.030 mm		2030 mm	2030 mm
Width Chiller	830 mm		830 mm	830 mm
Length Chiller	1.240 mm		1240 mm	1240 mm
Socket dimensions (Weight / Length)	796 mm / 1.186 mm		796 mm / 1186 mm	796 mm / 1186 mm
Net weight without cooling medium	475 kg	480 kg	475 kg	475 kg
Pumps Quantity	2	2	2	2
Certificates	ETL/CSA	ETL/CSA	CE	CE

* depending on application, see KKT installation guideline

Chillertyp	cBoxX 60	cBoxX 60	cBoxX 60	cBoxX 60	cBoxX 60	cBoxX 60	cBoxX 60	cBoxX 60
SAP-Nummer	90906000238	90906000239	90906000241	90906000242	90906000243 90906001011	90906000244 90906001012	90906000377	909060-00424
Refrigerating capacity * @ tw2=13 °C / tu=45 °C	41kW	41kW	41kW	41kW	41kW	41kW	41kW	41kW
Ambient temperature range	-25 - +50 °C	-25 - +50 °C	-25 - +50 °C	-25 - +50 °C	-25 - +50 °C	-25 - +50 °C	-25 - +50 °C	-25 - +50 °C
Hermetically sealed refrigeration circuit	no							
Refrigerant	R410A							
GWP	2.088							
Refrigerant capacity	7kg							
CO2 equivalent	14,6 t CO2							
Cooling medium	Water with 35Vol% AFN	Water with 35Vol% AFN	Water with 35Vol% AFN	Water with 35Vol% AFN	Water with 35Vol% AFN	Water with 50Vol% AFN	Water with 35Vol% AFN	Water with 35Vol% AFN
Supply temperature setpoint	13 °C							
Additional envelope: Supply temperature range at tu=45 °C	+8 °C...+15 °C							
Target constancy	+/-2 K							
Coolant circulation	5,0 m³/h							
Free pump pressure (min)	2,8bar	2,8bar	2,8bar	2,8bar	5bar	5bar	2,8bar	5bar
Operating voltage (+/-10%)	400V/3/50Hz	400V/3/50Hz	400V/3/60Hz	460V/3/60Hz	460V/3/60Hz	460V/3/60Hz	400V/3/60Hz	460V/3/60Hz
Protection class Electrical cabinet	IP54							
Air flow rate (max.)	20.000 m³/h							
Sound pressure level at 5 m distance	69 dB(A)							
Height Chiller	2.030 mm							
Width Chiller	830 mm							
Length Chiller	1.240 mm							
Socket dimensions (Weight / Length)	796 mm / 1.186 mm							
Net weight without cooling medium	515 kg	540 kg	515 kg	540 kg	540 kg	540 kg	540 kg	584 kg
Pumps Quantity	1	2	1	2	2	2	2	2
Certificates	CE	CE	CE	CE	CE/ETL/CSA	CE/ ETL /CSA	CE	CE/ ETL /CSA/ seismic

* depending on application, see KKT installation guideline

Chillertyp	cBoxX 70	cBoxX 70	cBoxX 70	cBoxX 70	cBoxX 70	cBoxX 70	cBoxX 70
SAP-Nummer	90907000245	90907000246	90907000247	90907000248	90907000249 90907001014	90907000255	909070-00425
Refrigerating capacity * @ tw2=13°C / tu=45°C	45kW	45kW	45kW	45kW	45kW	45kW	45kW
Ambient temperature range	-25 - +55°C	-25 - +55°C	-25 - +55°C	-25 - +55°C	-25 - +55°C	-25 - +55°C	-25 - +55°C
Hermetically sealed refrigeration circuit	no						
Refrigerant	R410A						
GWP	2.088						
Refrigerant capacity	8kg						
CO2 equivalent	16,7 t CO2						
Cooling medium	Water with 35Vol% AFN	Water with 35Vol% AFN	Water with 35Vol% AFN	Water with 35Vol% AFN	Water with 35Vol% AFN	Water with 35Vol% AFN	Water with 35Vol% AFN
Supply temperature setpoint	9°C						
Additional envelope: Supply temperature range at tu=45°C	+8°C...+15°C						
Target constancy	+/-2 K						
Coolant circulation	5,0 m³/h						
Free pump pressure (min)	2,8bar	2,8bar	2,8bar	2,8bar	5bar	2,8bar	5bar
Operating voltage (+/-10%)	400V/3/50Hz	400V/3/50Hz	400V/3/60Hz	460V/3/60Hz	460V/3/60Hz	400V/3/60Hz	460V/3/60Hz
Protection class Electrical cabinet	IP54						
Air flow rate (max.)	36.500 m³/h						
Sound pressure level at 5 m distance	71 dB(A)						
Height Chiller	2.030 mm						
Width Chiller	830 mm						
Length Chiller	1.840 mm						
Socket dimensions (Weight / Length)	796 mm / 1.786 mm						
Net weight without cooling medium	665 kg	680 kg	680 kg	680 kg	680 kg	665 kg	724 kg
Pumps Quantity	1	2	2	2	2	1	2
Certificates	CE	CE	CE	CE	CE/ ETL /CSA	CE	CE/ ETL /CSA/ seismic

* depending on application, see KKT installation guideline

Chillertyp	cBoxX 80	cBoxX 80
SAP-Nummer	90908000284	90908000529
Refrigerating capacity * @ tw2=9 °C / tu=45 °C	50kW	50 kW
Refrigerating capacity * @ tw2=13 °C / tu=45 °C	55kW	57kW
Ambient temperature range	-25 - +50 °C	-25 - +50 °C
Hermetically sealed refrigeration circuit	no	no
Refrigerant	R410A	
GWP	2.088	
Refrigerant capacity	8kg	8kg
CO2 equivalent	16,7 t CO2	16,7 t CO2
Cooling medium	Water with 40Vol% AFN	Water with 40Vol% AFN
Supply temperature setpoint	9 °C	
Supply temperature range	+8 °C...+15 °C	
Target constancy	+/-2 K	
Coolant circulation	7,8 m³/h	7,2 m³/h
Free pump pressure (min)	4,5 bar	5,5 bar
Operating voltage (+/-10%)	400V/3/50Hz	400V/3/60Hz
Protection class	IP54	
Air flow rate (max.)	36.500 m³/h	36.500 m³/h
Sound pressure level at 5 m distance	71 dB(A)	71 dB(A)
Height Chiller	2.030 mm	
Width Chiller	830 mm	
Length Chiller	1.840 mm	
Socket dimensions (Weight / Length)	796 mm / 1.786 mm	
Net weight without cooling medium	680 kg	680 kg
Pumps Quantity	2	2
Certificates	CE	CE

* depending on application, see KKT installation guideline

Chillertyp	cBoxX 100	cBoxX 100	cBoxX 100	cBoxX 100	cBoxX 100
SAP-Nummer	90910000468 90910001002	909100-00469	90910000470 90910001015	90910000218	90910000510
Refrigerating capacity * @ tw2=9°C / tu=45°C	63 kW	63 kW	63 kW	60 kW	63 kW
Refrigerating capacity * @ tw2=13°C / tu=45°C	73 kW	73 kW	73 kW	70 kW	73 kW
Ambient temperature range	-25 - +50°C	-25 - +50°C	-40 - +50°C	-25 - +50°C	-25 - +50°C
Hermetically sealed refrigeration circuit	no				
Refrigerant	R410A				
GWP	2.088				
Refrigerant capacity	8	8	8	8	8
CO2 equivalent	16,7 t CO2	16,7 t CO2	16,7 t CO2	16,7 t CO2	16,7 t CO2
Cooling medium	Water with 35Vol% AFN	Water with 35Vol% AFN	Water with 50Vol% AFN	Water with 40Vol% AFN	Water with 40Vol% AFN
Supply temperature setpoint	9°C				
Additional envelope: Supply temperature range at tu=45°C	+8°C...+15°C				
Target constancy	+/-2 K				
Coolant circulation	6,0 m³/h	6,0 m³/h	6,0 m³/h	7,8 m³/h	9,1 m³/h
Free pump pressure (min)	5,0 bar	5,0 bar	5,0 bar	5,9 bar	5,5 bar
Operating voltage (+/-10%)	460V/3/60Hz			400V/3/50Hz	400V/3/60Hz
Protection class	IP54				
Air flow rate (max.)	36.500 m³/h	36.500 m³/h	36.500 m³/h	36.500 m³/h	36.500 m³/h
Sound pressure level at 5 m distance	71 dB(A)	71 dB(A)	71 dB(A)	71 dB(A)	71 dB(A)
Height Chiller	2.030 mm				
Width Chiller	830 mm				
Length Chiller	1.840 mm				
Socket dimensions (Weight / Length)	796 mm / 1.786 mm				
Net weight without cooling medium	701 kg	751 kg	701 kg	. 751 kg	751 kg
Pumps Quantity	2	2	2	2	2
Certificates	ETL /CSA	ETL /CSA/seismic	ETL /CSA	CE	CE

* depending on application, see KKT installation guideline

Chillertyp	cBoxX 120	cBoxX 120	cBoxX 120	cBoxX 120
SAP-Nummer	90912000313	90912000528	90912000471	90912000472
Refrigerating capacity * @ tw2=9°C / tu=45°C	74 kW	75 kW	75 kW	75 kW
Refrigerating capacity * @ tw2=13°C / tu=45°C	85 kW	88 kW	88 kW	88 kW
Ambient temperature range	-25 - +50°C	-25 - +50°C	-25 - +50°C	-40 - +50°C
Hermetically sealed refrigeration circuit	no			
Refrigerant	R410A			
GWP	2.088			
Refrigerant capacity	17	17	17	17
CO2 equivalent	35,5 t CO2	35,5 t CO2	35,5 t CO2	35,5 t CO2
Cooling medium	Water with 40Vol% AFN	Water with 40Vol% AFN	Water with 35Vol% AFN	Water with 50Vol% AFN
Supply temperature setpoint	9°C			
Supply temperature range	+8°C...+15°C			
Target constancy	+/-2 K			
Coolant circulation	7,8 m³/h	10,8 m³/h	7,8 m³/h	7,8 m³/h
Free pump pressure (min)	5,9 bar	5,5 bar	5,0 bar	5,0 bar
Operating voltage (+/-10%)	400V/3/50Hz	400V/3/60Hz	460V/3/60Hz	460V/3/60Hz
Protection class	IP54			
Air flow rate (max.)	45.550 m³/h	45.550 m³/h	45.550 m³/h	45.550 m³/h
Sound pressure level at 5 m distance	66 dB(A)	66 dB(A)	66 dB(A)	66 dB(A)
Height Chiller	2.030 mm			
Width Chiller	1.100 mm			
Length Chiller	2.665 mm			
Socket dimensions (Weight / Length)	1.086 mm / 2.569 mm			
Net weight without cooling medium	1.046 kg	1.046 kg	1.046 kg	1.046 kg
Pumps Quantity	2	2	2	2
Certificates	CE	CE	ETL / CSA	ETL / CSA

* depending on application, see KKT installation guideline

Chillertyp	cBoxX 160	cBoxX 180
SAP-Nummer	90916000690	90918000701
Refrigerating capacity * @ tw2=9 °C / tu=45 °C	94 kW	108 kW
Refrigerating capacity * @ tw2=13 °C / tu=45 °C	108 kW	121 kW
Ambient temperature range	-25 - +50 °C	-25 - +50 °C
Hermetically sealed refrigeration circuit	no	no
Refrigerant	R410A	
GWP	2.088	
Refrigerant capacity	17kg	23,5kg
CO2 equivalent	35,5 t CO2	49,1 t CO2
Cooling medium	Water with 40Vol% AFN	Water with 40Vol% AFN
Supply temperature setpoint	9 °C	
Additional envelope: Supply temperature range at tu=45 °C	+8 °C...+30 °C	
Target constancy	+/-2 K	
Coolant circulation	7,4 m³/h	7,4 m³/h
Free pump pressure (min)	5 bar	5 bar
Operating voltage (+/-10%)	400V/3/60Hz	400V/3/50Hz
Protection class	IP54	
Air flow rate (max.)	45.550 m³/h	49.100 m³/h
Sound pressure level at 5 m distance	67 dB(A)	67 dB(A)
Height Chiller	2.030 mm	
Width Chiller	1.200 mm	
Length Chiller	2.665 mm	3.965 mm
Socket dimensions (Weight / Length)	1.086 mm / 2569 mm	1.086 mm / 3894 mm
Net weight without cooling medium	1.200 kg	1.300 kg
Pumps Quantity	2	2
Certificates	CE	CE

* depending on application, see KKT installation guideline

1.2.2. Technical data open loop

Chillertyp	cBoxX 40	cBoxX 40	cBoxX 40
SAP-Nummer	90904000865	90904000875	90904000870
Refrigerating capacity * @ tw2=13 °C / tu=50 °C /	23 kW	27 kW	27 kW
Ambient temperature range	-25 - +50 °C		
Hermetically sealed refrigeration circuit	no		
Refrigerant	R410A		
GWP	2.088		
Refrigerant capacity	6 kg		
CO2 equivalent	12,5 t CO ₂		
Cooling medium	Water with 35Vol% AFN		
Supply temperature range	+8 °C...+15 °C		
Supply temperature setpoint	13 °C		
Target constancy	+/-2K		
Tank volume	300 l		
Tank level (max)	266 l		
Coolant circulation *	4,0 m³/h	4,1 m³/h	
Free pump pressure	2,8 bar	3,0 bar	
Operating voltage (+/-10%)	400V/3/50Hz	460V/3/60Hz	400V/3/60Hz
Protection class Electrical cabinet	IP54		
Air flow rate (max.)	12.600 m³/h		
Sound pressure level at 5 m distance	55 dB(A)		
Height Chiller	2.030 mm		
Width Chiller	830 mm		
Length Chiller	1240 mm		
Socket dimensions (Weight / Length)	796 mm / 1.186 mm		
Net weight without cooling medium	540 kg		
Pumps Quantity	2		
Certificates	CE	CE + ETL/CSA	CE

* depending on application, see KKT installation guideline

Chillertyp	cBoxX 60		cBoxX 60	cBoxX 60
SAP-Nummer	90906000866		90906000876 90906001013	90906000871
Refrigerating capacity * @ tw2=13°C / tu=45°C	41 kW		41 kW	41 kW
Ambient temperature range	-25 - +50°C			
Hermetically sealed refrigeration circuit	no			
Refrigerant	R410A			
GWP	2.088			
Refrigerant capacity	7 kg			
CO2 equivalent	14,6 t CO ₂			
Cooling medium	Water with 35Vol% AFN			
Supply temperature setpoint	13°C			
Additional envelope: Supply temperature range at tu=45°C	+8°C...+15°C			
Target constancy	+/-2 K			
Tank volume	300 l			
Tank level (max)	266 l			
Coolant circulation *	5,0 m³/h			
Free pump pressure	2,8 bar		5,0 bar	2,8 bar
Operating voltage (+/-10%)	400V/3/50Hz		460V/3/60Hz	400V/3/60Hz
Protection class Electrical cabinet	IP54			
Air flow rate (max.)	20.000 m³/h			
Sound pressure level at 5 m distance	69 dB(A)			
Height Chiller	2.030 mm			
Width Chiller	830 mm			
Length Chiller	1240 mm			
Socket dimensions (Weight / Length)	796 mm / 1.186 mm			
Net weight without cooling medium	620 kg			
Pumps Quantity	2			
Certificates	CE		CE + ETL/CSA	CE

* depending on application, see KKT installation guideline

Chillertyp	cBoxX 80	cBoxX 80	cBoxX 80
SAP-Nummer	90908000867	90908000877	90908000872
Refrigerating capacity * @ tw2=9°C / tu=45°C /	50 kW	50 kW	50 kW
Ambient temperature range	-25 - +50 °C		
Hermetically sealed refrigeration circuit	no		
Refrigerant	R410A		
GWP	2.088		
Refrigerant capacity	8		
CO2 equivalent	16,7 t CO ₂		
Cooling medium	Water with 35Vol% AFN		
Supply temperature range	+8°C...+15°C		
Supply temperature setpoint	9 °C		
Target constancy	+/-2 K		
Tank volume	500 l		
Tank level (max)	468 l		
Coolant circulation *	7,8 m³/h	7,2 m³/h	7,2 m³/h
Free pump pressure	4,5 bar	5,5 bar	5,5 bar
Operating voltage (+/-10%)	400V/3/50Hz	460V/3/60Hz	400V/3/60Hz
Protection class Electrical cabinet	IP54		
Air flow rate (max.)	36.500 m³/h		
Sound pressure level at 5 m distance	71 dB(A)		
Height Chiller	2.030 mm		
Width Chiller	830 mm		
Length Chiller	1840 mm		
Socket dimensions (Weight / Length)	796 mm / 1.786 mm		
Net weight without cooling medium	650 kg		
Pumps Quantity	2		
Certificates	CE	CE + ETL/CSA	CE

* depending on application, see KKT installation guideline

Chillertyp	cBoxX 100	cBoxX 100	cBoxX 100
SAP-Nummer	90910000868	90910000878 90910001016	90910000873
Refrigerating capacity * @ tw2=10 °C / tu=45 °C /	60 kW	63 kW	63 kW
Ambient temperature range	-25 - +50 °C		
Hermetically sealed refrigeration circuit	no		
Refrigerant	R410A		
GWP	2.088		
Refrigerant capacity	8		
CO2 equivalent	16,7 t CO ₂		
Cooling medium	Water with 35Vol% AFN		
Supply temperature setpoint	9 °C		
Additional envelope: Supply temperature range at tu=45 °C	+8 °C...+15 °C		
Target constancy	+/-2 K		
Tank volume	500 l		
Tank level (max)	468 l		
Coolant circulation *	7,8 m³/h	6,0 m³/h	9,1 m³/h
Free pump pressure	5,9 bar	5,0 bar	5,5 bar
Operating voltage (+/-10%)	400V/3/50Hz	460V/3/60Hz	400V/3/60Hz
Protection class Electrical cabinet	IP54		
Air flow rate (max.)	36.500 m³/h		
Sound pressure level at 5 m distance	71 dB(A)		
Height Chiller	2.030 mm		
Width Chiller	830 mm		
Length Chiller	1.840 mm		
Socket dimensions (Weight / Length)	796 mm / 1.786 mm		
Net weight without cooling medium	720kg		
Pumps Quantity	2		
Certificates	CE	CE + ETL/CSA	CE

* depending on application, see KKT installation guideline

Chillertyp	cBoxX 120		cBoxX 120	cBoxX 120
SAP-Nummer	90912000869		90912000879	90912000874
Refrigerating capacity * @ tw2=10°C / tu=45°C / 4,0 m3/h	74 kW		75 kW	75 kW
Ambient temperature range	-25 - +50°C			
Hermetically sealed refrigeration circuit	no			
Refrigerant	R410A			
GWP	2.088			
Refrigerant capacity	17			
CO2 equivalent	35,5 t CO ₂			
Cooling medium	Water with 35Vol% AFN			
Supply temperature setpoint	9°C			
Supply temperature range	+8°C...+15°C			
Target constancy	+/-2 K			
Tank volume	500 l			
Tank level (max)	468 l			
Coolant circulation *	7,8 m³/h	7,8 m³/h	10,8 m³/h	
Free pump pressure	5,9 bar	5,0 bar	5,5 bar	
Operating voltage (+/-10%)	400V/3/50Hz	460V/3/60Hz	400V/3/60Hz	
Protection class Electrical cabinet	IP54			
Air flow rate (max.)	45.550 m³/h			
Sound pressure level at 5 m distance	66 dB(A)			
Height Chiller	2.030 mm			
Width Chiller	1.100 mm			
Length Chiller	2.665 mm			
Socket dimensions (Weight / Length)	1.086 mm / 2.569 mm			
Net weight without cooling medium	1100 kg			
Pumps Quantity	2			
Certificates	CE	CE + ETL/CSA	CE	

* depending on application, see KKT installation guideline

1.3. Elements

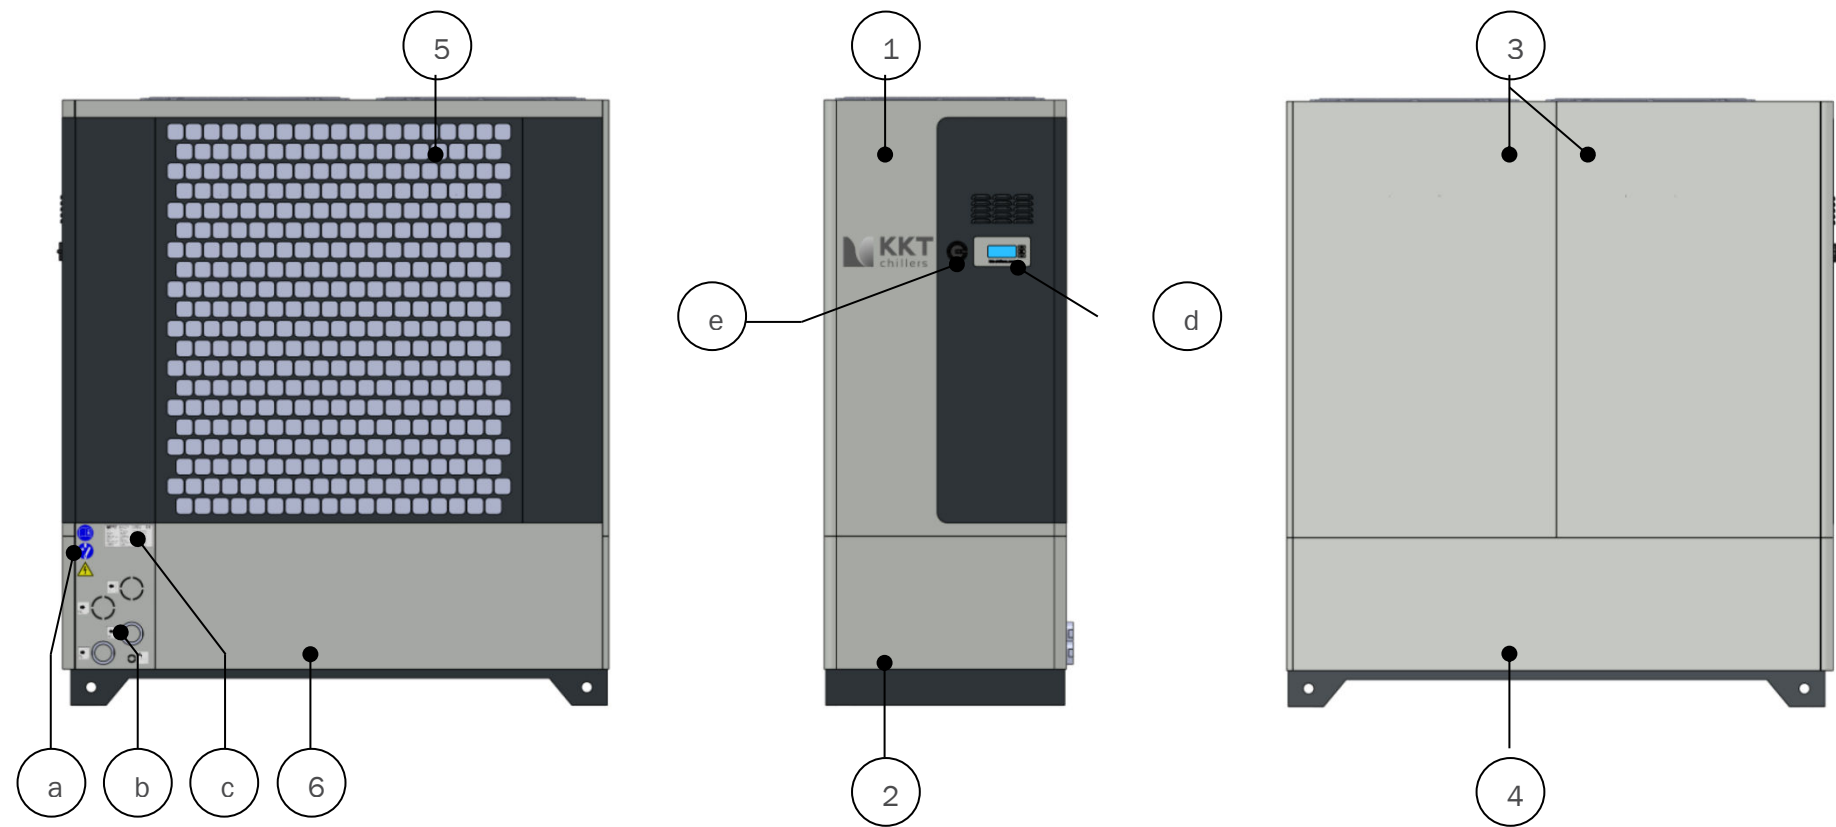


Figure 1: Elements

1	Cover panel operating side top		a	Safety instructions
2	Cover panel operating side bottom		b	Water connections
3	Cover panel service side top		c	Nameplate
4	Cover panel service side bottom		d	Display
5	Cover panel condenser protection grilles		e	Main switch
6	Cover panels hydraulics			

1.4. Explanation of terms

For the sake of better understanding, we have listed some relevant terms that are used frequently in this document.

Table 4: Explanation of terms

Term	Explanation
Application	The source of heat hydraulically connected to the chiller.
Process circuit	Application and piping to the chiller.
Cold water circuit	Process circuit and chiller in hydraulic piping.
Cold water	Refrigerant in cold water circuit.
Cooling air	Heat absorbing ambient air drawn through the machine.
Net weight	Machine ready for operation without cooling water.
Gross weight	Machine ready for operation with cooling water.

2. Function and main components

The chiller consists of the main components compressor, condenser, expansion valve, evaporator, which are arranged in a circuit (**Figure 2**). Refrigerant circulates in this circuit. In the evaporator, it absorbs heat from the cold water and emits it in the condenser into the drawn in air.

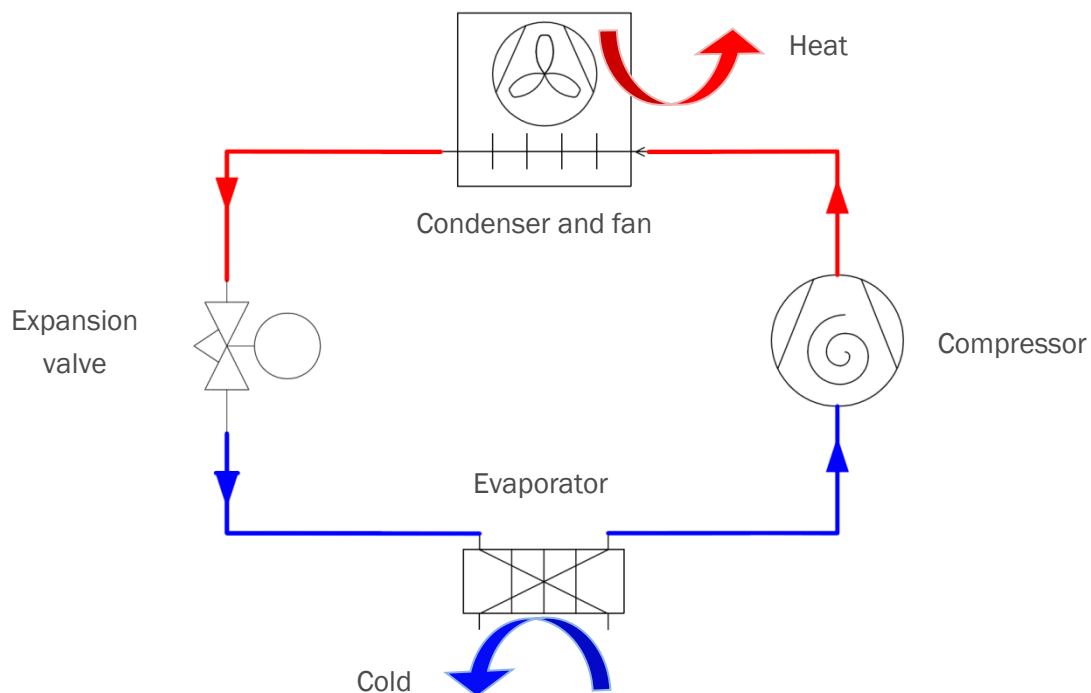


Figure 2: refrigeration diagram

In addition, diverse pressure and temperature sensors, a control unit, a high-pressure switch, one or more pumps and one or more fans are also installed for control and operation of the chiller.

2.1. Compressor

The compressor generates the needed pressure difference for evaporation and condensation between heat sink and heat source in the refrigerant circuit. Vaporised refrigerant coming from the evaporator is drawn in and compressed in the compressor to the condensing pressure.

The compressors used work on the basis of the scroll principle. Scroll compressors are maintenance-free, quiet and have a very high degree of efficiency.

The flow temperature is controlled by switching on or off one or more compressors (see **8.7.5 Compressor control**). Sequential changeover ensures that all compressors are loaded uniformly.

2.2. Evaporator

The evaporator is a plate heat exchanger that transfer heat from the cold water to the refrigerant. In order for the transfer of heat to take place, the refrigerant in the evaporator must have a lower temperature than the cold water and changes its physical state upon heat absorption from liquid to gaseous.

If the cold water is polluted, deposits can accumulate on the transfer surfaces of the evaporator. This impairs the transfer of heat to the refrigerant and has negative effects on the refrigerating capacity of the machine. Therefore always make sure to use the prescribed water quality and do not make use of any other additives than prescribed.

2.3. Condenser

The condenser is a microchannel heat exchanger that transfers heat from the refrigerant to the ambient air. In order for the transfer of heat to take place, the refrigerant in the condenser must have a higher temperature than the drawn-in ambient air changes its physical state upon heat dissipation from gaseous to liquid.

Contaminated cooling air can cause deposits to accumulate on the condenser surface. This impairs the transfer of the heat to the refrigerant. This restricts the operating limit of the machine and reduces the refrigerating capacity of the machine. How to clean the condenser is described in **Chapter 9 Cleaning**. If you operate your chiller in an environment contaminated with dust or oil vapours, make use of the optionally available air filter mat (see **9.1: Air filter mat**).

2.4. Expansion valve

The expansion valve regulates the admission of liquid refrigerant to the evaporator and restricts the pressure of the refrigerant before entering the evaporator. In this process, the refrigerant cools down to the evaporating temperature.

The expansion valve used in the machine is regulated electronically. The electronic regulation ensures that the evaporator is constantly optimally supplied with refrigerant. This improves the COP (coefficient of performance) and reduces pressure fluctuations in the refrigeration circuit.

2.5. Refrigerant

The refrigerant R410A circulates in the refrigeration circuit. It "transports" the heat from the evaporator the condenser and continuously changes its physical state in doing so.

R410A is a fluorinated greenhouse gas consists of the zeotropic mixture 50% R32 and 50% R125 with virtually negligible temperature glide. R410A has a very high volumetric cooling capacity and has no ozone depletion potential (ODP=0). A corresponding safety data sheet can be requested from our KKT chillers Service Team (see: **Contact details**).

2.6. Oil

The compressor components subject to friction are lubricated by oil that is added to the refrigerant at the factory. Polyolester-160SZ is used for this purpose. The oil is soluble in the refrigerant and distributes itself with it throughout the entire refrigeration circuit. The total oil quantity of the specific unit can be taken from

the technical data. A corresponding safety data sheet can be requested from our KKT chillers Service Team (**see: Contact details**).

2.7. Filter dryer

The task of the filter dryer is to absorb any contamination or moisture from the cooling circuit. Both refrigerant and oil are hygroscopic. When installing the refrigeration circuit, the oil may absorb moisture. This moisture can lead to corrosion and impair the cooling process. The filter dryer bonds this moisture and also has a mechanical filter effect. If work is being performed on the refrigeration circuit, for which it has to be opened, the filter dryer must be replaced.

2.8. Pressure sensors

The pressure sensors used are compact pressure transmitters with piezoresistive measurement cell. The sensors continuously record the system pressure at various locations in the refrigerant and cold water circuits. The values are used to regulate the system and for visualisation on the controller display.

2.9. Temperature sensors

The temperature sensors employed are equipped with a platinum measurement cell. The sensors continuously record the temperature at various locations in the refrigerant and cold water circuits. The values are used to control the system.

2.10. Control unit / main circuit board

The control unit is a control that is programmed at the factory. This is where all system-technical measurement values and information come together. In addition, the electrical components are controlled via algorithms.

2.11. Display

The display is used to visualise the necessary information and processes of the system for the user. Plus, it can be used to make entries. The display communicates with the control unit. Further information on operation can be found in **Chapter 8.5 Control panel**.

2.12. Control cabinet

The control cabinet conforms to the requirements of EN 60204 and contains the electrical and electronic components for controlling the chiller. The control cabinet can be accessed by removing the operating panel. To prevent damage to the main switch when disassembling the side panel, it must be tilted at least 10 cm before it can be removed. It can be opened by means of a standard two-way key. A corresponding circuit diagram is included with the device.

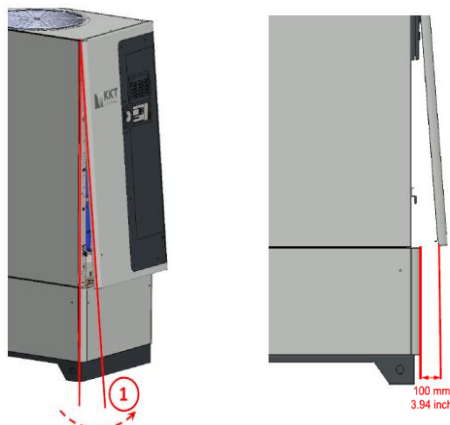


Figure 3: Demounting the side panel

2.13. Pump

The pump of the chiller provides for the necessary circulation of the cold water.

2.14. Fan

The fan draws in the cooling air from the environment via the condenser and discharges the heated air upward from the chiller. To prevent injuries, the fan is protected against accidental contact by protective grilles. The fan's speed is variable and is regulated from the main circuit board. The speed of the fan is essentially determined by the condensing pressure. The fan is protected against thermal overload. In units with two fans the speed of fan1 is always the same as the speed of fan2.

2.15. Closed loop cold water circuit


Cold water is conveyed through the process circuit by means of the internal pump. In the process circuit, the cold water absorbs heat. The circuit closes when the cold water is conveyed back into the chiller. It goes through the evaporator in which it discharges the heat. Then the cycle starts again.

Furthermore, the closed system is designed with a membrane expansion vessel that is under a certain initial pressure depending on the system volume. The membrane expansion vessel balances out the temperature fluctuations and the associated system pressure in the cold water circuit. If the water pressure increases, the membrane expansion vessel absorbs the expansion volume of the water. If the water temperature decreases, the membrane expansion vessel takes the expansion water back to the cold water circuit.

2.16. Open loop cold water circuit

The cold water is drawn out of the chiller's internal tank by the internal pump and is pumped through the process circuit. In the process circuit the cold water absorbs heat. The circuit closes when the cold water is pumped back into the chiller. It flows through the evaporator, in which it gives off heat. The cold water then passes back into the tank. The cycle begins again.


The internal overflow valve ensures the minimum volumetric flow through the chiller and therefore prevents the pump from switching off.

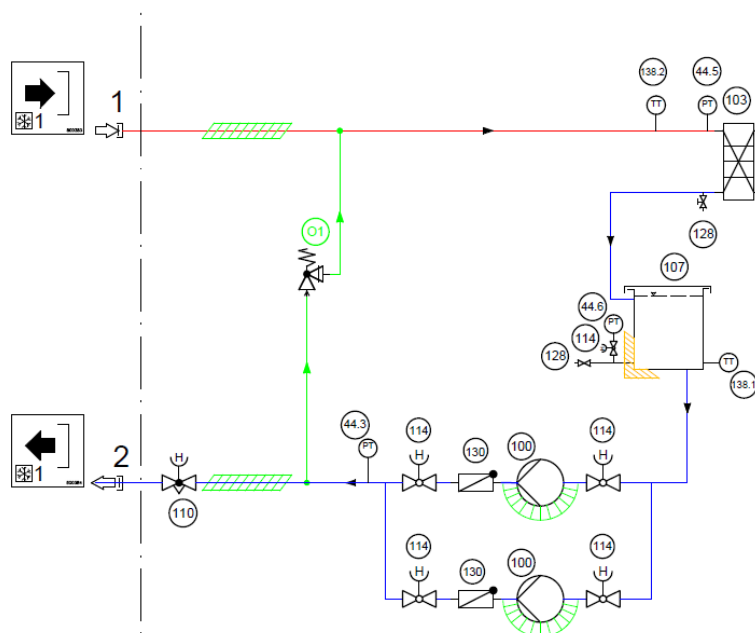

ATTENTION! The chiller may not be installed 500 mm below the process level, as there is a risk of cold water escaping or running off the internal tank of the chiller. If this however is necessary, the level package option (2.16.2 Level package) must be installed.

2.16.1. Filling a open loop cold water circuit

If the hydraulic installation of the overall system has been completed the chiller can be filled. All shut-off valves in the cold water circuit must be opened.


	ATTENTION! Only use approved refrigerants, see Chapter 2.18 and 2.19! If there is a risk of frost, note Chapter 1.1 Taking out of service! All operating liquids must be mixed before they are added to the system!
---	--

Procedure for chillers with integrated tank:

Remove the cladding panels 3 and 4 (see Chapter **1.3 Elements**) and fill your system via the internal filling connection mounted on the tank or use a hose to fill directly into the internal tank.

(the shut-off valve to the level sensor must also be closed and the cotter pin (if present) on the tank cap must be released)

Attention: the cotter pin (if present) must be reattached to the tank cap after filling.

	ATTENTION! The spring cotter (if present) must be reattached to the fuel filler cap after filling. (flat side must point upwards)
---	--



Procedure for chillers without integrated tank:

In the standard version, a machine without integrated tank has no filling connection. Provide a filling connection in the process circuit for filling the machine. If an external tank is installed in the process circuit, fill your system directly into this tank.

All filling and feed connections are identified with the following pictogram:





Figure 4: Filling and feed connection

	ATTENTION! In the EU you must follow the provisions of EN378-3. Please also note and follow the local installation regulations and provisions, especially the Ordinance on handling water pollutant substances and BGR500.
---	---

2.16.2. Level package (accessories)

The level package must be installed if the application ore piping is to be installed more than 500 mm above the chiller. This option is supplied as a separate supply and consists of an electrically controlled valve and a non-return valve. The electrically controlled valve must be installed at the inlet of the unit, the non-return valve at the outlet of the unit. The electrical installation of the valve is carried out in the control cabinet according to the circuit diagram.



ATTENTION! If the level package is installed in the external piping and the system can also be closed elsewhere in the line (e.g. ball valve/gate valve), the water should not be subject to large temperature swings, as the resulting expansion can cause damage to the pipe or connection points.

2.17. Materials used in the water circuit

In the standard version, the material compilation is depicted as shown in Table 5:

Table 5: Materials used in the standard version

Component	Material (cBoxX 40 – cBoxX180)
Unit connections	V2A 1.4305
Evaporator	V2A 1.4301 and copper (99.9%)
Pump	Grey cast iron and V2A 1.4301
Mechanical seal	EPDM
Sealing plugs yellow	Polyamide PA 6
Sealing plugs black	Polyoxymethylene (POM)
Bends, tees, couplings	Gunmetal CC499K
Fittings	V4A 1.4408
Hose nozzle	Brass, nickel-plated
Temperature sensor	V2A 1.4301
Pressure sensor	V2A 1.4301

Table 6: Materials used in the open loop version

Component	Material (cBoxX 30 – cBoxX100)
Unit connections	V2A 1.4305
Hose	Synthetic rubber band
Evaporator	V2A 1.4301 and copper (99.9%)
Tank	V2A 1.4301
Tank nozzle	V4A 1.4571
Pump	Grey cast iron and V2A 1.4301
Mechanical seal	EPDM
Sealing plugs yellow	Polyamide PA 6
Sealing plugs black	Polyoxymethylene (POM)
Filling and drain valve	Brass, nickel-plated
Bends, tees, couplings, fittings	Gunmetal CC499K , V4A 1.4408
Hose nozzle	Brass, nickel-plated
Angle swivel fitting (level indicator)	PVC and nickel-plated brass
Temperature sensor PT1000	V2A 1.4301
Pressure sensor XSK AC10I-U188	V2A 1.4301
Overflow valve (optional)	Gunmetal
Tank heating (optional)	Nickel-chromium-iron alloy Alloy 825

2.18. Water quality

The following limit values must be adhered to to ensure the safe operation of the devices:

Table 6: Water quality


Property / Constituents	Unit	Value range Standard model	Value range Non-ferrous metal version
pH-value (20 °C)	-	7,5 - 9	6 - 10
Saturation index	-	-0,2 < 0 < 0,2	-
Conductivity	µS/cm	30 - 500	3 - 2000
Water hardness	°dH	4,5 - 8,5	< 8,5
Total germ count	K/ml	<10,000	<10,000
Grain size	µm	< 250	< 250
Glycole fraction (AFN)	Vol%	0, 20 - 40	0, 20 - 40
Oil fraction	Vol%	0	0
Chloride (Cl ⁻)	mg/l	< 200	< 200
Sulphate	mg/l	< 70	< 300
Nitrate	mg/l	<100	<100
Copper	mg/l	<0.1	<0.1
Iron	mg/l	<0.2	<0.2
Free carbonic acid	mg/l	< 5	<20
Manganese	mg/l	<0.1	<0.1
Ammonia	mg/l	< 0,5	< 20
Free chloride	mg/l	<0.5	< 1
Sulphide	mg/l	< 1	< 1
Hydrogen carbonate	mg/l	70 - 200	-
Hydrogen sulphide	mg/l	< 0,05	< 0,05
Filterable substances	mg/l	< 30	< 30

To prevent clogging of the plate heat exchangers, the prescribed limit values must be observed.

Furthermore, any occurrence of mucilage bacteria in the cooling water must be ruled out. If this is not possible, KKT chillers can suggest or provide a suitable inhibitor on the basis of a biological water analysis to remove the mucilage agents.

2.19. Permitted coolant media

Permitted are water fluids and mixtures of Water specification defined in *Chapter 2.18 Water quality* and monoethylene glycol with corrosion protection inhibitors,

	ATTENTION! The water - glycol mixture ratios specified in the Technical Data Chapter 1.2 must always be observed Do not use mixtures of different anti-freeze products. This can lead to undesired chemical reactions as well as silting.
---	--

2.19.1. Permitted cooling media

Water and mixtures of waters (antifreeze plus biocide inhibitors), e.g. Antifrogen N (AFN) according to the details given in *Chapter 2.18 Water quality*. The following table shows the requirements for the mix ratio of water with the antifreezes AFN. To maintain the performance of your machine and prevent damage to components, these values must be maintained as precisely as possible.


	ATTENTION! Do not mix different antifreezes. This can cause unwanted chemical reactions and silting up. ATTENTION! Even in regions where frost-free conditions are guaranteed throughout the year, freezing protection additives must be used for water flow temperatures <+10°C.
---	---

Table 8: AFN mix ratios (or equivalent)

Setting	Frost-free at t-environment to	AFN mix ratio
Glycol 20 - 25 %	-10 °C	20-25 %
Glycol 30 - 35 %	-15 °C	30-35 %
Glycol 40 %	-25 °C	40 %

3. Options and accessories

The chiller can be equipped in the factory with the options described in the following.

The positions marked with "accessory" are included with the device, unattached, and can be re-ordered at any time with the respective product number. The installation of the accessory is the responsibility of the installer of the machine. You can also ask our KKT chillers Service Team to arrange for this installation (see *Contact details*).

Information on the features of your machine can be found in the separately enclosed summary documentation.

3.1. Heater for the compressor and control cabinet

The oil sump heater prevents the deposit of refrigerant in the oil when the temperature is low. When the compressor is started up this refrigerant would be liberated from the oil as gas and make the oil foam up. Under these conditions the lubrication of components subject to friction in the compressor would be poor, which could lead to the damage of the compressor.

The control cabinet heater is thermostatically controlled and prevents moisture from the drawn-in ambient air in the event of lower ambient temperatures from condensing on electrical and electronic components of the control cabinet and hence from damaging them.

To enable the activation of both heaters, the chiller may not be disconnected from the power supply (**Chapter 8.2 Selecting the operating mode**).

3.2. Insulating cold pipes

To prevent condensation on cold pipes of the chiller, the option insulation of the cold pipes must be specified in case of high temperature differences between the environment and the cold water flow and taking into account the relative humidity.

The insulation of the hydraulic pipes, connections and fittings installed by the customer must be vapour diffusion-tight in accordance with the regionally applicable standards and regulations.

3.3. Pump redundancy

Depending on the device model, a second pump can be used for redundancy reasons. If a second pump is included, the pumps are switched at regular intervals (can be set e.g. to every 24h) in order to increase the service life of the pump. This means that if a pump fails, the second pump is activated automatically and therefore ensures secure operation.

3.4. Phase monitoring

Compact-Line devices can also be optionally equipped so-called phase monitoring. It monitors phase sequence, phase failure, under voltage and asymmetry and covers a voltage range of 200-690V. If the respective predefined limits are exceeded the system switches off and protects the electrical components installed in the unit.

3.5. Hot gas bypass for output control <1K

If a more precise target constant than ± 1 Kelvin is required, the chiller can be equipped with an output control. In this case the output of the refrigeration circuit is adjusted to the cooling demand by an electronically controlled valve. Unlike the standard control by switching compressors on or off, a higher target constant is achieved by the continuous regulation of the valve.

3.6. Low-temperature package (ambient temperature < -25 °C)

If the chiller is operated at ambient temperatures below -25 °C, the low-temperature package has to be installed. With the use of additional heating and two non-return valves, this ensures a stable refrigerant pressure in the refrigeration circuit at temperatures below -25 °C.

At ambient temperatures < -25 °C install pipe trace heating (on site by customer).

To prevent frost damage, never switch off or disconnect the chiller from the power supply at ambient temperatures < -25 °C. If necessary, set the chiller to standby mode

Ensure that you always comply with the requirements with regard to the operating fluid and the mix ratio

3.7. Levelling feet (accessories)

The levelling feet are used for vibration isolation and for height adjustment. They consist of a threaded rod and a grey cast iron shell with an elastic element attached. The threaded rod enables the height to be

adjusted and compensates for floors sloping by up to 5°. The elastic element has a slip-resistant covering. **Figure 5: Machine base (foot) - outside view** and **Figure 6: Machine base (foot) - mounting on the baseplate** show the installed machine foot – the technical drawing is given in the appendix. (Attention: Not allowed in combination with the earthquake kit)

The Seismic feet (**Figure 7: Seismic feet are used for seismic and high wind gust regions**) are used for seismic and high wind gust regions

A height adjustment is not possible with these feet.

The following units are equipped with the seismic feet as standard:

90904000743, 90904000744, 909060-00424, 909070-00425, 909100-00469, 90912000471, 90912000472

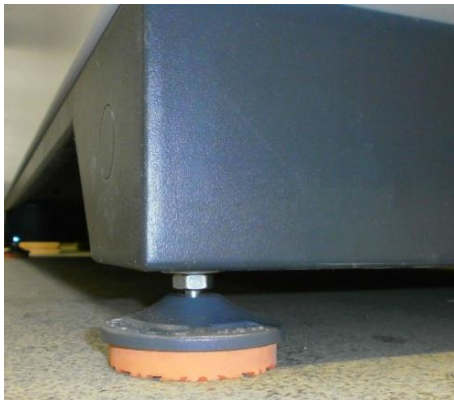


Figure 5: Machine base (foot) - outside view



Figure 6: Machine base (foot) - mounting on the baseplate



Figure 7: Seismic feet are used for seismic and high wind gust regions

3.8. Filter assembly group coolant circuit (accessories)

The water filter protects the cold water circuit against dirt. The set, consisting of a filter, fitting and two shut off valves, is enclosed with the chiller in a separate pack and must be fitted onto the cold water inlet of the chiller from the outside when the chiller is installed.

3.9. Anybus-Gateway (accessories)

A Modbus TCP communication is already included on the display pcb as a standard feature. An Anybus gateway is not required.

3.10. Remote control panel (accessories)

In the event that the chiller shall be operated not from the machine itself but from a different operating location, the chiller can be delivered with a remote control panel. Thereby the same display that is already installed in the chiller is mounted together with a rail to the operating voltage supply in one miniature housing.

The remote control panel can be connected to the chiller via the RS485 interface and takes over the complete function of the controller in the main device. By setting the accordant bridge in the control cabinet cabinet of the main device, the required operating place can be chosen.

3.11. Special languages (accessories)

These instruction manuals are provided in German, English, French and Spanish. Other languages are available on request.

3.12. Seaworthy crate packaging (accessories)

Seaworthy crates for the Compact-Line are produced according to International Standards for Phytosanitary Measures with packaging made of solid wood (ISPM 15). This means that the crates are made of heat-treated solid wood which has been stripped of its bark. Only wood-based materials, such as OSB boards, are used. In addition, all crates are marked with the IPPC logo and registration number. The units are fixed in the crate with the help of coach bolts, ring nuts and polyester straps and are packed in a sea air consistent foil with desiccant. The components used to pack the units can be dismantled using a cross-head screwdriver. Please note the changed transport dimensions.

3.13. Earthquake kit (accessories)

In the event that your chiller is to be operated in areas of tectonic activity, your device can be supplied with the earthquake kit accessory. Here the chiller is equipped with additional reinforcement bars as well as specially non-adjustable machine bases (feet). *Figure 8* and *Figure 9* show the assembled earthquake kit - detailed assembly instructions are included with the accessory.

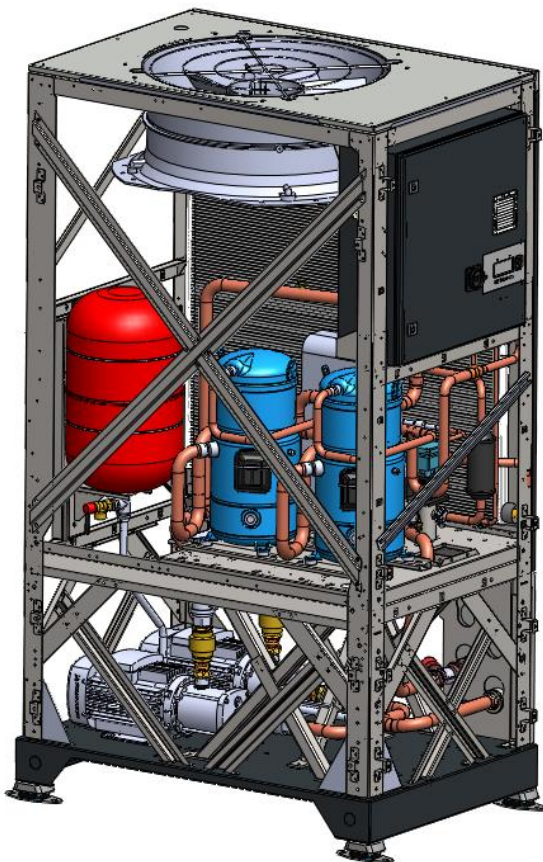


Figure 8: Earthquake kit cBoxX 60

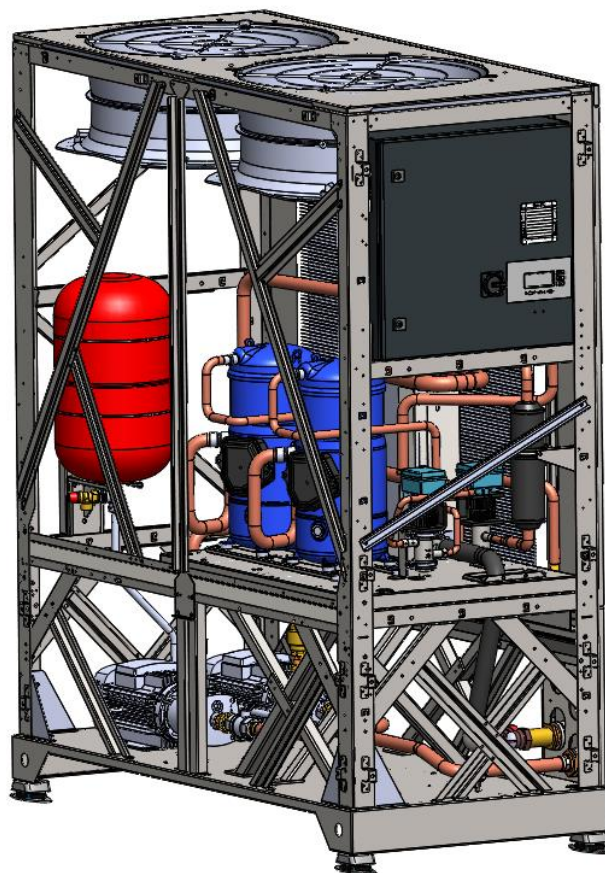


Figure 9: Earthquake kit cBoxX 70 - cBoxX 100

3.14. CIP Chiller interface panel (accessories)

The CIP accessory is a transfer station that can be installed in the customer's cold-water circuit. The transfer station is made of steel and contains a water filter, a flow rate indicator, inlet and outlet valve, pressure and temperature display as well as a connection to an emergency cooling system.

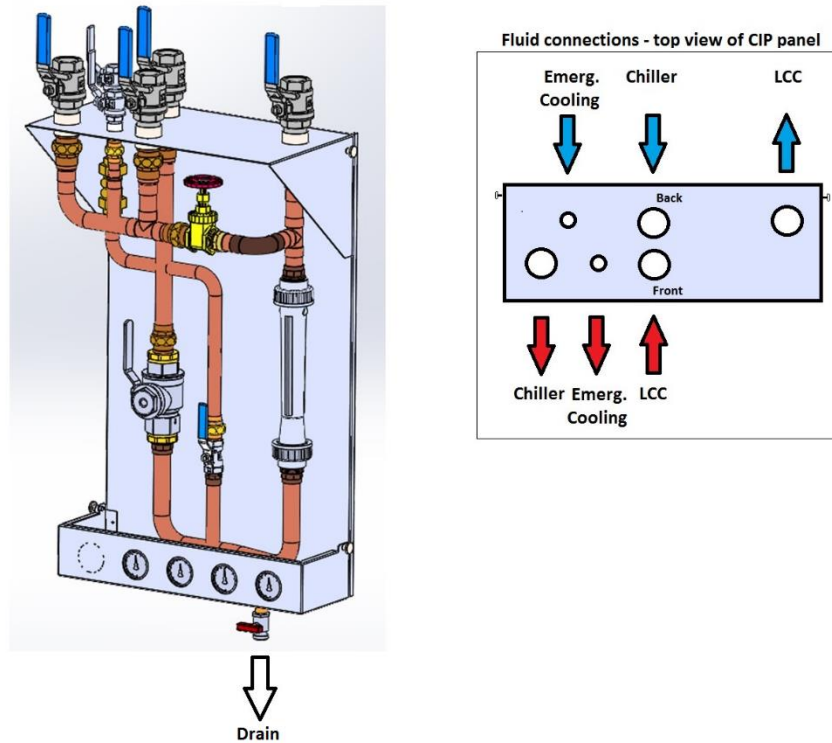


Figure 10: Chiller Interface Panel

4. Safety

The chiller, within the sense of its intentional use, is designed to operate safely, provided also that the instructions concerning transport, installation, commissioning/startup and maintenance given in these operating instructions are complied with.












4.1. General information

The chiller contains a high-pressure circuit. The maximum pressure that occurs is 45 bar. Even when inactive or disconnected from the power supply the circuit is still under pressure.

4.2. Hazard warnings






A number of warning labels are applied to the machine. Keep these warnings clean at all times. Damaged or missing warnings must be replaced.

Table 7: Definition of the safety symbols

	Observe the instruction manual!
	Before opening the machine, disconnect the machine from the power supply. The machine may only be opened 5 minutes after it has been disconnected from the power supply.
	Beware of dangerous electrical voltage! If the machine is only turned off by means of the main switch, some of the terminals in the control cabinet will still be under dangerous voltage.
	Wear foot protection!
	Wear hand protection!
	Wear eye protection!
	Wear protective clothing!
	Beware of hot surface!
	Beware of cold surface!
	ATTENTION!
	Contains pressurised gas!

The following hazard warnings apply in particular to the machine:


Table 8: Hazard warnings

	ATTENTION! Work on the chiller must be carried out by properly qualified, competent personnel!
	The surfaces of pipes and components of the refrigerant and cold water circuit and electrical equipment can be very hot during operation and even for a while after.
	The surfaces of pipes and components of the refrigerant and cold water circuit and electrical equipment can be very hot during operation and even for a while after.
	ATTENTION! Pipes and components of the refrigerant and cold water circuit are pressurised.
	ATTENTION! Do not undo the system parts. Risk of injury on contact.
	ATTENTION! Only use the specified liquids!

4.3. Residual energy

Even if all the hazard warnings in **Chapter 4.2** are taken into account, the following residual energy situations can result in a hazard:

- Rotational energy of the decelerating fan
 - Despite the installed protective grille, hair or pieces of clothing can still be drawn in and caught.
- Hot surfaces on machine parts
 - Especially the compressor head and the hot gas pipe and the condenser can still be very hot for some time after the machine has been switched off. Temperatures within the range from 60°C to 90°C are possible.
- Dangerous electrical voltage in the control cabinet despite the switched off main switch
 - If the machine is only switched off at its main switch, dangerous electrical voltage is nonetheless still present at several terminals in the control cabinet. In particular, these are the main supply terminal and the input terminals of the main switch.

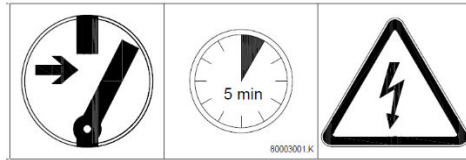

- Refrigeration circuit is pressurised
 - Provided it is not damaged the refrigeration circuit is closed. Therefore, a hazard is not to be assumed.

Note:

After switching off the unit at the main switch, if you wait for 5 minutes before opening the unit risks due to rotational energy and electrical power can be reduced. In this case only the residual thermal energy must be considered.


4.4. Safety devices, guards and safeguards

4.4.1. High-pressure limiter

The high-pressure limiter (PZH) is a pressure switch with manual reset. The PZH limits the condensing pressure and switches off all compressors via their load contactors when the maximum permitted system operating pressure is reached. It is part of the safety chain. The PZH is installed on the refrigerant collector for the chiller types cBoxX 40 – cBoxX 180 (see **Figure 11: Position of the high pressure limiter (PZH)**). If the PZH has been activated, a message is output at the operating terminal. In this case, please following the instructions in the Chapter Troubleshooting (see **Appendix Fehler! Verweisquelle konnte nicht gefunden werden. Fehler! Verweisquelle konnte nicht gefunden werden.**)



High pressure limiter (PZH)
cBoxX 40 – cBoxX 100

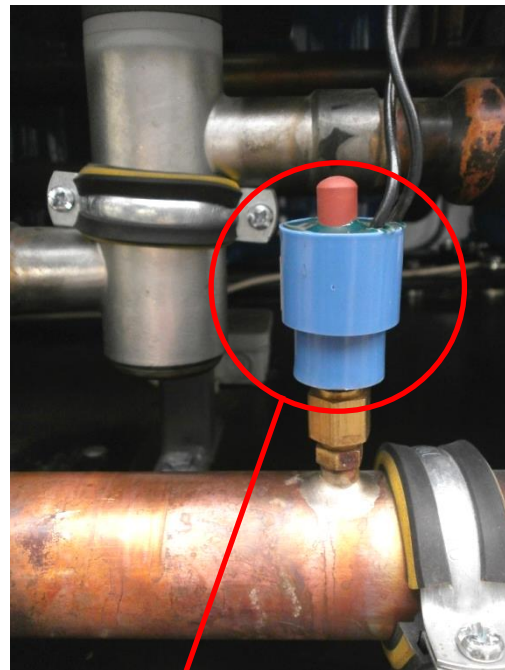

High pressure limiter (PZH)
cBoxX 120 -cBoxX 180

Figure 11: Position of the high pressure limiter (PZH)

4.4.1. High-pressure monitoring via sensor

If the high pressure in your machine's refrigeration circuit increases to a maximum value, the compressor is switched off by the **high-pressure sensor**. A reset is only required at the display. If the high-pressure monitor has triggered, please follow the instructions in the **Troubleshooting chapter (see Appendix II)**.

4.4.2. Low-pressure monitoring

If the low-pressure in the refrigeration circuit of your system is too low for the specified cooling medium there is a risk of freezing. For this reason, the low pressure is monitored continuously and if it falls below a minimum value, the compressor is switched off. If the low pressure has increased to a minimum value, the compressor is released once more. If the low-pressure monitor has triggered, please follow the instructions in the **Troubleshooting chapter (see Appendix II)**.

4.4.3. Flow monitoring

If the flow rate of the cold water, which is pumped through the evaporator is too low, there is a risk of freezing. For this reason, the pressure at the evaporator inlet is monitored continuously. If the pressure falls below the preset value, the "Flow warning" message appears. If the value falls below the minimum value, the pump and the compressor are switched off and the "Flow stop" message appears. In this case, please follow the instructions in the ***Troubleshooting chapter (see Appendix II)***.

4.4.4. Personal protective equipment when operating the machine

Operating the machine involves making settings at the control panel. During operation of the machine its cover panels are installed, the machine is completely enclosed. No protective equipment is needed. We recommend ear protectors be worn by persons with jobs that require them to be continuously in the immediate vicinity of the chiller. Please refer to the sound emission information included in the technical data.

4.5. Personal protective equipment for servicing work

Servicing work on the machine includes all work for which the machine is opened and one or more cover panels are dismantled. In particular, this includes cleaning work in accordance with ***Chapter 8.7.1 Thermostatic pump start***

To save energy, the consumer pump is not operated permanently, but cyclically. An evaporator pump, if present, is also controlled. The tank heater or compressor is released after a short circulation of the cold water.

The thermostatic pump start is intended for two applications:

- When the chiller is switched on, a defined "start" temperature of the cold water should be made available to the application. The water temperature is kept at a constant level to prevent unnecessary temperature drops or increases.
= **Pre-tempering**
- If the system is not installed without anti-freeze mixture in the cold water circuit, a minimum temperature of 5 °C should be maintained.
= **Anti-freeze mixture**

The tank heater is activated when the temperature falls below the minimum setpoint and the compressor is activated when the maximum setpoint is exceeded. A separate hysteresis is assigned to each setpoint.

This results in the following control sequence:

- Cyclic activation of the pump every 60 min. for at least 5 min.
- 1 min. after activating the pump (circulation process), the tank heater or compressor is released.
- The pump switches off when the runtime has elapsed and the tank heater and compressor are no longer required by the temperature.

If the interval time is 0 min, the thermostatic pump start is only activated by the temperature. However, the runtime is effective.

4.5.1. Electronic level monitoring

Before switching on the chiller the electronic level monitoring starts up.

The level is monitored for three states:

- Tank min level STOP; the chiller switches off immediately.

- Tank min level warning; the chiller continues running but does not switch back on in the event of a stoppage. The water feed solenoid valve (only with optional automatic water top-up) is opened.
- Tank max level message; the cold water feed, water feed solenoid valve (only with optional automatic water feed) is closed.

The ideal state is if the level is above the warning level and below the maximum level. In this case no message appears.

If the chiller is switched on and the min level warning is reached the chiller remains switched on so that any cooling process that has been started is not interrupted. If the chiller is switched off, the chiller does not start, to ensure that no cooling process is initiated that may not be able to be ended.

4.5.2.Switching the chiller On/off

The following conditions must be fulfilled for the chiller Standby state:

- The control has completed its initialization routine,
- Release of at least one primary pump,
- Release of the cold water feed or return sensor,
- No exceeding of the cold water feed temperature,
- Release through tank level monitoring,
- Approval by cold water pressure monitoring on evaporator.

A primary pump is released if:

- It is selected in the system configuration of the software,
- No motor protection switch faults are queued,
- No flow monitoring faults are queued,
- No minimum or maximum pump pressure faults are queued.

A condenser fan is released if:

- No motor protection switch faults are queued,
- No fault is queued at the digital fault input (e.g. control unit group fault).

From the standby state, the chiller can be switched on or off via a software switch in the display. In Automatic mode the floating contact for the remote control must be closed.

When the system is switched on the primary pumps are switched on with a 3.5 s delay. After a further 3.5 s the fan control is released.

When the primary pump is switched on a timing element starts for each pump, which activates the monitoring of the minimum and maximum cold water pressure at the pump outlet. When the pump is switched on a timing element also starts for release of the compressor's temperature control. The compressor's temperature control is released when the time of a pump has expired. This time is also used for activation of the flow monitoring.

The pressure and flow monitoring takes place with two timing elements:

- Delay at start; the pressure or the flow monitoring does not trigger an alarm.
- Delay during operation; in order to ignore short-term fluctuations in pressure or flow, the alarm is delayed.

When the system is switched off the temperature control is locked immediately and therefore the compressor is switched off. The pump continues running to prevent uncontrolled continued evaporation.

4.5.3. Cold water flow temperature control

In the normal case the sensor in the tank (system with tank, with pump) is used to control the cold water feed temperature. If this sensor fails, the control switches internally to the sensor in the cold water return and the target value (setpoint value) is increased by a defined value.

A purely proportional controller is used, which generates an output signal from -100 % to +100 %. The switching on and switching off points of the cooling levels are set within this range. If the setpoint is changed the switching ratio between the compressors is retained, it is shifted overall. If the proportional range is changed the switching ratio is also retained. The range is extended or reduced.

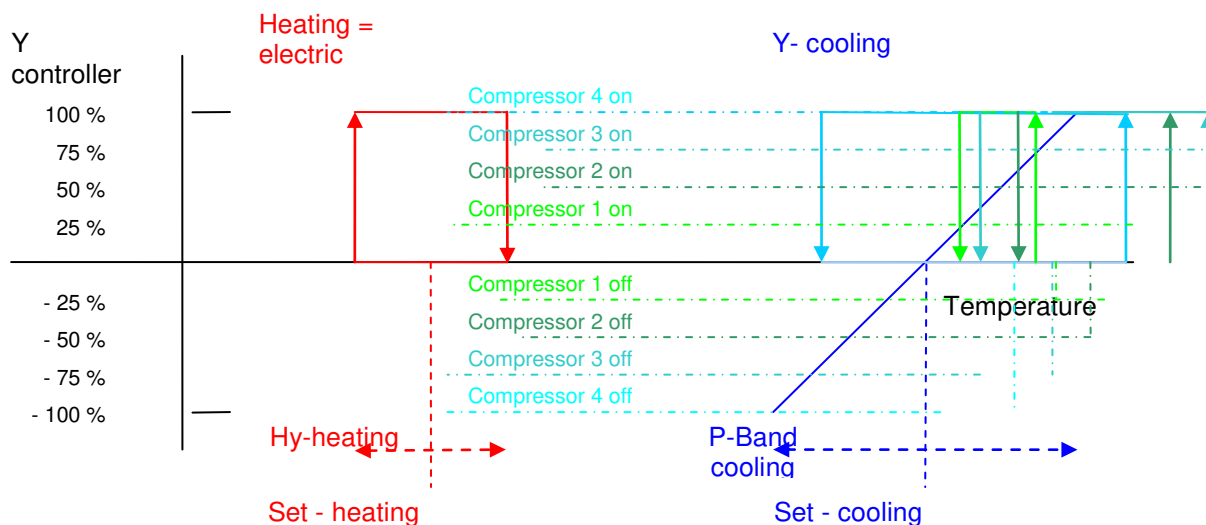


Figure 20: Cooling and heating sequence

Different operating states reduce the number of cooling levels required by one cooling level:

- High pressure warning
- Low pressure warning
- Difference between high and low pressure is too large.

4.5.4. Compressor control

The control is defined for a refrigeration circuit with a maximum of four compressors. The number of compressors is selected by means of coding resistance. The number of compressors is determined once when the control is restarted (switching on of the operating voltage) and is compared with the number of the last restart. If these are not the same the "Coding resistance changed" alarm is generated. When the alarm is acknowledged the new number of compressors is stored in the E-EEPROM and the factory setting is accepted as the new number of compressors.

The compressors are requested depending on the controller output signal. The compressor with the least number of operating hours switches on first. If no more refrigerating capacity is required the compressor that switched on first also switches off first. The compressors are switched on with a time delay (comment: only applies if several compressors exist)

In the event of a fault in a compressor (motor protection switch) a fault changeover is activated. The high pressure is monitored on the hardware side by means of the high-pressure limiter. If it is triggered all compressors switch off immediately. In addition, the high pressure is controlled by means of a pressure

transmitter. This also switches off the compressors if the setpoint is exceeded, but releases them again if the value falls below the release value. Before switching off the, high-pressure transmitter signals a warning.

Low pressure is also monitored by pressure transmitters. If the value falls below the setpoint the compressors switch off. If the switch-off value is exceeded by the hysteresis, the compressors are released again. The triggering of the alarm is delayed by two timing elements. The first timing element is started with the request for the compressor. If no intake pressure has built up by the time the time expires the low-pressure fault alarm is triggered. After the start time has expired the low pressure may exceed the switch-off value for a short time. If this occurs more than three times within an hour the compressors are blocked. Before a low-pressure fault is triggered a low-pressure warning is signalled.

4.5.5.Fan speed control

Due to the continuous adjustment in the number of fans, the condensing pressure is kept constant depending on the ambient temperature by means of a PI controller. As the condensing pressure at the moment in which the compressor is switched on rises very fast, the PI controller is superimposed by a P controller with limiting setpoint. This only intervenes if the PI controller is too slow.

4.5.6.Electronic expansion valve control

An electronic expansion valve with PI controller is used to keep the overheating constant. To prevent the maximum operating pressure (MOP) from being exceeded, a P controller is used, which counteracts when the MOP is approached and limits opening of the electronic expansion valve.

4.5.7.Temperature limit monitoring

The temperature of the cold water feed is monitored for a minimum and maximum limit value if the chiller is switched on (pump is running). If the limit value is exceeded or the minimum is not reached, an alarm is triggered with time delay, which switches off the chiller.

4.5.8.Group fault alarm

A group fault alarm is triggered if an alarm occurs. All alarms are included in the group fault, but not the warnings. The group fault signalling relay has a floating changeover contact and is energised in fault-free operation, in order to ensure wire break monitoring.

4.6. Execution types

Basically, you can choose between two types of construction:

4.6.1.ECO mode

The default setting of the Compact-Line provides for operation in ECO mode ("Run" parameter is set to "0"). As a result, the increase in fan speed reduces the condensing pressure to the minimum necessary value in the respective operating point – the electrical power consumption of the overall system is limited to a minimum.

4.6.2.Comfort mode

In case of strict sound emission requirements the fan speed can be reduced to the minimum necessary value in the respective operating point and sound power level limited to a minimum. To do this the "Run" parameter must be set to "1". As a result of the lower air flow rate a reduced output of around 3% is to be expected.

The optimised parameter list for your application is enclosed with the unit.

Cleaning and maintenance work in accordance with *Chapter 10 Service*. Before work is carried out on the chiller the protective equipment described in *Table 7: Definition of the safety symbols* must be used.

Table 9: Personal protective equipment for servicing work

	Wear foot protection!
	Wear hand protection!
	Wear eye protection!
	Wear protective clothing!

4.7. Airborne sound emissions

The airborne sound emissions data is given as the sound pressure level, measured at a distance of five metres without reflection. Its maximum value is shown in the technical data. This only occurs at the highest fan speed at the air intake side of the chiller (*Figure 12*, measuring point [1]). The emissions in [2] to [4] are generally around 10 % lower than [1].

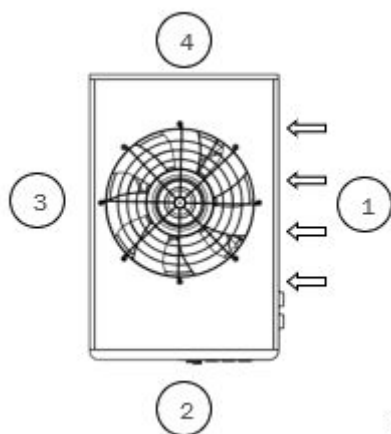


Figure 12: Airborne sound emissions

In partial load mode or under favourable ambient conditions (see *Chapter 4.8.1 Noise*) the fan speed and therefore the sound emissions reduce automatically.

4.8. Notes on reducing noise and vibration

4.8.1.Noise

Details of your chiller's airborne sound emissions are given in **Chapter 4.7**.

To reduce noise pollution caused by airborne sound emissions it is advisable to install the chiller out of doors and out of the range of workplaces.

If this is not possible we recommend that when the unit is installed attention is paid to ensuring that the air intake side is not pointed directly at a workplace/workstation.

High ambient temperatures mean high fan speeds and this increases the noise levels produced. It is advisable not to expose the chiller to direct sunlight or to install it in rooms with high air temperature. Further information is given in **Chapter 6.2 Installation site**.


4.8.2.Vibration

The chiller is designed so that the vibrations caused by the compressor are largely isolated by the chiller's frame.

To minimise the effect of vibration still further it is possible to install the chiller with optionally available levelling feet (see **Chapter 3.7 Levelling feet (accessories)**). These are fitted with damping elastomers.

4.9. Residual risks

4.9.1.Electrical

	ATTENTION: The mains voltage must comply with the quality characteristics of EN 50160 and the defined standard voltages of IEC 60038. The electrical connection on the building side is the responsibility of the operator. The operator must ensure that the limit values permitted in DIN EN 60204-1 (occurrence of a leakage current to earth at any mains connection of more than 10 mA AC or DC) are complied with, and that measures are taken to reduce them to non-critical values if they are exceeded.
--	---



If all safety provisions are complied with there is no risk.

4.9.2.Mechanical



If all safety provisions are complied with there is no risk.

Mechanical damage to components or pipes of the refrigerant circuit can cause refrigerant to leak. Leaking refrigerant can cause cold burns.

4.9.3.Chemical

	ATTENTION! Toxic and caustic products are produced by the thermal decomposition of the R410A refrigerant.
	ATTENTION! Do not install in rooms with naked flames or smoke.

4.9.4.Other

	ATTENTION! Risk of suffocation if the chiller is installed in a room that is too small please note and follow chapter 6.2.2.
	ATTENTION! In the EU you must follow the provisions of EN378-3. Please also note and follow the local installation regulations and provisions, especially the ordinance on handling water pollutant substances and BGR500.

4.10. Dangerous substances

4.10.1. Refrigerant R410A

First aid measures:

- After inhaling: remove victim to fresh air, ensuring your own safety, and keep the person at rest in a comfortable position. Get medical attention. If the person stops breathing, give artificial respiration
- Following skin contact: leave clothing that has fused with the skin. Rinse areas damaged by cold with lukewarm water (never use hot water). Do not rub! Cover with sterile dressing. Ensure medical treatment is provided.
- Following eye contact: rinse the eyes with clean water or eyewash solution for at least 15 minutes with the eyelids open. Consult an eye specialist.
- After swallowing: swallowing is not considered to be a likely risk as the refrigerant in the surroundings is gaseous.

Notes for the doctor: do not give the patient catecholamine or adrenalin ephedrine preparations.

Fire-fighting measures::

- Suitable extinguishing agents: The product itself is not flammable. Match the extinguishing measures to the surrounding fire. Cool containers with sprayed water.
- Particular hazards due to the substance, its combustion products or gases formed: forms toxic and caustic gases and fumes on decomposition.
- Special protective equipment for fire-fighting: self-contained or air-line breathing apparatus and acid-resistant protective suit for deployment in immediate vicinity.
- Further information: The effect of fire can cause bursting or explosion of the container. Ignitable gas-air mixtures possible under certain conditions.

Measures in case of accidental release::

- Environmental protection measures: where possible do not allow the product to get into the environment.
- Cleaning procedure: leave the product to evaporate.

Handling and storage:

- Handling: fire and explosion protection: heating results in increased pressure and a risk of bursting. Cool containers at risk with water. Open the containers slowly and carefully.

Personal protective equipment:

- Respiratory protection: not necessary if adequate ventilation available. Self-contained or air-line breathing apparatus within enclosed rooms, if insufficient oxygen supply available, in case of substantial or uncontrollable release. Only use breathing apparatus in accordance with the international / national standards. Only use breathing apparatus, no filtering devices.
- Hand protection: chemical-resistant protective gloves. Recommended material: Polyvinyl alcohol.
- Eye protection: close-fitting safety glasses/goggles.

General protection and hygiene measures:

- Do not inhale fumes / aerosols.
- Do not eat/drink or smoke during work.

4.10.2. ÖI POE 160SZ

First aid measures:

- After inhaling: remove victim to fresh air, ensuring your own safety, and keep the person at rest in a comfortable position. Get medical attention.
- Following skin contact: remove soiled, soaked clothing. Wash skin with water. If symptoms develop, get medical advice.
- Following eye contact: rinse the eyes with clean water or eyewash solution for at least 10 minutes with the eyelids open. Consult an eye specialist.
- After swallowing: can cause vomiting. Have the mouth rinsed out with water and give the patient two glasses of water to drink. Get medical advice.
- Notes for the doctor: symptomatic treatment and assistive therapy as indicated.

Fire-fighting measures:

Low fire risk. Product only ignites in case of very large heat supply.

- Suitable extinguishing agents: match to the surroundings. Carbon dioxide, powder and foam extinguishing agents. Use water with caution to avoid possibly considerable steam generation.
- Particular hazards due to the substance, its combustion products or gases formed: irritant fumes are released during thermal decomposition.
- Special protective equipment for fire-fighting: self-contained or air-line breathing apparatus and acid-resistant protective suit for deployment in immediate vicinity.
- Further information: The effect of fire can cause bursting or explosion of the container. Ignitable gas-air mixtures possible under certain conditions.

Measures in case of accidental release:

- Environmental protection measures: do not allow the product to get into the sewers or bodies of water. Absorb with sand, soil or a similar absorbent material. Ensure proper disposal in containers.
- Cleaning procedure: Clean the contaminated area with water. Caution! Slipping hazard!
- Further information: Inform the police or competent authorities in case of penetration in the sewers or bodies of water.

Personal protective equipment:

- Respiratory protection: not necessary if adequate ventilation available. Self-contained or air-line breathing apparatus within enclosed rooms, if insufficient oxygen supply available, in case of substantial or uncontrollable release. Only use breathing apparatus in accordance with the international / national standards. Only use breathing apparatus, no filtering devices.
- Hand protection: Protective gloves. Recommended material: nitrile rubber.
- Eye protection: close-fitting safety glasses/goggles.

Handling and storage:

- Handling: avoid lengthy skin contact. Avoid inhaling high concentrations of vapour. Avoid inhaling high concentrations of fumes.
- Storage: suitable material for containers: mild steel. Tightly close unused containers to prevent the penetration of moisture. Keep away from strong oxidants.

4.11. Reasonably foreseeable misuse

Reasonably foreseeable misuse, for the users of the chiller, means foreseeable use in a way not intended according to the operating instructions. It is due to foreseeable human behaviour.

The following dangerous situations can arise due to misuse which could reasonably be expected:

- dangerous voltage of electrical components, if the machine is not disconnected from the power supply before it is opened.
- the fan and compressor can start up suddenly, without any visible change to the machine's state.
- even if the machine has been disconnected from the power supply, the surfaces of components in the unit can still be very hot or cold.
- risk of damage to external hydraulic components if the cold water feed is confused with the cold water return.
- danger caused by using media in the unit that have not been approved.
- danger caused by connecting an incorrect source of power.

4.12. Information for emergencies

If an emergency occurs during operation of the chiller, the machine must be disconnected from the mains at once using the master switch. Remove people from the danger zone immediately. An emergency situation can among other things be:

- a leak and escape of refrigerant and/ or oil.
- a part of the machine becoming mechanically detached from it.
- the machine making unusual noises.
- the machine vibrating severely.

Then contact the KKT chillers Service Team. If you detect a refrigerant or oil leak, proceed as described in Chapter 4.9 Dangerous substances.

5. Handling and storage


The chiller is fixed on a wooden pallet in the factory for delivery. The machine is additionally protected against damage by polystyrene corner protectors and stretch film. Therefore you should remove the packaging as late as possible.

5.1. Dangerous goods

Chillers with refrigerant capacity >12 kg must be declared as dangerous goods in accordance with UN2857. The cBoxX 40 – cBoxX 70 chillers have been specified so that they contain <12 kg refrigerant. This reduces the logistics costs of our customers and final consumers.

5.2. Transport

The chiller may only be transported using a fork lift truck or crane with sufficient rated capacity. The net weight of your machine is given in the technical data. Please note that if a machine has already been in operation, it can contain residual fluids, which increase the transport weight.

	ATTENTION! The chiller must not be tilted by more than 10° from the perpendicular position.
---	--

5.2.1. Forklift truck

It is possible to transport the machine both in a packed and an unpacked condition by means of fork lift truck. Please note that the centre of gravity may vary depending on the model.

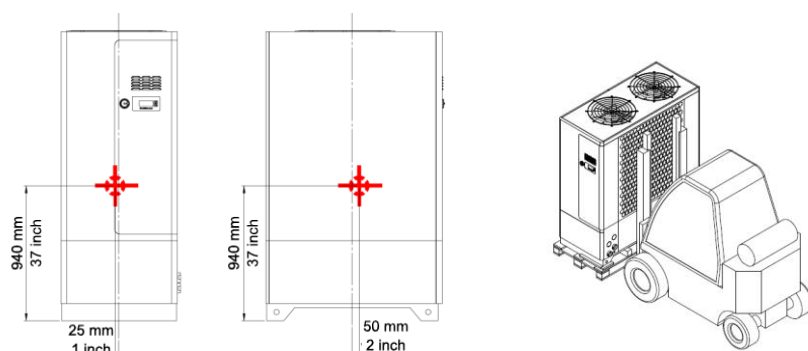


Figure 12: center of gravity cBoxX 40 – cBoxX 60

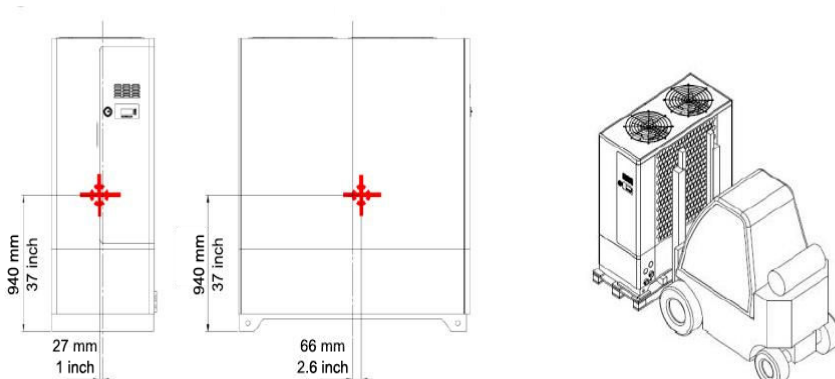


Figure 13: center of gravity cBoxX 70 – cBoxX 100

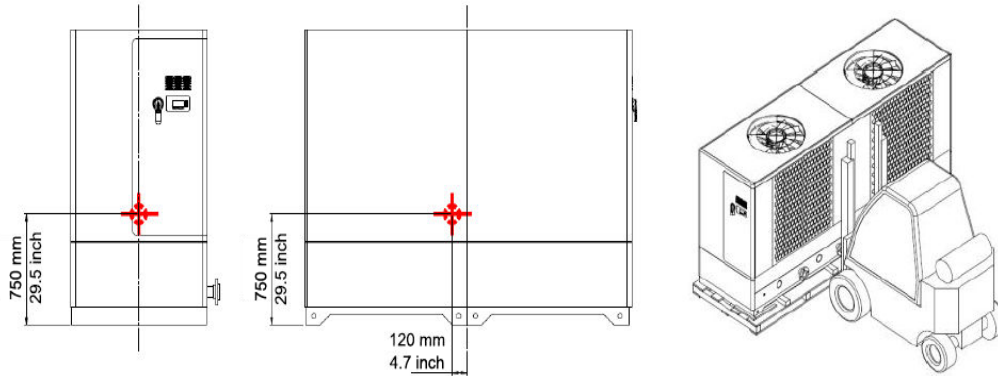


Figure 14: center of gravity cBoxX 120 – cBoxX 160

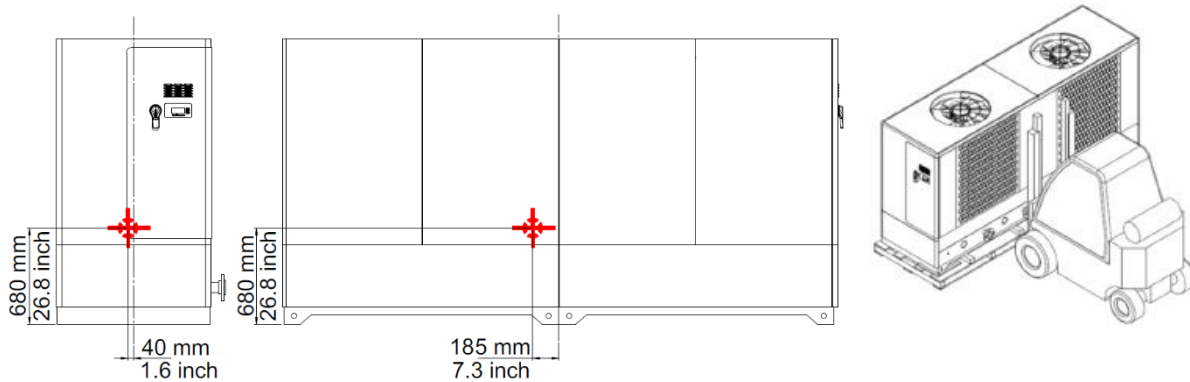



Figure 15: center of gravity cBoxX 180




5.3. Unpacking




	<p>ATTENTION! Packing straps are mechanically stressed and can snap back when cut. Risk of injuries!</p>
---	---

Remove all straps, films, corner protectors and spacers carefully. Optional accessories may be located under the film. Ensure that they are not damaged.

The packaging can be recycled according to the local regulations. Refer to the following table for details of the packaging materials used:

Table 10: Material of packaging

Element	Material	Recycling code
Polystyrene corner protectors	Polystyrene	
Stretch film	Polyethylene	
Edge protection / corner protectors	Cardboard	

Packaging tape	Polypropylene	
Strapping seals	Steel, galvanized	
Wooden pallet	Untreated raw wood, spruce or pine without bark	

5.4. Storage

If the chiller is stored for more than one month, it should remain in the transport packaging or be repacked.

The following conditions must be noted for storage:

- Avoid direct sunlight and moisture
- Ambient temperatures 30°C to 50°C

To avoid frost damage the cold water circuit must be completely drained before the chiller is placed in storage and then flushed with a mixture of water and anti-freeze (see **Chapter 11.1 Draining**).

6. Installation

6.1. Overview

Several tasks are necessary to install the chiller. The following work schedule shows the order in which they are carried out:

- Prepare the installation site
- Install the machine
- Flush the cold water circuit
- Hydraulic installation
- Fill the whole system
- Vent the whole system
- Electrical installation

6.2. Installation site

6.2.1. General information

The chiller is approved for indoor installation (installation site classification I) - as well as for outdoor installation (installation site classification III) for the access area categories (b) "monitored access area" and (c) "access area to which only authorised personnel have access" (note option packages). DIN EN 378-1. The electrical degree of protection corresponds to IP54. If installed indoors, ensure sufficient air exchange. An enclosed room will steadily heat up and the machine can switch off due to a lack of cooling. The exhaust heat from the machine can be approximately calculated as 1.3 x net refrigeration capacity. The air flow rate required for your machine is given in Table 3: **Technical data**. When choosing the installation site, ensure that waste heat from other processes cannot be guided directly onto the air intake side of the chiller. The installation of exhaust air ducts is not allowed.



ATTENTION! Do not install in rooms with naked flames or smoke.

6.2.2. Minimum room volume

The refrigerant R410A contained in the system is classified in safety group A1 in accordance with EN 378-1 Table E.2. I.e. the refrigerant is not flammable and has low toxicity. If the chiller is installed in enclosed rooms without additional safety measures a minimum room volume is required. This is due to the maximum concentration occurring in an area occupied by persons in the event of release and depends on the refrigerant quantity in the chiller. Please refer to the following table for the value to be complied with for your machine.

Table 11: Minimum volume of the installation room with regard to maximum refrigerant concentration in case of a leakage if installed indoors

cBoxX chiller	40	60	70	80	100	120	160	180
Minimum volume of the installation room (in m ³)	14	16	20	20	20	40	40	55

6.2.3. Ambient temperature

The chiller is cooled by the ambient air and the lower the temperature of this cooling air the more economically the chiller works. Direct sunshine or exhaust air from other machines heats up the surrounding air and must be taken into account when installing the chiller. Preference is for a shaded installation. The maximum ambient temperature is given in the technical data.

At ambient temperatures < -25 °C install pipe trace heating (on site by customer).

To prevent frost damage, never switch off or disconnect the chiller from the power supply at ambient temperatures < -25 °C. If necessary, set the chiller to standby mode.

6.2.4. Effect of surrounding air flow

The chiller emits heat to the surrounding area, the machine also draws in cooling air. The machine controls the quantity of cooling air automatically via the speed of the fan. Air currents surrounding the machine, such as the wind, can affect this control and endanger operation of the machine. If a constant direction of an air current is known at the installation site, this should not be directed at the air intake side of the chiller.

6.2.5. Minimum clearances

The minimum clearances around the machine are made up of service clearances and clearances to ensure optimum air supply. On the one hand accessibility must be ensured from all sides, in addition, an unhindered, sufficient quantity of cooling air must be able to be drawn in and blown out upwards. If the minimum clearances are not complied with there is a risk of an air short-circuit between the air intake and discharge side.

6.2.6.Surface and foundation

The surface on which the machine is installed must be flat and horizontal. All the machine's feet must have uniform contact with the ground. Ensure that the ground/subsoil has sufficient load bearing capacity. According to the installation instructions a continuous concrete foundation with the given minimum size is recommended. For details, the gross weight of your machine is listed in the technical data (**Table 3: Technical data**). In the case of chillers equipped with a tank the net weight increases during operation by the quantity of liquid in the tank. This gives the gross weight.

If it is not possible to lay a foundation, the machine can also be positioned on a baseframe made of steel sections. Please also ensure here that all the unit feet have uniform contact with the baseframe. It is recommended to fix the Chiller to the foundation.

6.2.7.Stability

The normal situation is for the machine and the baseplate to be stood firmly on the ground. It is not necessary to anchor the machine to the ground. However, if this is necessary due to the surrounding conditions, the machine can be equipped with the optionally available levelling feet (see **Chapter 3.7 Levelling feet (accessories)**). The levelling feet provide very good resistance to slipping. If this is not sufficient for your application the machine can also be bolted to the ground. Holes are provided in the machine baseplate for precisely this purpose. The system designer is responsible for choosing suitable fixing elements.



6.2.8.Levelling

If it is necessary to level the chiller on the ground or floor, this can be done using the optionally available levelling feet.

6.2.9.Vibration isolation

If it is necessary to isolate the chiller on the ground or floor, this can be done using the optionally available levelling feet. The levelling feet are fitted with vibration-isolating elastomers.

6.2.10. Installation

	Unit outlet cold water circuit 1 (supply line)
	Unit outlet cold water circuit 1 (return line)

6.2.11. Hydraulic installation

The system designer is responsible for choosing the material and the cross-section of the hydraulic connections between the chiller and the application. Other dependent factors include the accepted pressure loss in the connection lines and the available pump pressure. When designing the connections attention must also be paid to the minimum flow rate to be maintained and sufficient resistance to the maximum pump pressure.


At ambient temperatures < -25 °C install pipe trace heating (on site by customer).

To prevent frost damage, never switch off or disconnect the chiller from the power supply at ambient temperatures < -25 °C. If necessary, set the chiller to standby mode.

Ensure that you always comply with the requirements with regard to the operating fluid and the mix ratio

The insulation of the hydraulic pipes, connections and fittings installed by the customer must be vapour diffusion-tight in accordance with the regionally applicable standards and regulations.

It must also be ensured during the hydraulic installation that the device connections available on the refrigeration machine do not provide a fixed point. In order to avoid damage to the piping and refrigeration machine, the hydraulic connections must be supported close to the device connections by the customer.

	ATTENTION! Galvanised pipes must not be used if water-glycol mixtures are used! Formation of decomposition products, which result in silting up of the system!
--	---


6.2.12. Flushing the cold water circuit

Contamination of external pipes and components can damage the chiller. Before the chiller is connected hydraulically with the cold water circuit this must be flushed several times. If there are dirt traps in the cold water circuit they must be cleaned after the flushing.

6.2.13. Filling


Once the hydraulic installation of the overall system has been completed, the chiller can be filled. All shut-off valves in the cold water circuit must be opened.

In the standard version the machine does not have a filling connection. To fill the system, provide a filling connection in the process circuit. If an external tank is installed in the process circuit, fill your system directly in this tank.

	ATTENTION! Only use approved refrigerants see Chapter 2.19! If there is a risk of frost, note Chapter 11 Taking out of service! All operating liquids must be mixed before they are added to the system!
---	---

6.2.14. Venting

If your chiller contains a horizontal pump, the pump does not have to be vented. Before switching on the pump the vent plug must be opened at the automatic vent and left open while the unit is running until all air has completely escaped from the pump body (see *Figure 16*).

	<p>ATTENTION! Please also note and follow the local installation regulations and provisions, especially the ordinance on handling water pollutant substances and BGR500 Chapter 2.35.</p>
---	--

We recommend also installing an automatic venting valve at the highest point in the cold water circuit.

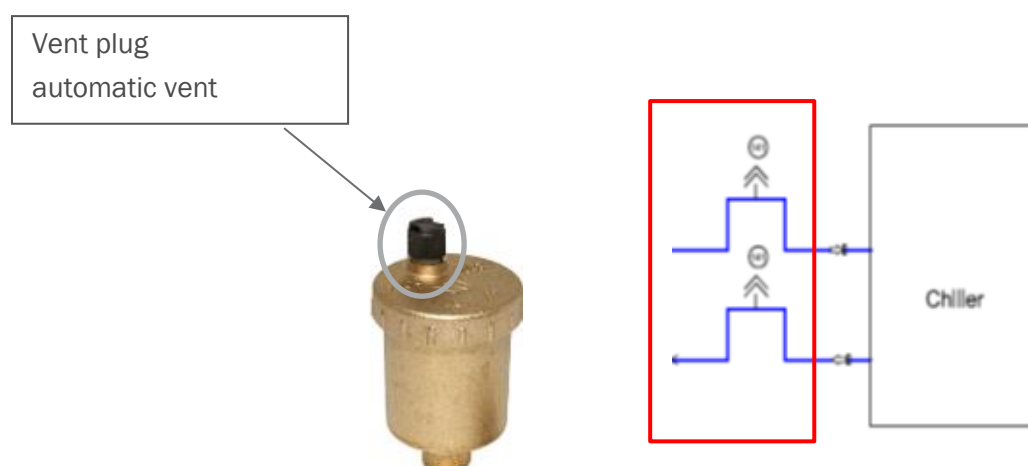





Figure 16: Automatic vent valve

Check the bleeder valve regularly and clean it if necessary.

6.2.15. Electrical installation

	<p>ATTENTION! The electrical installation, testing and commissioning may only be carried out by qualified personnel. Note and follow the local regulations.</p>
	<p>ATTENTION! Do not switch on the chiller until the hydraulic installation is completed and the machine has been filled as specified in Chapter 6.2.11. Otherwise the machine could be damaged.</p>
	<p>ATTENTION: The mains voltage must comply with the quality characteristics of EN 50160 and the defined standard voltages of IEC 60038.</p> <p>The electrical connection on the building side is the responsibility of the operator.</p> <p>The operator must ensure that the limit values permitted in DIN EN 60204-1 (occurrence of a leakage current to earth at any mains connection of more than 10 mA AC or DC) are complied with, and that measures are taken to reduce them to non-critical values if they are exceeded.</p>

The chiller is connected electrically to its main supply terminal in the control cabinet. (see *Figure 17 Main supply*). A corresponding circuit diagram is included with the unit.

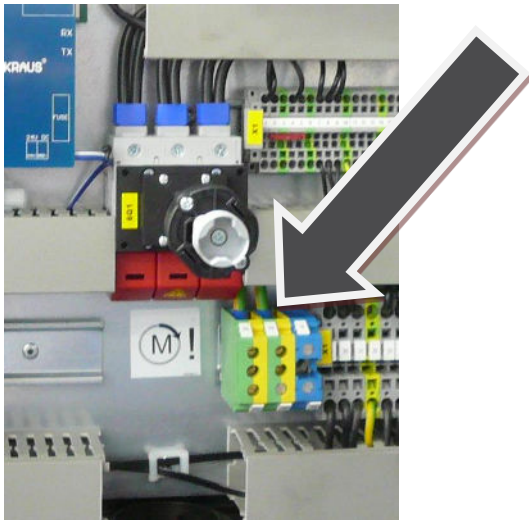


Figure 17: Main supply (here: cBoxX 40 – cBoxX 100)

The dimensioning of the load cable and the fusing must be in accordance with the machine's technical data and the local regulations of the power supply company.

The supply cable must be routed into the machine. Cut-outs are provided for this purpose in the baseplate and in the compressor mount (cBoxX 40 – cBoxX 100). Feed the supply cable, protected by rubber grommets, through these openings (see *Figure 17 Main supply*). Please note that the dimensions described in DIN VDE 0298-4 must be observed.

Never switch on the chiller immediately if the machine is moved from a cold into a warm room. The condensing moisture can damage electronic components. For the initial startup or following a lengthy period out of use all the electronic components must have become acclimatised.

Use an external control cable to set the chiller's release (see *Chapter 8.3 External release*) of the Chiller. This must be laid separately from the supply line and wired to the appropriate terminals in the switch cabinet. (see wiring diagram included in the unit)

Once the electrical installation has been completed the phase sequence must be tested. This is done by checking the rotational direction of the pump. This has a rotational direction arrow on it. If the rotational direction does not match the arrow, the phase sequence can be corrected by swapping two phases at the main supply.

7. Commissioning

Before commissioning the chiller the checklist must be used to check whether all the necessary work in *Chapter 6 Installation* has been carried out properly.

The chiller must be installed for at least 12 hours at $>+5\text{ }^{\circ}\text{C}$, so that the compressor oil can heat up and the refrigerant can be liberated from the oil.

If your machine is equipped with oil sump heating and the machine has been completely installed, it is permissible to switch on the machine at the main switch and to allow the compressor to be preheated for at least 3 hours without enabling the cooling.

7.1. Installation checklist

- Unit installed horizontal and stable?
- Any vibration damping and floor anchors installed?
- Spaces / clearances around the unit are adequate according to the requirements?
- Air intake side free from packaging materials, etc.?
- Hydraulic connection OK?
- Cold water circuit filled in accordance with the specifications? Water quality OK?
- Whole system flushed? Dirt trap cleaned?
- Cross-sections adequately dimensioned?
- Electrical connection OK? Electrical power is available?
- External pumps OK? Rotational direction?
- Unit cover closed?
- Overall system OK and ready for commissioning/startup?
- Compressor "preheated"?
- External release OK?

After checking the above list you can continue with *Chapter 8 Operation*.

8. Operation

The chiller is designed for fully automatic operation.

8.1. Switching on

First, switch on the machine at the main switch (component 5 in *Figure 18: C6842 Display and operating modes*). A start screen appears on the display.

8.2. Selecting the operating mode

In the Start screen you can choose between the following three operating modes:

- **STANDBY**
This operating mode must be selected if the chiller has been without power for more than 6 hours at ambient temperatures $< 5^{\circ}\text{C}$. In this case the compressors must be preheated for 3 h, so that the refrigerant can escape from the oil. The crankcase heater and thermostatic pump start are effective.
- **AUTO**
The chiller is ready for operation. Fully automatic operation starts by external release (potential-free contact) according to *Chapter 8.3. External release*. When the contact is open, the compressor heating and the thermostatic pump start are active. When the contact is closed, the fully automatic control for the compressor and the tank heating is enabled. The chiller regulates to its setpoint value.
- **ON**
The chiller is permanently switched on in fully automatic operation without external release.

8.3. External release

The contact for external release is bridged in the delivery state. An external control line can be wired instead of the bridge. Please refer to **Chapter 6.2.15 Electrical installation** for information on installing the external release. Fully automatic operation starts with this external release.

8.4. Control

The chiller's control consists of a control board and a control panel, which communicate with each other via a BUS connection. The control board operates autonomously so that if the control panel or communication fails, operation continues to be possible if no other fault prevents operation.

The program, setpoints, parameters and times are stored in an EEPROM in the controller and are therefore retained even in the event of a power failure. Therefore the control does not require a buffer battery. The buffer battery is only used to keep the clock running.

8.5. Control panel

The following **Figure 18** shows the chiller's display elements and controls.

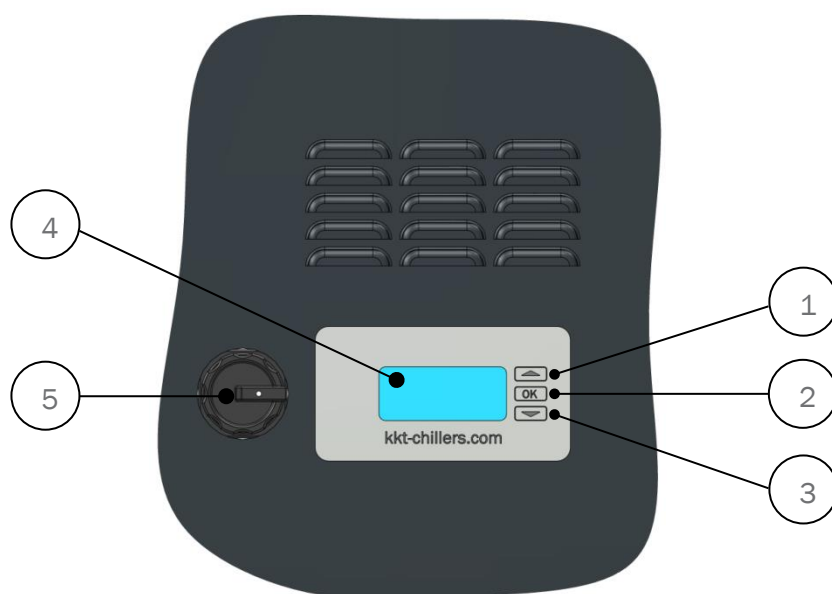


Figure 18: C6842 Display and operating modes

Table 12: Description for C6842

Number	Function Key	Function
1	"UP" button	Navigation button
2	"OK" button	Navigation button & acknowledgement button for warning and fault messages
3	"AB" button	Navigation button & acknowledgement button for warning and fault messages
4	Display with plain text	
5	Main switch	

Use the "UP" and "DOWN" buttons to select the required menu item. The selected menu item is displayed with inverse text. Press the "OK" button to return to or exit the selected menu. The data is accepted at the end of the menu by selecting the box with the tick/checkmark. In the Start screen the "right" arrow points towards the Main menu. The "left" arrow indicates return to the previous menu.

The displays are divided into the two access levels

- Customer
- Factory

Detection occurs by means of a USB stick or day password. Only the information that exists or is selected in the configuration is displayed.

8.5.1.Start screen

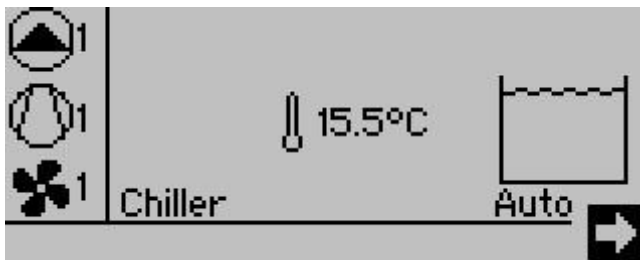


Figure 19: Example Start screen with tank and without alarm

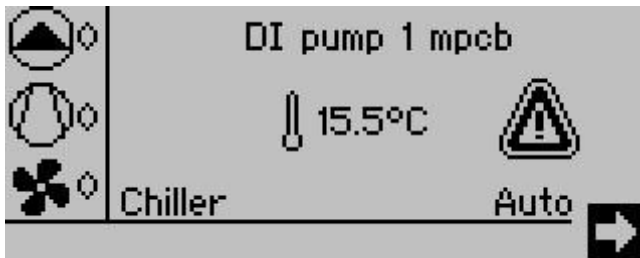


Figure 20: Example Start screen with alarm

The general operating state of the chiller is displayed on the Start screen:

- Active alarm
- Top left-hand side: Number of pumps running
- Left-hand middle: Number of compressors running
- Bottom left-hand side: Number of fans running
- Middle: Actual value of the cold water feed
- Right-hand side: Tank level (if tank installed)

If an alarm is active the alarm symbol is displayed

By pressing the UP, DOWN and OK buttons on the control panel, you can access the corresponding selection fields, in which the time and date setting, the menu access arrow and the operating mode selection are displayed. There are three switching commands:

- STANDBY: the chiller is always switched off
- AUTO: the chiller is switched on and off via the potential free contact.
- ON: the chiller is always switched on

8.5.2.Main menu

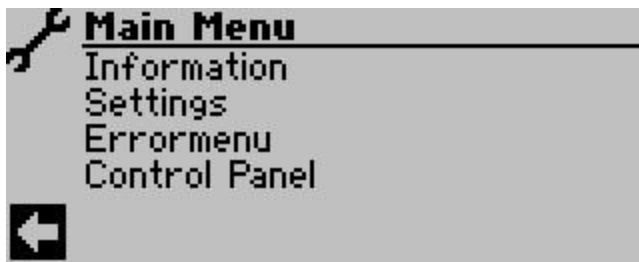


Figure 21: Main menu

From the Main menu you can move into the submenus or return to the Start screen.

For the structure of the individual submenus see *Fehler! Verweisquelle konnte nicht gefunden werden.* **REF_Ref53583081 \h * MERGEFORMAT Fehler! Verweisquelle konnte nicht gefunden werden., starting on page Fehler! Textmarke nicht definiert..**

The entries of the submenus are either visible or hidden depending on the configuration of the system.

8.5.3.Information

In the information menu you branch into different submenus, which provide an overview of the current status of the system:

Measured values	Values of the analogue inputs
Status	States of the digital inputs and outputs as well as some controller internal states
Energy meter	
Operating hours	Operating hours of the individual components of the system
Digital inputs	Status at the terminals of the digital inputs
Digital outputs	Status of the output relays
Analogue inputs	Signal before the analogue-digital converter. The value must be between 0 and 4095. 0 means that no sensor is connected. 4095 means, the input is short-circuited
Analogue outputs	Signal before the digital-analogue converter. The value 10000 corresponds to an output voltage of 10 volt
Software status	
Test point 1	
Error memory	

8.5.4.Settings

All setpoint/target and parameter values and times are stored in the Settings menu.

Limit value monitoring	
Regulation	
Pump control	
Compressor control	
Basics	Overview of the fundamental hardware configuration.
System configuration	

Sensor configuration	
----------------------	--

8.5.5.Alarm menu

In the alarm menu the alarms are listed.

The alarm is acknowledged if the "OK" button is pressed for longer than **eight** seconds.

(after five seconds, the display switches back to the start menu)

- active: The alarm is still active. (e.g. DI MSS ...) The motor protection switch has triggered.
- OK: The alarm is no longer on and has been acknowledged on the control panel. The alarm entry no longer appears the next time the Errormenu is called up.
- SH: The alarm is no longer queued. E.g. the motor protection switch has been unlocked on the hardware side but has not yet been acknowledged at the control panel.

Alarms that are preceded by the abbreviation DI refer directly to the digital input. All digital inputs must be closed in a fault-free state. The abbreviation AI indicates a sensor error of an analog input. The analog input must be checked for interruption and short circuit. Alarms without abbreviations are formed internally in the control.

8.5.6.Control panel

Customer-specific settings are stored in the Control panel menu.

Language	
Settings	
IP address	
Serial number	
Save parameters	
Load parameters	
Password	

8.5.7.Software update

The control software can be updated via the Software Update menu.

8.5.8.Datalog export

Via the Datalog export menu, the data currently stored in the control software can be exported.

8.5.9.Datalog stop

Via Datalog stop menu, the recording of the data is stopped. The USB stick is disconnected and you return to the main menu.

8.6. Parameters

The parameters are divided into the three display and access levels:

- Customer, user
- Factory setting

A parameter can have a lower display level than access level. I.e. not all the parameters displayed can be changed.

The specific parameter list for your application is enclosed with the unit.

8.7. Controller description

8.7.1. Thermostatic pump start

To save energy, the consumer pump is not operated permanently, but cyclically. An evaporator pump, if present, is also controlled. The tank heater or compressor is released after a short circulation of the cold water.

The thermostatic pump start is intended for two applications:

- When the chiller is switched on, a defined "start" temperature of the cold water should be made available to the application. The water temperature is kept at a constant level to prevent unnecessary temperature drops or increases.
= **Pre-tempering**
- If the system is not installed without anti-freeze mixture in the cold water circuit, a minimum temperature of 5 °C should be maintained.
= **Anti-freeze mixture**

The tank heater is activated when the temperature falls below the minimum setpoint and the compressor is activated when the maximum setpoint is exceeded. A separate hysteresis is assigned to each setpoint.

This results in the following control sequence:

- Cyclic activation of the pump every 60 min. for at least 5 min.
- 1 min. after activating the pump (circulation process), the tank heater or compressor is released.
- The pump switches off when the runtime has elapsed and the tank heater and compressor are no longer required by the temperature.

If the interval time is 0 min, the thermostatic pump start is only activated by the temperature. However, the runtime is effective.

8.7.2. Electronic level monitoring

Before switching on the chiller the electronic level monitoring starts up.

The level is monitored for three states:

- Tank min level STOP; the chiller switches off immediately.
- Tank min level warning; the chiller continues running but does not switch back on in the event of a stoppage. The water feed solenoid valve (only with optional automatic water top-up) is opened.
- Tank max level message; the cold water feed, water feed solenoid valve (only with optional automatic water feed) is closed.

The ideal state is if the level is above the warning level and below the maximum level. In this case no message appears.

If the chiller is switched on and the min level warning is reached the chiller remains switched on so that any cooling process that has been started is not interrupted. If the chiller is switched off, the chiller does not start, to ensure that no cooling process is initiated that may not be able to be ended.

8.7.3. Switching the chiller On/off

The following conditions must be fulfilled for the chiller Standby state:

- The control has completed its initialization routine,
- Release of at least one primary pump,

- Release of the cold water feed or return sensor,
- No exceeding of the cold water feed temperature,
- Release through tank level monitoring,
- Approval by cold water pressure monitoring on evaporator.

A primary pump is released if:

- It is selected in the system configuration of the software,
- No motor protection switch faults are queued,
- No flow monitoring faults are queued,
- No minimum or maximum pump pressure faults are queued.

A condenser fan is released if:

- No motor protection switch faults are queued,
- No fault is queued at the digital fault input (e.g. control unit group fault).

From the standby state, the chiller can be switched on or off via a software switch in the display. In Automatic mode the floating contact for the remote control must be closed.

When the system is switched on the primary pumps are switched on with a 3.5 s delay. After a further 3.5 s the fan control is released.

When the primary pump is switched on a timing element starts for each pump, which activates the monitoring of the minimum and maximum cold water pressure at the pump outlet. When the pump is switched on a timing element also starts for release of the compressor's temperature control. The compressor's temperature control is released when the time of a pump has expired. This time is also used for activation of the flow monitoring.

The pressure and flow monitoring takes place with two timing elements:

- Delay at start; the pressure or the flow monitoring does not trigger an alarm.
- Delay during operation; in order to ignore short-term fluctuations in pressure or flow, the alarm is delayed.

When the system is switched off the temperature control is locked immediately and therefore the compressor is switched off. The pump continues running to prevent uncontrolled continued evaporation.

8.7.4.Cold water flow temperature control

In the normal case the sensor in the tank (system with tank, with pump) is used to control the cold water feed temperature. If this sensor fails, the control switches internally to the sensor in the cold water return and the target value (setpoint value) is increased by a defined value.

A purely proportional controller is used, which generates an output signal from -100 % to +100 %. The switching on and switching off points of the cooling levels are set within this range. If the setpoint is changed the switching ratio between the compressors is retained, it is shifted overall. If the proportional range is changed the switching ratio is also retained. The range is extended or reduced.

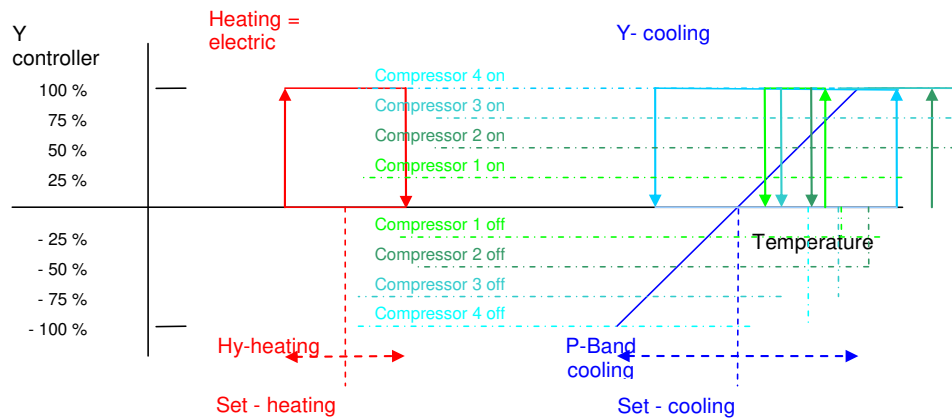


Figure 22: Cooling and heating sequence

Different operating states reduce the number of cooling levels required by one cooling level:

- High pressure warning
- Low pressure warning
- Difference between high and low pressure is too large.

8.7.5.Compressor control

The control is defined for a refrigeration circuit with a maximum of four compressors. The number of compressors is selected by means of coding resistance. The number of compressors is determined once when the control is restarted (switching on of the operating voltage) and is compared with the number of the last restart. If these are not the same the "Coding resistance changed" alarm is generated. When the alarm is acknowledged the new number of compressors is stored in the E-EEPROM and the factory setting is accepted as the new number of compressors.

The compressors are requested depending on the controller output signal. The compressor with the least number of operating hours switches on first. If no more refrigerating capacity is required the compressor that switched on first also switches off first. The compressors are switched on with a time delay (comment: only applies if several compressors exist)

In the event of a fault in a compressor (motor protection switch) a fault changeover is activated. The high pressure is monitored on the hardware side by means of the high-pressure limiter. If it is triggered all compressors switch off immediately. In addition, the high pressure is controlled by means of a pressure transmitter. This also switches off the compressors if the setpoint is exceeded, but releases them again if the value falls below the release value. Before switching off the, high-pressure transmitter signals a warning.

Low pressure is also monitored by pressure transmitters. If the value falls below the setpoint the compressors switch off. If the switch-off value is exceeded by the hysteresis, the compressors are released again. The triggering of the alarm is delayed by two timing elements. The first timing element is started with the request for the compressor. If no intake pressure has built up by the time the time expires the low-pressure fault alarm is triggered. After the start time has expired the low pressure may exceed the switch-off value for a short time. If this occurs more than three times within an hour the compressors are blocked. Before a low-pressure fault is triggered a low-pressure warning is signalled.

8.7.6.Fan speed control

Due to the continuous adjustment in the number of fans, the condensing pressure is kept constant depending on the ambient temperature by means of a PI controller. As the condensing pressure at the moment in which

the compressor is switched on rises very fast, the PI controller is superimposed by a P controller with limiting setpoint. This only intervenes if the PI controller is too slow.

8.7.7. Electronic expansion valve control

An electronic expansion valve with PI controller is used to keep the overheating constant. To prevent the maximum operating pressure (MOP) from being exceeded, a P controller is used, which counteracts when the MOP is approached and limits opening of the electronic expansion valve.

8.7.8. Temperature limit monitoring

The temperature of the cold water feed is monitored for a minimum and maximum limit value if the chiller is switched on (pump is running). If the limit value is exceeded or the minimum is not reached, an alarm is triggered with time delay, which switches off the chiller.

8.7.9. Group fault alarm

A group fault alarm is triggered if an alarm occurs. All alarms are included in the group fault, but not the warnings. The group fault signalling relay has a floating changeover contact and is energised in fault-free operation, in order to ensure wire break monitoring.

8.8. Execution types

Basically, you can choose between two types of construction:

8.8.1. ECO mode

The default setting of the Compact-Line provides for operation in ECO mode ("Run" parameter is set to "0"). As a result, the increase in fan speed reduces the condensing pressure to the minimum necessary value in the respective operating point – the electrical power consumption of the overall system is limited to a minimum.

8.8.2. Comfort mode

In case of strict sound emission requirements the fan speed can be reduced to the minimum necessary value in the respective operating point and sound power level limited to a minimum. To do this the "Run" parameter must be set to "1". As a result of the lower air flow rate a reduced output of around 3% is to be expected.

The optimised parameter list for your application is enclosed with the unit.

9. Cleaning

9.1. Air filter mat

To maintain high performance the optional air filter mat (**3.19 Air filter mat**) must be checked for contamination at least once a month. The correct air filter mats can be ordered at any time as an original spare part – please contact our KKT chillers Service Team (**Contact details**).

9.2. Condenser

To maintain high performance, the Microchannel heat exchanger should be cleaned when visibly soiled, or at least once a year. For this purpose, disconnect the unit from the power supply and remove the service plates as well as the condenser protection grid (plates 3 and 5, see chapter **1.2 Elements**). Remove first any coarse dirt particles from the outside with a commercial vacuum cleaner. Then carefully rinse the Microchannel heat exchanger from the inside against the air flow direction with warm tap water. Then clean

with a wet vacuum cleaner until the surface is dry again. For versions with water-cooled condenser see Complete cleaning of the cold water circuit.

9.3. Water filter

If the existing water quality (dirt load) Chapter 2.17 Water quality as well as the required water circulation quantity differ, a water filter must be used. (3.23 *Filter assembly group coolant circuit*) It must be checked for contamination at least once a month. The appropriate filter unit can be ordered as an original spare part at any time – please contact our KKT chillers Service Team for this (*Contact details*).

9.4. Complete cleaning of the cold water circuit

Due to the complexity and diversity of the possible external materials, we recommend that the complete cleaning of the cold water circuit only be carried out by qualified personnel – please contact our KKT chillers Service Team (*Table 1 Contact details*).

10. Service

All service work may only be carried out by properly trained, competent personnel.

10.1. Maintenance

Reliable operation and a long service life for the entire system can be guaranteed by proper maintenance.

The purpose of the maintenance is:

- to ensure that the machine operates reliably and without unexpected failures
- to plan further service work in order to minimise downtimes

An overview of the maintenance intervals as recommended by the VDMA is given in *Appendix III*. In addition, the national regulations of the respective installation site must be followed.

Please note that the points listed represent the minimum maintenance required. By increased monitoring, system reliability can be enhanced. Please contact our service department at any time about maintenance quotations / service agreements.

10.2. Fault correction

Troubleshooting and fault correction instructions are given in *Appendix II*.

Our technical customer service can be reached around the clock and will assist you with all service matters (maintenance, repairs, spare parts, etc.):

Service Team Europe

T +49 9228 9977 7190

E service@kkt-chillers.com

W www.kkt-chillers.com

Service Team USA

TF +1 866 517 6867

E techsupport@kkt-chillersusa.com

W www.kkt-chillers.com

Service Team East Asia


S +86 512 6790 3091



10.3. Spare parts

To ensure that the performance of your chiller is not impaired, we recommend that you only use original spare parts purchased from KKT chillers. In this way you ensure the reliability and quality of the machine. For spare parts enquiries, please contact our KKT chillers Service Team spareparts@kkt-chillers.com or (*Contact details*).

11. Taking out of service

	<p>ATTENTION! Decommissioning must only be carried out by professional and qualified technicians.</p> <p>They must also be familiar with the local regulations.</p>
---	---

For safety-relevant instructions regarding possible residual energy, please refer to **Chapter 4.3 Residual energy**.

11.1. Draining

If the system is filled and there is a risk of frost, suitable measures must be taken to protect the liquid from frost. The complete cold water circuit must be fully drained before any lengthy stoppage of the unit. Do this as follows:

- Drain the tank via the drain cock provided
- (when doing so, close the shut-off valve leading the level sensor)
- Drain the evaporator via the drain cock provided
- Drain the pump using the drain plug provided

The drain cock is marked on the unit by the symbol in **Figure 23**.





Figure 23: Marking of the drain cock

The position of the drain plug is shown in **Figure 25**.

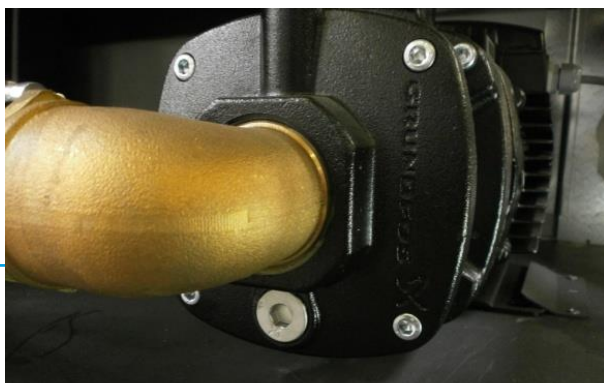


————— Drain plug
(Allen key 10 mm)

Figure 24: Position of the pump drainage (horizontal type)

To prevent frost damage the cold water circuit must then be flushed with a mixture of water and 40 % by vol Antifrogen-N (or equivalent).

12. Recycling

	ATTENTION! Dismantling must be carried out by professional and qualified technicians. Water and refrigerant pipes are pressurised! They must also be familiar with the local regulations.
---	--

All parts (e.g. refrigerant, oil, glycol, metal, electronics, battery etc.) must be recycled, reused or disposed of. Please note and follow all local and national regulations and if necessary contact your local waste management agency.

A specialised disposal company must be contracted to dispose of these wastes. They issue a proof of disposal which must be archived. The chiller can be returned to KKT chillers for disposal. Please contact our KKT chillers Service Team for details (**Contact details**).

13. Products, solutions and services

Apart from the Compact-Line, KKT chillers also offers other products, solutions and services which are not described in this document. For more information, visit our homepage <http://www.kkt-chillers.com> or contact your KKT chillers contact – we look forward to hearing from you!

I. Menu navigation



Attention: The parameters specified here serve only as an example. For the parameterization relevant to your chiller, please refer to the parameter set included in the unit.

Main menu		
Information	Information	Measuring
Settings	Energy meter	Pressure pump 1 bar
Alarm menu	Operating hours	Y pump 1 %
Control Panel	Digital inputs	Pressure pump 2 bar
Software update	Digital outputs	Y pump 2 %
Datalog export	Analogue inputs	Pressure KW (VP) bar
Datalog stop	Analogue outputs	Press exp.tank bar
	Software status	Tank pressure bar
	Test point 1	Tank pressure %
	Error memory	Temp. inlet (VP) °C
	Energy meter	Temp. outlet °C
		Y compressor bar
		Y hot gas BP °C
		Temp. outlet 2 bar
		Y valve coldwater °C
		Temp cooling water inlet °C
		High pressure (HP) K
		Setpoint bar
		Condensing temp K
		Y fan %
		Low pressure (LP) bar
		Evaporating temp °C
		Suction gas temp °C
		Superheating K
		Y expansions valve %
		Ambient temperature °C
		Temp. inlet EES °C
		Temp. system return °C
		Y fan EES %
		Y valve EES %
		Conductivity µS/cm

Main menu
Information
Settings
Alarm menu
Control Panel
Software update
Datalog export
Datalog stop

Information
Measuring
Status
Energy meter
Operating hours
Digital inputs
Digital outputs
Analogue inputs
Analogue outputs
Software status
Test point 1
Error memory

Status
DI resetswitch
DI remote start 1
DI remote start 2
DI phase monitoring
DI mpcb Pump 1
DI flow pump 1
DI mpcb Pump 2
DI flow pump 2
DI mpcb compressor 1
DI mpcb compressor 2
DI mpcb compressor 3
DI mpcb compressor 4
DI high-pr. limiter
DI mpcb fan 1
DI fault fan 1
DI mpcb fan 2
DI fault fan 2
DI mpcb tank heating
DI STP tank heating
DI mpcb pump freec.
DI mpcb freecool.fan
DI fault freecool.fan
DO pump 1
DO pump 2
DO compressor 1
DO compressor 2
DO compressor 3
DO compressor 4
DO EV hot gas bypass
DO tank heating
DO fan 1
DO fan 2
DO tank heating
DO pump freecooler
DO fan freecooler
DO EV demineralisation
DO control range
DO collective fault

Main menu
Information
Settings
Alarm menu
Control Panel
Software update
Datalog export
Datalog stop

Information
Measuring
Status
Energy meter
Operating hours
Digital inputs
Digital outputs
Analogue inputs
Analogue outputs
Software status
Test point 1
Error memory

Energy meter	
U L1 N	V
U L2 N	V
U L3 N	V
I L1	A
P L1 N	kW
Total real energy	kWh
Operating hours	h
Frequency	Hz

Operating hours	
DO pump 1	hour
DO pump 3	hour
DO compressor 1	hour
DO compressor 2	hour
DO compressor 3	hour
DO compressor 4	hour
DO tank heating	hour
DO pump ESS	hour

Main menu
Information
Settings
Alarm menu
Control Panel
Software update
Datalog export
Datalog stop

Information
Measuring
Status
Energy meter
Operating hours
Digital inputs
Digital outputs
Analogue inputs
Analogue outputs
Software status
Test point 1
Error memory

Digital inputs
DI1 clip 1,2
DI1 clip 3,4
DI1 clip 5,6
DI1 clip 7,8
DI1 clip 9,10
DI2 clip 1,2
DI2 clip 3,4
DI2 clip 5,6
DI3 clip 1,2
DI3 clip 3,4
DI4 clip 1,2
DI4 clip 3,4
DI4 clip 5,6
DI4 clip 7,8
DI5 clip 1,2
DI5 clip 3,4
DI5 clip 5,6
DI5 clip 7,8
DI6 clip 1,2
DI6 clip 3,4
DI6 clip 5,6
ES1 clip 9,10
IFPDI1 clip 1,2

Main menu
Information
Settings
Alarm menu
Control Panel
Software update
Datalog export
Datalog stop

Information
Measuring
Status
Energy meter
Operating hours
Digital inputs
Digital outputs
Analogue inputs
Analogue outputs
Software status
Test point 1
Error memory

Analogue inputs	
AI1 clip 1,2	Inc.
AI1 clip 1,4	Inc.
AI1 clip 1,6	Inc.
AI1 clip 1,8	Inc.
AI1 clip 1,10	Inc.
AI1 clip 1,12	Inc.
AI1 clip 1,14	Inc.
AI1 clip 1,16	Inc.
AIO1 clip 1,2	Inc.
AIO2 clip 1,2	Inc.
AIO2 clip 5,6	Inc.
IFPAI1 clip 1,2	Inc.
IFPAI2 clip 3,4	Inc.
IFPAI3 clip 5,6	Inc.
AI1 clip 1,3	Inc.
AI1 clip 1,5	Inc.
AI1 clip 1,7	Inc.
AI1 clip 1,9	Inc.
AI1 clip 1,11	Inc.
AI1 clip 1,13	Inc.
AI1 clip 1,15	Inc.
AI1 clip 1,17	Inc.
AIO1 clip 1,2	Inc.
AIO2 clip 1,2	Inc.
AIO2 clip 5,6	Inc.
IFPAI1 clip 1,2	Inc.
IFPAI2 clip 3,4	Inc.
IFPAI3 clip 5,6	Inc.

Analogue outputs	
AO1 clip 1,2	Inc.
AO1 clip 3,4	Inc.
AO1 clip 5,6	Inc.
AO1 clip 7,8	Inc.
AIO1 clip 3,4	Inc.
AIO2 clip 3,4	Inc.
AO1 clip 1,2	Inc.

Main menu
Information
Settings
Alarm menu
Control Panel
Software update
Datalog export
Datalog stop

Information
Measuring
Status
Energy meter
Operating hours
Digital inputs
Digital outputs
Analogue inputs
Analogue outputs
Software status
Test point 1
Error memory

Software status		
Display		3.24
Controller ES910		3.24

Test point 1		
Test point 1		Analogue
Test point 2		Analogue
Test point 3		Analogue
Test point 4		Analogue
Test point 1		Digital
Test point 2		Digital
Test point 3		Digital
Test point 4		Digital

Error memory		
123-16.05.19 12:37 Mem		
123-16.05.19 12:37 Act		

Main menu
Information
Settings
Alarm menu
Control Panel
Software update
Datalog export
Datalog stop

Settings
Limit monitoring
Control
Control pump
Control compressor
Chiller configuration
Sensor configuration

Limit monitoring		
Limit temperature cooling water		
Time delay	5	min
Outlet temp.		
Running delay	15	min
Outlet max STOP	32.0	°C
Outlet max warning	30.0	°C
Outlet min STOP	-20.0	°C
Outlet temp. 2		
Running delay	5	sec
Outlet max STOP	34.0	°C
Outlet max warning	32.0	°C
Outlet min STOP	15.0	°C
Limit tank pressure		
Tank max level	125	mbar
Tank min level warning	105	mbar
Tank min level STOP	80	mbar
Hysteresis	2	mbar
Pressure exp. vessel		
Min warning	2.5	bar
Min Stop	2.0	bar
Limit pressure water		
Time delay start	20	sek
Time delay running	10	sek
Pressure cooling water (VP)		
Min warning	0.5	bar
Min STOP	0.1	bar
Differential pressure		
Outlet max STOP	2.0	bar
Pressure pump 1		
Outlet max STOP	10.0	bar
Outlet min warning	2.5	bar
Outlet min STOP	2.0	bar
Pressure pump 2		
Outlet max STOP	10.0	bar
Outlet min warning	2.5	bar
Outlet min STOP	2.0	bar
Conductivity		
Conduc. max. alarm	50	µS/cm
Conduc. max. warning	30	µS/cm

Settings
Limit monitoring
Control
Control pump
Control compressor
Basics
Chiller configuration
Sensor configuration

Control
Thermost. pump start
Control pump 1 pressure
Control pump 2 pressure
Control cold water temperature
Control hot gas bypass
Control cold water valve
Control tank heating
Control EEV superheating
Control condensation
Control cooling water
Control ESS free cooling
Control tank refill
Control conductivity

Thermost. pump start		
Interval	15	min
Time delay	60	sec
Runtime	5	min
Minimum Setpoint	8.0	°C
Hysteresis Maximum	1.0	K
Setpoint	28.0	°C
Hysteresis	1.0	K

Control pump 1 pressure		
Mode VFD	Auto	
Manual VFD	50	%
Setpoint	3.5	bar
P-band	15.0	bar
Ti Int time	10	sec
Td Diff time	0	sec

Control cold water temperature		
Setpoint (water)	20.0	°C
Hysteresis	2.0	K
External release		
Maximum	27.0	°C
Minimum	20.0	°C
Cooling steps compress.		
Y cooling step 1 off	-100	%
Y cooling step 1 on	100	%
Y cooling step 2 off	-50	%
Y cooling step 2 on	50	%
Y cooling step 3 off	-25	%
Y cooling step 3 on	25	%
Y cooling step 4 off	-75	%
Y cooling step 4 on	75	%
Time delay steps	5	sek

Settings
Limit monitoring
Control
Control pump
Control compressor
Basics
Chiller configuration
Sensor configuration

Control
Thermost. pump start
Control pump 1 pressure
Control pump 2 pressure
Control cold water temperature
Control hot gas bypass
Control cold water valve
Control tank heating
Control EEV superheating
Control condensation
Control cooling water
Control ESS free cooling
Control tank refill

Control hot gas bypass		
Start relief	2	sec.
Output control 2point		
Valve OPEN	-20	%
Valve CLOSED	30	%
Continuous output control		
Temp. outlet		
Difference	0.2	K
Proportional band	2.0	K
Ti integration time	50	sec.
Td diff. time	0	sec.
Temp. min	35.0	°C
Opening temp. min	0	%
Temp. max	40.0	°C
Opening temp. max	100	%
Cold water high temp start ass.		
Temp. inlet (VP)		
Valve OPEN	40.0	°C
Valve CLOSED	35.0	°C

Control cold water valve		
Setpoint	32.0	°C
P-band	10.0	K
Ti Int time	100	sec.
Td diff. time	0	sec.

Control tank heating		
Setpoint	8.0	°C
Hysteresis	2.0	K

Control EEV superheating		
Start	No	
Setpoint	12.0	°C
Delay time	60	sec.
Setpoint	6.0	K
P-band	6.0	K
Ti Int time	400	sec.
Td diff. time	0	sec.
MOP		
Application point	10.6	bar
End point	15.6	bar
Opening minimum	100	Inc
Delay start	10	sec.
Delay running	10	sec.

Superheating min	1.5	K
Superheating max	18.0	K
Number of alarms / hour	3	
Start	No	
Opening minimum	10	%
Delay time	60	sec.

Settings
Limit monitoring
Control
Control pump
Control compressor
Basics
Chiller configuration
Sensor configuration

Control
Thermost. pump start
Control pump 1 pressure
Control cold water temperature
Control hot gas bypass
Control cold water valve
Control tank heating
Control EEV superheating
Control condensation
Control cooling water
Control ESS free cooling
Control tank refill
Control conductivity

Control condensation		
Control cooling water		
Model	Eco	
Setpoint eco mode	31.5	bar
Setpoint comfort mode	35.0	bar
P-band	10.0	bar
Ti Int time	100	sec
Td diff. time	0	sec
HP max limit		
Application point	32.0	bar
End point	38.0	bar
Delay time		
Compressor control		
Temp. cooling water inlet		
Temp. < 30°C	12	sec
Temp. < 40°C	18	sec
Temp. > 40°C	25	sec

Control ESS free cooling		
Energy-saving system	AUTO	
Diff.temp. ambient-return	3.0	K
Hysteresis	0.5	K
Delay time	300	sec
Sequence	50	%
P-band	3.0	K
Ti Int time	100	sec
Td diff. time	0	sec
Min. limit		
Setpoint	10.0	°C
P-band	9.0	K
Ti Int time	100	sec
Td diff. time	0	sec

Settings
Limit monitoring
Control
Control pump
Control compressor
Basics
Chiller configuration
Sensor configuration

Control
Thermost. pump start
Control pump 1 pressure
Control cold water temperature
Control cold water temperature
Control hot gas bypass
Control cold water valve
Control tank heating
Control condensation
Control cooling water
Control ESS free cooling
Control tank refill
Control conductivity

Control tank refill		
Valve open	110	mbar
Valve closed	120	mbar
DO EV refill		
Max time open	120	sec.

Control conductivity		
Valve open	20	µS/cm
Valve closed	16	µS/cm
DO EV demineralisation		
Max time open	30	min

Main menu
Information
Settings
Alarm menu
Control Panel
Software update
Datalog export
Datalog stop

Settings
Limit monitoring
Control
Control pump
Control compressor
Basics
Chiller configuration
Sensor configuration

Control pump		
Delay control	15	sec.
After-run time	15	sec.
Pump after-run time	15	sec.
Switch flow sensor		
Delay start	20	sec,
Delay running	10	sec,
Interval switchover		
Weekday	Mo	
Hour	10	
Minute	0	

Main menu
Information
Settings
Alarm menu
Control Panel
Software update
Datalog export
Datalog stop

Settings
Limit monitoring
Control
Control pump
Control compressor
Basics
Chiller configuration
Sensor configuration

Control compressor		
Compressor type	DSH	
Year of construction	2018	
Time between 2 starts	300	sec.
Min timeout	5	sec.
Low pressure warning (LP)		
LP warning (STOP+dP)	0.2	bar
Time delay	30	sec.
LP STOP	7.3	bar
Delay start	60	sec.
Delay running	3	sec.
LP ON (STOP+dP)	1.5	bar
Number of alarms per hour	3	
Time delay	10	sec.
High pressure (HP)		
HP warning ON	42.5	bar
HP warning OFF	40.0	bar
Time delay	10	sec.
HP STOP	43.0	bar
HP off	40.0	bar
Time delay	10	sec.
HP max limit		
Cooling levels OFF	42.0	bar
Cooling levels ON	40.0	bar
HP-LP difference		
Cooling levels OFF	36.8	bar
Cooling levels ON	30.0	bar
Pump out?	No	
Compressor LP OFF	2.5	Bar
Pump out timeout	30	sec.

Basics	
Chiller type	cBox 30
Year of construction	2020
Compressor type	DSH
AI ambient temp.	No

Main menu
Information
Settings
Alarm menu
Control Panel
Software update
Datalog export
Datalog stop

Settings
Limit monitoring
Control
Control pump
Control compressor
Basics
Chiller configuration
Sensor configuration

Chiller configuration	
Number of compressors	1
Heat exchanger	Steel
Thermost. Pump start	No
Pump 1?	Consumer
Pump 1 VFD?	No
Pump 1 flow?	No
Pump 2?	No
Pump 2 VFD?	No
Pump 2 flow?	No
Control pressure	Outlet
Cooling medium	Water
Condenser valve 2	No
Control hot gas bypass	No
Tank present?	Yes
Tank heater?	No
Control tank refill	No
AI press exp.tank	No
AI temp. inlet (VP)	Yes
AI temp outlet	Yes
Temperature control	Outlet
AI temp outlet 2	No
Valve circuit 2	Cooling
Control cooling water	No
Control conductivity	No
DI phase monitoring	No
DI remote control 2	No
Energy-saving system	No
Energy meter	No
Relay D04 (1.2)	Temp range

Main menu
Information
Settings
Alarm menu
Control Panel
Software update
Datalog export
Datalog stop

Settings
Limit monitoring
Control
Control pump
Control compressor
Basics
Chiller configuration
Sensor configuration

Sensor configuration		
AI pump pressure 1		
Measuring 4 mA	-0.5	bar
Measuring 20 mA	10.0	bar
AI pump pressure 2		
Measuring 4 mA	-0.5	bar
Measuring 20 mA	10.0	bar
AI press. cold water evaporator		
Measuring 4 mA	-0.5	bar
Measuring 20 mA	10.0	bar
AI tank pressure		
Measuring 4 mA	0	mbar
Measuring 20 mA	200	mbar
AI press. exp. vess.		
Measuring 4 mA	0.0	bar
Measuring 20 mA	10.0	bar
AI high pressure		
Measuring 4 mA	0.0	bar
Measuring 20 mA	60.0	bar
AI low pressure		
Measuring 4 mA	0.0	bar
Measuring 20 mA	40.0	bar
AI conductivity		
Measuring 4 mA	0	µS/cm
Measuring 20 mA	1000	µS/cm
AI airflow		
Measuring 4 mA	0	Pa
Measuring 20 mA	1000	Pa
AO temperature		
Output 0 V	0.0	°C
Output 10 V	50.0	°C
AO pressure		
Output 0 V	0.0	bar
Output 10 V	10.0	bar
AO conductivity		
Output 0 V	0	µS/cm
Output 10 V	1000	µS/cm

Main menu
Information
Settings
Alarm menu
Control Panel
Software update
Datalog export
Datalog stop

Alarm menu
AI pump pressure 1
AI pump pressure 2
AI cold water pressure evaporator
AI press. exp. vess.
AI tank pressure
AI temp. inlet (VP)
AI temp outlet
AI temp outlet 2
AI cool. water temp. on
AI cool. water temp. off
AI cool. water press. on
AI cool. water press. off
AI high pressure
AI low pressure
AI suction gas temp
AI ambient temp.
AI freecooler inlet temp.
AI temp. system return
AI coding resistor
AI conductivity
AI air flow
DI emergency stop
DI phase monitoring
DI mpcb Pump 1
Flow, start pump 1
DI mpcb Pump 2
Flow, start pump 2
Flow, pump 21 running
Flow, pump 1 running
Outlet temp. 1 max STOP
Outlet temp. 1 min STOP
Outlet temp. 2 max STOP
Outlet temp. 2 min STOP
Coldwater VP press STOP
Coldwater VP press STOP
Press. exp. vess. max stop
Press. exp. vess. min stop
Min tank level STOP
Press pump 1 max STOP
Press pump 1 min STOP
Press pump 2 max STOP
Press pump 2 min STOP

Temp. cooling water on max STOP
Temp. cooling water on min STOP
Temp. cooling water on max STOP
Temp. cooling water on min STOP
Press. cooling water on max STOP
Press. cooling water on min STOP
Conductivity max alarm
DI high-pr. limiter
DI mpcb compressor 1
DI mpcb compressor 2
DI mpcb compressor 3
DI mpcb compressor 4
Superheating
LP STOP
LP STOP 3x
HP STOP
DI mpcb fan 1
DI fan 1 fault
DI mpcb fan 2
DI fan 2 fault
DI mpcb tank heating
DI STP tank heating
DI mpcb pump freec.
DI mpcb freecool.fan
DI fault freecool.fan
EV refill time limit
Outlet temp. 1 max warn.
Outlet temp. 2 max warn.
Coldwater press. VP warning
Press. exp. vess. min warning
Min tank level warning
Pressure pump 1 min warning
Pressure pump 2 min warning
Temp. cold water on max warning
Press. cold water on max warning
Diff. press. cold water min warning
LP warning
HP warning
Conductivity max warning
Coding changed

Main menu
Information
Settings
Alarm menu
Control Panel
Software update
Datalog export
Datalog stop

Control Panel
Language
Settings
IP address
Serial number
Save parameters
Load parameters
Password

Language
Deutsch
English
Français
Română
Čeština
Magyarul
Dansk
Eesti
Português
Lietuviškai
Polski
Slovenščina
Svenska
Suomi
Türkçe
Español
Hrvatski
Italiano
Nederlands
Slovenský

Settings	
Unit	Metric
Remote maintenance	No
DHCP	Off
GLT data take-over	Auto

IP address
IP
Subnetmask
Broadcast
Gateway

Main menu
Information
Settings
Alarm menu
Control Panel
Software update
Datalog export
Datalog stop

Control Panel
Language
Settings
IP address
Serial number
Save parameters
Load parameters
Password

Serial number
Entry of serial number 9000-0000

Result
Saving to controller:OK Saving to USB:OK

Load parameters
XXXXXXXXX.par

Password
Enter digits: 0 0 0 0 Data access Work

Main menu
Information
Settings
Alarm menu
Control Panel
Software update
Datalog export
Datalog stop

Datalog export
Date Time The files were copied successfully

II. Troubleshooting

Error code	Display view	Type of message	Message description	Cause of the message	Troubleshooting	Reaction of the chiller
111	HP warning	Group warning	Condensation pressure has exceeded the warning limit	Condensation pressure threatens to run against the design limit of the high pressure stop,	Clean the condenser and filter. Check the function of the fan. Check the cooling water circuit. Install the cover panels.	A compressor is switched off if the number of compressors is > 1. After pressure reduction, the compressor switches on again. All other components continue to run. Warning is saved. Manual reset.
121	LP warning	Group warning	Evaporation pressure has fallen below the warning limit	Evaporating pressure approaches the low pressure stop limit	Check liquid flow. Check the function of the expansion valve. Check the refrigerant level.	A compressor is switched off if the number of compressors is > 1 (delayed from v. 2.60). After pressure increase, the compressor switches on again. All other components continue to run. Warning is not saved, Automatic reset.
123	Compr.Pump Out Warn	Group warning	When the EEV closes, the low pressure does not drop below the set value.	EEV does not close, MV hot gas bypass leaks, refrigerant circuit leaks.	Check EEV, check MV hot gas bypass, check refrigerant circuit for leaks.	Compressor shuts down after the set time. 1x automatic reset. The compressor is blocked after the second attempt (fault stop).
131	Superheating	Group warning from Version 2.71 previously fault message AL171				
151	HP STOP	Group fault alarm	Condensation pressure is outside the allowable range.	Waste heat from the chiller circuit cannot be dissipated.	Clean the condenser and filter. Check the function of the fan. Check the cooling water circuit. Install the cover panels.	All compressors shut down. (time-delayed from V. 2.60) All other components continue to run. Alarm is saved. Manual reset.

Error code	Display view	Type of message	Message description	Cause of the message	Troubleshooting	Reaction of the chiller
161	LP STOP	Group fault message	Pressure has fallen below the minimum allowable pressure on the intake side of the compressor (low pressure side).	Liquid flow through the evaporator is too low. Refrigerant loss. Faulty function of the expansion valve. Faulty function of the LP sensor.	Check liquid flow. Check the function of the expansion valve. Check the refrigerant level.	After the compressor is started, the low pressure is bridged. All compressors then switch off. When the pressure increases, the compressors switch on again. During operation, all compressors switch off with a time delay. They switch on again when the pressure increases. The compressors restart up to 3x, after which alarm AL162 is triggered. All other components continue to run. Alarm is saved, Manual reset.
162	LP STOP 3x	Group fault alarm	The minimum permissible pressure on the suction side of the compressor (low pressure side) was 3 times lower.	S.h. LP STOP	S.h. LP STOP	Compressor no longer starts automatically after the 3rd low pressure STOP AL161, All other components continue to run. Alarm is saved. Manual reset.
163	ND STOP 3x	Group fault alarm	After closing the EEV, the low pressure does not drop below the set value.	EEV does not close, MV hot gas bypass leaks, refrigeration circuit leaks.	Check EEV, Check MV hot gas bypass, Check refrigeration circuit for leaks.	Compressor switches off after set time. After the warning, the compressor is blocked. Manual reset.
171	Superheating	Group fault alarm message from Version 2.70 then warning WA131	The superheat limit has been exceeded or undercut. vBoxX Min; cBoxX Min and Max.	Superheat too low or too high	0	only display if alarm occurred 3 times, alarm is saved, 2x automatic reset, then manual reset.
301	Outlettemp. 1 max warning	Group warning	The outlet temperature of the chiller circuit is approaching the upper design limit.	Thermal overload, No refrigeration.	Check refrigerating capacity, check the function of the refrigeration circuit	All components continue to run, Warning is saved, Manual reset.
302	Temp. outlet 2 Max Warn	Group warning	Outlet temperature of the refrigerant circuit is approaching the upper limit.	Thermal overload, no cooling, cooling valve does not work; cooling valve configured incorrectly.	Check cooling output, check function of the refrigerant circuit, check cooling valve, check configuration of cooling valve.	All components continue running, warning is saved, manual reset.
304	Temp. cooling water On Max Warn	Group warning	Inlet temperature of the cooling water circuit is approaching the upper limit.	Cooling water circuit does not work; no cooling water is supplied.	Check cooling water generation; check cooling water circuit, pump, check flow	0

Error code	Display view	Type of message	Message description	Cause of the message	Troubleshooting	Reaction of the chiller
312	Min tank level warning	Group warning	Level in the tank is approaching the minimum design limit.	Level in the tank is too low, level sensor in the tank is defective.	Fill tank, Check the function of the tank sensor in the tank	All components continue to run, Alarm is saved, Manual reset.
313	EV refill time limit	Group fault alarm	The solenoid valve of the tank refill does not close within the specified time.	The freshwater supply is interrupted.	Check the function of the solenoid valve tank refill. Open the shut-off devices integrated in the supply line. Check the supply line for leakage.	Solenoid valve for tank refill closes. All other components continue to run, Alarm is saved, Manual reset.
321	Coldwater press warning	Group warning	The refrigerant pressure at the evaporator is approaching the minimum or maximum limit	External slide is closed, filter soiled, air in the system.	Open external slide valve, clean the filter, vent the system.	All components continue to run, alarm is saved, manual reset.
325	Pressure exp. Vess. min. warn.	Group warning	Suction pressure of the pump is below the setpoint value	Water quantity in the closed pipe system too small, pressure in the expansion tank incorrectly set, expansion vessel defective.	Refill water	All components continue to run, alarm is saved, manual reset.
326	Press pump 1 min warning	Group warning	The pump's pressure is approaching the minimum limit	Flow rate too high, chiller resistance too low, Air in the system	Reduce flow rate, increase chiller resistance, vent the system	All components continue to run, Alarm is saved, Manual reset.
327	Press pump 2 min warning	Group warning	The pump's pressure is approaching the minimum limit	Flow rate too high, chiller resistance too low, Air in the system	Reduce flow rate, increase chiller resistance, vent the system	All components continue to run, Alarm is saved, Manual reset.
328	Pressure cooling water On Min Warn	Group warning	The cooling water inlet pressure at the heat exchanger is too low	0	0	0
329	Diff. pressure cooling water Min Warn	Group fault alarm	Differential pressure cooling water inlet - cooling water outlet too low	0	0	0
331 334	Conduc. max. STOP Conduc. max. alarm	Group fault alarm	Conductivity exceeds maximum design limit.	Conductivity too high.	Check limit design value: If available: Check DI cartridge, Check flow through DI cartridge.	All components continue to run, Alarm is saved, Manual reset.

Error code	Display view	Type of message	Message description	Cause of the message	Troubleshooting	Reaction of the chiller
332 335	Conductivitymaxwarn.	Group warning	Conductivity is approaching maximum design limit.	Conductivity too high.	Check the limit default. If installed: Check DI cartridge, Check flow through DI cartridge.	All components continue to run, Alarm is saved, Manual reset.
333 336	EV demin. time limit	Group warning	The demineralization solenoid valve does not close within the specified time period.	DI cartridge worn. No flow through DI cartridge. Switch-off point set too high.	Replace DI cartridge. Check flow through the DI cartridge. DI cartridge worn.	Demineralization solenoid valve closes. All other components continue to run, Alarm is saved, Manual reset.
351	Outlettemp. 1 max STOP	Group fault alarm	Maximum outlet temperature cold water circuit 1 exceeded.	No refrigeration, Thermal overload.	Check function of the chiller circuit, Check installed heat load.	Chiller switches off immediately. Alarm is saved. Manual reset.
352	Outlettemp. 1 min STOP	Group fault alarm	Outlet temperature cold water circuit 1 is below the minimum.	Check function of the tank heater, check setpoint setting, ambient temperature too low.	Check tank heater function, check setpoint, increase ambient temperature.	Chiller switches off immediately, (Until V 2.60) (Compressors switch off immediately). Pumps deactivate via follow-up time, this would be correct) Alarm is saved, Manual reset.
353	Temp. outlet2 Max STOP	Group fault alarm	Maximum outlet temperature cold water circuit 2 undercut.	No cooling, valve of circuit 2 does not open thermal overload.	Check cooling circuit function, check water circuit 2 function (cooling valve), Check circuit 2 configuration, check installed thermal load.	0
354	Temp. outlet 2 Min STOP	Group fault alarm	Minimum outlet temperature cold water circuit 2 undercut.	Check tank heating function, check setpoint, ambient temperature too low.	Check tank heating function, check setpoint, increase ambient temperature.	
356	Temp. cooling water On Max STOP	Group fault alarm	Maximum inlet temperature Cooling water circuit exceeded	Cooling water circuit does not work, no cooling water is provided.	Check cooling water production; check cooling water circuit, check pump, flow.	System switches off immediately
357	Temp. cooling water On Min STOP	Group fault alarm	Minimum inlet temperature Cooling water circuit undercut	Cooling water circuit does not work, the water provided is too cold, ambient temperature too low.	Check cooling water production; check cooling water circuit, check pump, flow.	System switches off immediately
361	Min tank level STOP	Group fault alarm	Level in tank is below the minimum.	Level in the tank is too low, Level sensor soiled or defective	Fill tank, Check the function of the tank sensor.	Chiller switches off immediately. Alarm is saved. Manual reset.

Error code	Display view	Type of message	Message description	Cause of the message	Troubleshooting	Reaction of the chiller
371	Coldwater press STOP	Group fault alarm	Cold water pressure at the evaporator is too low.	External slide is closed, Filter soiled, Air in the system.	Open external slide, Clean filter, Vent the system.	Compressors switch off immediately. Pump 1 & 2 consumer pump Pumps continue to run. Pump 1 = Consumer pump Pump 2 = Evaporator pump Pump 1 continues to run. Pump 2 switches off. Pump 1 = Consumer pump Pump 2= Redundant The required pump continues to run. Alarm is saved, manual reset.
379	Pr.exp.vess.min Stop	Group fault alarm	Pump intake pressure is below the set setpoint	Diaphragm expansion vessel defective Quantity of water in the closed pipe system is too low.	Top-up water	Chiller switches off immediately. Alarm is saved. Manual reset.
381	Press pump 1 max STOP	Group fault alarm	Pressure of the liquid outlet pressure too high	External slide is closed, Filter soiled,	Open external gate valve, clean filter, check overflow valve setting	Pump switches off immediately. Alarm is saved. Manual reset.
382	Press pump 1 min STOP	Group fault alarm	Pressure of the liquid outlet pressure too low	Flow rate too high, chiller resistance too low, Air in the system	Reduce flow rate, increase chiller resistance, vent the system	Pump switches off immediately. Alarm is saved. Manual reset.
385	Pump pressure 2 Max STOP	Group fault alarm	Refrigerant outlet pressure is too high.	External slide valve closed; filter soiled.	Open external slide valve, clean filter, check the overflow valve setting	Pump shuts down immediately. Alarm is saved, manual reset.
386	Pump pressure 2 Min STOP	Group fault alarm	Refrigerant outlet pressure is too low.	Flow rate too high, chiller resistance too low, air in the system.	Reduce the flow rate, increase the chiller resistance, vent system	Pump shuts down immediately. Alarm is saved, manual reset.
389	Pressure cooling water On Max STOP	Group fault alarm	Pressure cooling water inlet at the heat exchanger is too high	0	0	0
390	Pressure cooling water On Min STOP	Group fault alarm	Pressure cooling water inlet at the heat exchanger is too low	0	0	0
501	Al temp. inlet (VP)	Group warning from Version 2.60	Sensor defective, sensor break or sensor short-circuit	Sensor defective, sensor break or sensor short-circuit	Check electrical connections of the sensor, check sensor using the characteristic curve	Alarm is saved, (From V.2.60) Manual reset.

Error code	Display view	Type of message	Message description	Cause of the message	Troubleshooting	Reaction of the chiller
502	AI temp outlet	Group fault alarm from Version 2.60	Sensor defective, sensor break or sensor short-circuit	Sensor defective, sensor break or sensor short-circuit	Check electrical connections of the sensor, check sensor using the characteristic curve	All components continue to run. If the temp. inlet sensor is functional, it is switched to this sensor and the setpoint is increased by 6K. Alarm is saved, (From V.2.60) Manual reset.
503	AI temp outlet 2	Group fault alarm from Version 2.60	Sensor defective, sensor break or sensor short-circuit	Sensor defective, sensor break or sensor short-circuit	Check electrical connections of the sensor, check sensor using the characteristic curve	Pump 1 and compressor continue to run, Cold water circuit 2 is blocked, Alarm is saved, (From V.2.60) Manual Reset.
504	AI temp. system return	Group fault alarm from Version 2.60	Measured value of the analogue input outside the valid measuring range	Sensor defective, sensor break or sensor short circuit	Check the electrical connections of the sensor, check sensor using the characteristic curve	Free cooling is blocked. All other components continue to run, alarm is saved, (from V.2.60) manual reset.
505	AI ambient temp.	Group fault alarm from Version 2.60	Measured value of the analogue input outside the valid measuring range	Sensor defective, sensor break or sensor short circuit	Check the electrical connections of the sensor, check sensor using the characteristic curve	Free cooling is blocked. All other components continue to run, alarm is saved, (from V.2.60) manual reset.
506	AI Freecooler inlet	Group fault alarm from Version 2.60	Measured value of the analogue input outside the valid measuring range	Sensor defective, sensor break or sensor short circuit	Check the electrical connections of the sensor, check sensor using the characteristic curve	Free cooling is blocked. All other components continue to run, alarm is saved, (from V.2.60) manual reset.
511	AI cold water press	Group fault alarm from Version 2.60	Measured value of the analogue input outside the valid measuring range	Sensor defective, sensor break or sensor short-circuit	Check electrical connections of the sensor, check sensor using the characteristic curve	Alarm is saved, (From V.2.60) Manual reset.
512	AI press. exp. vess.	Group fault alarm from Version 2.60	Measured value of the analogue input outside the valid measuring range	Sensor defective, sensor break or sensor short-circuit	Check electrical connections of the sensor, check sensor using the characteristic curve	Alarm is saved, (From V.2.60) Manual reset.

Error code	Display view	Type of message	Message description	Cause of the message	Troubleshooting	Reaction of the chiller
513	AI pump pressure 1	Group fault alarm from Version 2.60	Measured value of the analogue input outside the valid measuring range	Sensor defective, sensor break or sensor short-circuit	Check electrical connections of the sensor, check sensor using the characteristic curve	Pump 1 & 2 = Consumer pump - Pump 1 switches off, - Pump 2 and compressor continue to run. Pump 1 = Consumer pump Pump 2 = Evaporator pump Chiller switches off. Pump 1 = Consumer pump Pump 2 = Redundant - Pump 1 switches off, - Pump 2 switches on. Alarm is saved, (From V.2.60) Manual reset.
514	AI pump pressure 2	Group fault alarm from Version 2.60	Measured value of the analogue input outside the valid measuring range	Sensor defective, sensor break or sensor short-circuit	Check electrical connections of the sensor, check sensor using the characteristic curve	Pump 1 & 2 = Consumer pump - Pump 2 switches off, - Pump 1 and compressor continue to run. Pump 1 = Consumer pump Pump 2 = Evaporator pump Chiller switches off. Alarm is not recognised, No reaction up to V 2.58 - Pump 2 and compressor switch off - Pump 1 run until outlet temp. max. stop continues. From V 2.60 Pump 2 = Consumer pump Pump 1 = Redundant - Pump 2 switches off, - Pump 1 switches on. Alarm is saved, (from V.2.60) Manual reset.
515	AI tank pressure	Group fault alarm from Version 2.60	Measured value of the analogue input outside the valid measuring range	Sensor defective, sensor break or sensor short-circuit	Check electrical connections of the sensor, check sensor using the characteristic curve	Chiller switches off immediately, Alarm is saved, (From V.2.60) Manual reset.
521	AI high pressure	Group fault alarm from Version 2.60	Measured value of the analogue input outside the valid measuring range	Sensor defective, sensor break or sensor short-circuit	Check electrical connections of the sensor, check sensor using the characteristic curve	Pumps continue to run, Alarm is saved, (From V.260) Manual reset.
522	AI low pressure	Group fault alarm from Version 2.60	Measured value of the analogue input outside the valid measuring range	Sensor defective, sensor break or sensor short-circuit	Check electrical connections of the sensor, check sensor using the characteristic curve	Pumps continue to run, Compressor (KK) stops immediately Alarm is saved, (From V.260) Manual reset.

Error code	Display view	Type of message	Message description	Cause of the message	Troubleshooting	Reaction of the chiller
523	AI suction gas temp	Group fault alarm from Version 2.60	Measured value of the analogue input outside the valid measuring range	Sensor defective, sensor break or sensor short-circuit	Check electrical connections of the sensor, check sensor using the characteristic curve	Pumps continue to run, Compressor (KK) stops immediately Alarm is saved, (From V.260) Manual reset.
526	AI cool. water temp.	Group fault alarm from Version 2.60 Should be set to Warning, since only display	Measured value of the analogue input outside the valid measuring range	Sensor defective, sensor break or sensor short-circuit	Check electrical connections of the sensor, check sensor using the characteristic curve	Cooling water circuit is blocked. Refrigeration circuit goes to high pressure fault. Alarm is saved, (From V.2.60) Manual reset.
527	AI Temp. cooling water off	Group warning	Measured value of the analogue input outside the valid measuring range	Sensor defective, Sensor break or sensor short circuit	Check the electrical connections of the sensor, Testing the sensor on the basis of the sensor characteristic curve	
528	AI Pressure cooling water on	Group warning	Measured value of the analogue input is outside the valid measuring range	Sensor defective, sensor break or sensor short circuit	Check the electrical connections of the sensor, check the sensor using the sensor characteristic curve	
529	AI Pressure cooling water off	Group warning	Measured value of the analogue input is outside the valid measuring range	Sensor defective, sensor break or sensor short circuit	Check the electrical connections of the sensor, check the sensor using the sensor characteristic curve	
531	AI conductivity	Group fault alarm from Version 2.60	Measured value of the analogue input is outside the valid measuring range	Sensor defective, sensor break or sensor short circuit	Check the electrical connections of the sensor, check the sensor using the sensor characteristic curve	all components continue to run EV demineralization closes. Alarm is saved, (From V.2.60) Manual reset.
591	AI coding resistor	not in group fault alarm, omitted from Version 2.60	Coding resistor is missing	Coding resistor is missing	Check coding resistor	Chiller only continues to run with one compressor. Manual rest. (Up to V. 2.59)
592	Coding changed	Group fault alarm, omitted from Version 2.60	Coding error	The coding resistor measures a different encoding since the last switch-on (number of compressors)	Coding resistor defective, not connected, check the contact	Chiller only continues to run with one compressor. Alarm is saved. Manual reset. (Up to V. 259)
602	DI phase monitoring	Group fault alarm from Version 2.60	Phase monitoring has tripped	Error in relation to phase sequence, phase failure, undervoltage and asymmetry	Check feed	Chiller switches off immediately. Alarm is saved, (From V.2.60) Manual reset.

Error code	Display view	Type of message	Message description	Cause of the message	Troubleshooting	Reaction of the chiller
611	DI mpcb Pump 1	Group fault alarm	Motor protection switch has tripped	Motor current above the permissible range, Motor runs only on two phases, direction of rotation, poor contact at clip points, Winding fault, earth fault, rotor blocked.	Check the motor power consumption, check the operating point, check the electrical connection of the components	<p>Pump 1 & 2 = Consumer pump</p> <ul style="list-style-type: none"> - Pump 1 switches off, - Pump 2 and compressor continue to run. <p>Pump 1 = Consumer pump Pump 2 = Evaporator pump Chiller switches off.</p> <p>Pump 1 = Consumer pump Pump 2 = Redundant</p> <ul style="list-style-type: none"> - Pump 1 switches off, - Pump 2 switches on. <p>Alarm is saved. Manual reset,</p>
613	Flow, start pump 1	Group fault alarm	Flow switch did not switch through after the pump start-up phase	Flow too low	Check flow, check shut-off valves, check pump, check the setting of the reed contact at the flow monitor	<p>Pump 1 & 2 = Consumer pump</p> <ul style="list-style-type: none"> - Pump 1 switches off, - Pump 2 and compressor continue to run. <p>Pump 1 = Consumer pump Pump 2 = Evaporator pump Chiller switches off.</p> <p>Pump 1 = Consumer pump Pump 2 = Redundant</p> <ul style="list-style-type: none"> - Pump 1 switches off, - Pump 2 switches on. <p>Alarm is saved. Manual reset,</p>
614	Flow, pump 1 oper.	Group fault alarm	Flow switch did not switch through during the pump operating phase	Flow too low	Check flow, check shut-off valves, check the setting of the reed contact at the flow monitor	<p>Pump 1 & 2 = Consumer pump</p> <ul style="list-style-type: none"> - Pump 1 switches off, - Pump 2 and compressor continue to run. <p>Pump 1 = Consumer pump Pump 2 = Evaporator pump Chiller switches off.</p> <p>Pump 1 = Consumer pump Pump 2 = Redundant</p> <ul style="list-style-type: none"> - Pump 1 switches off, - Pump 2 switches on. <p>Alarm is saved. Manual reset,</p>

Error code	Display view	Type of message	Message description	Cause of the message	Troubleshooting	Reaction of the chiller
615	DI mpcb Pump 2	Group fault alarm	Motor protection switch has tripped	Motor current above the permissible range, Motor runs only on two phases, direction of rotation, poor contact at clip points, Winding fault, earth fault, rotor blocked.	Check the motor power consumption, check the operating point, check the electrical connection of the components	Pump 1 & 2 = Consumer pump - Pump 2 switches off, - Pump 1 and compressor continue to run. Pump 1 = Consumer pump Pump 2 = Evaporator pump - Pump 2 and compressor switch off, - Pump 1 runs up to outlet temperature Max Stop continues. Pump 2 = Consumer pump Pump 1 = Redundant - Pump 2 switches off, - Pump 1 switches on. Alarm is saved. Manual reset,
617	Flow, start pump 2	Group fault alarm	Flow switch did not switch through after the pump start-up phase	Flow too low	Check flow, check shut-off valves, check pump, check the setting of the reed contact at the flow monitor	Pump 1 & 2 = Consumer pump - Pump 2 switches off, - Pump 1 and compressor continue to run. Pump 1 = Consumer pump Pump 2 = Evaporator pump - Pump 2 and compressor switch off, - Pump 1 runs up to outlet temperature Max Stop continues. Pump 2 = Consumer pump Pump 1 = Redundant - Pump 2 switches off, - Pump 1 switches on. Manual reset, Alarm is saved.
618	Flow, pump 2 oper.	Group fault alarm	Flow switch did not switch through during the pump operating phase	Flow too low	Check flow, check shut-off valves, check the setting of the reed contact at the flow monitor	Pump 1 & 2 = Consumer pump - Pump 2 switches off, - Pump 1 and compressor continue to run. Pump 1 = Consumer pump Pump 2 = Evaporator pump - Pump 2 and compressor switch off, - Pump 1 runs up to outlet temperature Max Stop continues. Pump 2 = Consumer pump Pump 1 = Redundant - Pump 2 switches off, - Pump 1 switches on. Alarm is saved. Manual reset,

Error code	Display view	Type of message	Message description	Cause of the message	Troubleshooting	Reaction of the chiller
619	DI mpcb pump freec.	Group fault alarm	Motor protection switch has tripped	Motor current above the permissible range, Motor runs only on two phases, direction of rotation, poor contact at clip points, Winding fault, earth fault, rotor blocked.	Check the motor power consumption, check the operating point, check the electrical connection of the components	all components continue to run Free cooling is stopped Fault is stored and must be reset manually
621	DI compressor 1 mpcb	Group fault alarm	Motor protection switch has tripped	Motor current above the permissible range, Motor runs only on two phases, direction of rotation, poor contact at clip points, Winding fault, earth fault, rotor blocked.	Check the motor power consumption, check the operating point, check the electrical connection of the components	Pumps continue to run the faulty compressor (KK) stops immediately the other compressors continue to run Fault is stored and must be reset manually
622	DI compressor 2 mpcb	Group fault alarm	S.h. MSS Compressor 1	S.h. MSS Compressor 1	S.h. MSS Compressor 1	S.h. MSS Compressor 1
623	DI compressor 3 mpcb	Group fault alarm	S.h. MSS Compressor 1	S.h. MSS Compressor 1	S.h. MSS Compressor 1	S.h. MSS Compressor 1
624	DI compressor 4 mpcb	Group fault alarm	S.h. MSS Compressor 1	S.h. MSS Compressor 1	S.h. MSS Compressor 1	S.h. MSS Compressor 1
627	DI high-pr. limiter	Group fault alarm	High-pressure limiter has tripped.	Unable to remove the waste heat of the refrigeration circuit. Cladding panels not completely fitted	Clean condenser and filter, test function of the fan, check cooling water circuit, Switch off the main switch, Press the Reset button Fit the metal cladding, switch on main switch and acknowledge at the display.	Pumps continue to run, Compressor (KK) stops immediately Fault is stored and must be reset manually
631	DI mpcb fan 1	Group fault alarm	Motor protection switch has tripped	Motor current above the permissible range, motor runs only on two phases, direction of rotation, poor contact at terminals, short circuit of windings, earth fault, rotor blocked.	Check the motor current consumption, check the operating point, check the electrical connection of the components	Pump and compressor continue running Compressor switches off via HD. Alarm is saved. Manual reset.
632	DI fault fan 1	Group fault alarm	Internal monitoring of the fan has tripped.	Motor runs only on two phases, direction of rotation, poor contact at terminals, short circuit of windings, earth fault, rotor blocked.	Check the motor current consumption, check the electrical connection of the components, check for mechanical blocking.	Pump and compressor continue running Compressor switches off via HD. Alarm is saved. Manual reset.

Error code	Display view	Type of message	Message description	Cause of the message	Troubleshooting	Reaction of the chiller
633	DI fan 1 fault	Group fault alarm	Internal monitoring of the fan has tripped.	Motor runs only on two phases, direction of rotation, poor contact at terminals, Short circuit of windings, earth fault, rotor blocked.	Check the motor current consumption, check the electrical connection of the components, check for mechanical blocking.	Pump and compressor continue running Compressor switches off via HD. Alarm is saved. Manual reset.
633	DI MSS fan 2	Group fault alarm	S.h. fan 1	S.h. fan 1	S.h. fan 1	S.h. fan 1
634	DI fault fan 2	Group fault alarm	S.h. fan 1	S.h. fan 1	S.h. fan 1	S.h. fan 1
635	DI MSS fan ESS	Group fault alarm	Motor protection switch has tripped	Motor current above the permissible range, motor runs only on two phases, direction of rotation, poor contact at terminals, short circuit of windings, earth fault, rotor blocked.	Check the motor current consumption, check the operating point, check the electrical connection of the components	All components continue running Freecooling is stopped. warning is saved. manual reset,
636	DI fault fan ESS	Group fault alarm	Internal monitoring of the fan triggered.	Motor runs only on two phases, direction of rotation, poor contact at terminals, short circuit of windings, earth fault, rotor blocked.	Check the motor current consumption, check the electrical connection of the components, check for mechanical blocking.	All components continue running Freecooling is stopped alarm is saved. manual reset,
641	DI mpcb tank heating	Group fault alarm	Circuit breaker has tripped.	Current above the permissible range, poor contact at clip points due to soiling or corrosion, Short-circuit between the heating rods, earth fault.	Check the electrical connection to the components, test for short to earth	all components continue to run Tank heater is deactivated Fault is stored and must be reset manually
642 644	DI STP tank heating	Group fault alarm	Safety temperature limiter of the tank heating has tripped	Tank temperature is too high, no water in tank, Trigger point of STP incorrectly set.	Check the tank temperature, check the level, check the tripping point of the STP	all components continue to run Tank heater is deactivated Fault is stored and must be reset manually



**Attention: Make sure that the cause of the fault has been eliminated before resetting fault messages.
Frequent resetting of fault signals without remedying the cause can cause permanent damage to the system!**

III. Maintenance intervals in accordance with the VDMA

	Explanation	Annual	Six-monthly	As required	Remark
	Compressor				
1	Optical check for dirt, damage and corrosion	x		x	
2	Check fixing, check running noises	x			
3	Measure the intake pressure	x			
4	Measure the suction gas temperature upstream of the compressor	x			
5	Measure the compression end temperature at the discharge port	x			
6	Check the oil level	x			
7	Check the acid content of the oil (acid test)			x	
8	Oil change			x	
9	Check that the crankcase heater is working	x			
10	Check that the output control is working	x			
11	Check the refrigerant side for leaks	x			
12	Check high/low pressure switching equipment	x			
	Air-cooled condenser				
20	Optical check for dirt, damage and corrosion	x		x	
21	Measure the condensing temperature	x			
22	Measure the refrigerant side supercooling temperature at the condenser outlet	x			
23	Measure the medium temperature at condenser inlet and outlet	x			
24	Check that the condensation pressure control is functioning properly	x			
25	Check the refrigerant side for leaks	x			
	Evaporator				
30	Optical check for dirt, damage and corrosion	x			
31	Measure refrigerant overheating temperature	x			
32	Measure the medium temperature at the evaporator inlet and outlet	x			
33	Measure the anti-freeze temperature (freezing point) of the heat transfer media	x			
34	Check the water and refrigerant side for leaks	x			

	Explanation	Annual	Six-monthly	as required	Remark
	Parts in the refrigeration circuit/water circuit				
40	Optical check for dirt, damage and corrosion	x	x		
41	Check insulation for damage	x			
42	Check filter dryer for blockage	x			
43	Replace filter dryer			X	If components in the refrigeration circuit are replaced
45	Check all pipes carrying refrigerant for corrosion and damage	x			
	Fans				
50	Optical check for dirt, damage and corrosion	x		x	
51	Check fixings and bearings	x			
52	Check flexible connection for tightness (electrical connection)	x			
	Pump and piping				
60	Optical check for dirt, damage and corrosion	x			
61	Check fixing parts and bearings	x			
62	Check the safety function of the safety switching devices	x			
63	Check pump/mechanical seal for leaks	x		x	
	Water filters				
70	Optical check for dirt, damage and corrosion	x		x	
71	Clean filters	x		x	
72	Check filters for damage	x			

No.:	Explanation	Annual	Six-monthly	as required	Remark
	Tank / water tank				
80	Optical check for dirt, damage and corrosion	x			
81	Check fixing	x			
82	Check level	x			
	Control cabinet				
90	Optical check for dirt, damage and corrosion	x		x	
91	Check fixing	x			
92	Check all threaded connections	x			
93	Check all indicator lights and error messages	x			
94	Check the temperature and pressure sensors are functioning properly	x			
95	Check the function of the motor protection switches	x			
96	Check 24 VDC and supply voltage	x		x	
97	Check control cabinet heater	x			
99	Check control cabinet filter and if necessary replace/clean	x			
	Documents and labelling				
110	All documents such as operating instructions, diagrams, circuit plans, system log are present	x		x	
111	Rating plate and labels are clearly legible	x		x	
	Battery - time/date				
120	Battery			x	Every 5 years
	Leakage control of the refrigeration circuit in accordance with (EC) 517/2014	x			

IV. Product registration

PDF download at: www.kkt-chillers.com/service/produktregistrierung